


DEPARTMENT OF PLANNING AND PERMITTING
KA 'OIHANA HO'OLĀLĀ A ME NĀ PALAPALA 'AE
CITY AND COUNTY OF HONOLULU

650 SOUTH KING STREET, 7TH FLOOR • HONOLULU, HAWAII 96813
PHONE: (808) 768-8000 • FAX: (808) 768-6041 • WEB: www.honolulu.gov/dpp

File

RICK BLANGIARDI
MAYOR
MEIA



DAWN TAKEUCHI APUNA
DIRECTOR
PO'O

JIRO A. SUMADA
DEPUTY DIRECTOR
HOPE PO'O

September 8, 2023

2022/ED-29(ST)

Ms. Mary Alice Evans
Director
State of Hawaii
Office of Planning and Sustainable Development
Environmental Review Program
235 South Beretania Street, Room 702
Honolulu, Hawaii 96813-2437

Dear Ms. Evans:

SUBJECT: Chapter 25, Revised Ordinances of Honolulu
Final Environmental Assessment (FEA)

Project: Ono Vista Condominium Wastewater Treatment System
Agent: Environmental Science International, Inc. (Stephanie Davis)

Location: 68-024 Apuhihi Street - Waialua

Tax Map Key: 6-8-011: 058

Proposal: Replacement of an existing wastewater treatment system with a new wastewater treatment plant consisting of the four above-ground, multi-chambered tanks (21- to 24-foot-long x 8-foot diameter) which use membrane bioreaction technology and ultraviolet light disinfection, and relocation of the emergency generator, and revision to three existing injection wells.

Determination: Finding of No Significant Impact (FONSI)

With this letter, the Department of Planning and Permitting (DPP) hereby transmits the FEA and FONSI for the subject Project located in the Special Management Area at the above location in the Waialua District, on the island of Oahu. Please publish this finding in the next edition of *The Environmental Notice*.

Based on the significance criteria outlined in Title 11, Chapter 200.1, Hawaii Administrative Rules, the DPP has determined that the preparation of an Environmental

Ms. Mary Alice Evans
September 8, 2023
Page 2

Impact Statement is not required. The FEA adequately discloses and describes relevant environmental impacts and responds to review comments received.

We have uploaded an electronic copy of this letter, a completed Office of Environmental Quality Control publication form, the FEA and FONSI to your online submittal site.

Should you have any questions, please contact Steve Tagawa, of our Land Use Approvals Branch, at (808) 768-8024 or via email at stagawa@honolulu.gov.

Very truly yours,

A handwritten signature in black ink, appearing to read 'Dawn', with a stylized flourish extending to the right.

Dawn Takeuchi Apuna
Director

From: webmaster@hawaii.gov
To: [DBEDT OPSD Environmental Review Program](#)
Subject: New online submission for The Environmental Notice
Date: Monday, December 11, 2023 1:41:10 PM

Action Name

Replacement Wastewater System for Ono Vista Condominiums

Type of Document/Determination

Final environmental assessment and finding of no significant impact (FEA-FONSI)

HRS §343-5(a) Trigger(s)

- (9)(A) Propose any wastewater treatment unit, except an individual wastewater system or a wastewater treatment unit serving fewer than fifty single-family dwellings or the equivalent

Judicial district

Waialua, O'ahu

Tax Map Key(s) (TMK(s))

(1)6-8-011: 058

Action type

Applicant

Other required permits and approvals

Special Management Area Use Permit

Discretionary consent required

Special Management Area Use Permit

Approving agency

Department of Planning and Permitting

Agency contact name

Steve H. Tagawa

Agency contact email (for info about the action)

stagawa@honolulu.gov

Email address or URL for receiving comments

stagawa@honolulu.gov

Agency contact phone

(808) 768-8024

Agency address

650 South King Street
Honolulu, Hawaii 96813
United States
[Map It](#)

Applicant

Ono Vista AOA

Applicant contact name

Ginger Gertsch

Applicant contact email

sdavis@esciencei.com

Applicant contact phone

(808) 261-0740

Applicant address

737 Bishop Street
Honolulu, Hawaii 96813
United States
[Map It](#)

Was this submittal prepared by a consultant?

Yes

Consultant

Environmental Science International, Inc.

Consultant contact name

Stephanie Davis

Consultant contact email

sdavis@esciencei.com

Consultant contact phone

(808) 768-8024

Consultant address

354 Uluniu Street
Kailua, Hawaii 96734
United States
[Map It](#)

Action summary

The Ono Vista Condominium Association of Apartment Owners (AOAO), proposes to replace the existing wastewater treatment system from the 1970s, with a new above-ground multi-chambered tanks which use membrane bioreaction technology. The existing system is beyond the typical service life of 40 years. The existing injections wells (3) are limited in capacity, so wastewater is currently pumped out and hauled off-site multiple times a week. An EA is required for wastewater systems which service at least 50 single-family dwelling or the equivalent units, and is also required as a prerequisite to the application for a Major SMA Use Permit to be processed by the Department of Planning and Permitting; with decision-making on the SMA application by the Honolulu City Council.

Reasons supporting determination

The proposed Project is not deemed significant pursuant to the 13 significance criteria set forth in Section

11-200.1-13, Hawaii Administrative Rules.

Attached documents (signed agency letter & EA/EIS)

- [FEAOnoVistaWWTW1.pdf](#)
- [OnoVistaFONSI.determination.pdf](#)

Shapefile

- The location map for this Final EA is the same as the location map for the associated Draft EA.

Action location map

- [OnoVistaLocation-Google-Maps.zip](#)

Authorized individual

Steve H. Tagawa

Authorization

- The above named authorized individual hereby certifies that he/she has the authority to make this submission.

**Final
ENVIRONMENTAL ASSESSMENT**

In Support of a Special Management Area Use Permit Application

**Ono Vista Condominiums
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street
Waialua, HI 96791**

TMK No. (1) 6-8-011:058



**Environmental Science International, Inc.
354 Uluniu Street, Suite 304
Kailua, Hawaii 96734
(808) 261-0740**

Final ENVIRONMENTAL ASSESSMENT

In Support of a Special Management Area Use Permit Application

**Ono Vista Condominiums
Wastewater Treatment Plant (WWTP) Replacement
68-024 Apuhihi Street
Waialua, HI 96791**

TMK No. (1) 6-8-011:058

Prepared for:

**Ono Vista Condominiums AOAO
68-024 Apuhihi Street
Waialua, HI 96791**

Prepared by:

**Environmental Science International, Inc.
354 Uluniu Street, Suite 304
Kailua, Hawaii 96734**

Project No. 122067

August 3, 2023

PROJECT SUMMARY

Project Name: Ono Vista Condominiums Wastewater Treatment Plant (WWTP) Replacement

Applicant/Fee Owner: Ono Vista Condominiums Association of Apartment Owners
Point of Contact: Ginger Gertsch
Community Association Manager – Oahu
Pacific Guardian Center – Mauka Tower
737 Bishop Street, Suite 3100
Honolulu, HI 96713
(808) 260-6003

Approving Agency: City and County of Honolulu
Department of Planning and Permitting
650 South King Street, 7th Floor
Honolulu, Hawaii 96813

Tax Map Key Parcels and Roads Potentially Affected: (1) 6-8-011:058 (Ono Vista Condominiums), 1.1859 acres
Waialua Beach Road, Apuhihi Street, Au Street

State Land Use District: Urban

Existing County Zoning: A-2 Medium Density Apartment

City Development Plan: North Shore Sustainable Communities Plan

Special Designation: Special Management Area

Determination: Finding of No Significant Impact

EXECUTIVE SUMMARY

This EA was prepared on behalf of the Ono Vista Condominiums AOA for replacement of the wastewater treatment system at the Ono Vista Condominiums, referred to as the Property. The Property is located at 68-024 Apuhihi Street, Waialua, Hawaii. The Property is identified as TMK No. (1) 6-8-011:058. The proposed project consists of replacing the existing aged wastewater system with a new WWTP that will be connected to the existing injection wells disposal system. The purpose of the EA is to determine whether or not the project has the potential to cause significant environmental impacts. The EA was conducted in accordance with the requirements of the Hawaii EIS Law (HRS Chapter 343 and HAR Chapter §11-200.1).

The applicant for construction of the WWTP is the Ono Vista Condominiums AOA. The approving agency for the proposed activity is the City and County of Honolulu DPP Land Use Permits Division, which is responsible for administering the Land Use Ordinance and other regulations pertaining to land use within the City. The EA is necessary because the project is within the SMA and requires an SMA Use Permit. In accordance with ROH Chapter 25, an EA and FONSI are required prior to applying for the SMA Use Permit. The EA is also required pursuant to HRS Section 343-5(9)(A) (propose any wastewater treatment unit serving at least 50 single-family dwellings or the equivalent).

The Property is zoned as *Urban* by the State and as *A-2 Medium Density Apartment* by the County and is located within the North Shore District of Oahu. The area is developed with condominiums and single-family residences. The Property is below the UIC line, at a surface elevation of approximately 4 feet amsl. The Property is located approximately 300 feet south of the Pacific Ocean. Locally, the topographic surface gradient is relatively flat.

For wastewater treatment, Ono Vista Condominiums currently utilizes a system consisting of an influent lift (pump) station, grease trap/preloader, sludge and aeration tank, clarifier tank, and chlorine contact chamber. Treated effluent is then discharged by gravity into three (3) active injection wells. The existing wastewater treatment system was installed in the 1970s and is beyond the typical service life of 40 years. The injection wells are limited in capacity and operators have resorted to contracting a pumping company to haul wastewater offsite multiple times a week.

The proposed WWTP will consist of the following:

- Existing Wet Well/Lift Station (belowground)
- Preloader/Equalization Tank (aboveground)
- Primary Treatment Tank/System (aboveground)
 - Integrated Clarifier Tank
 - Integrated Sludge Holding Tank
 - Electromagnetic Flowmeter
- UV Disinfection System
- Multiple Injection Well Disposal System (one (1) primary and one (1) 100% backup well and a third well for redundancy)

The new WWTP will be constructed in the current location of the existing wastewater treatment system, in the central portion of the Property. The system was designed based on the total amount of wastewater generated by Ono Vista Condominiums residents. The new WWTP is designed to accommodate a design maximum daily flow of 22,600 gpd and 1.5 factor for safety, which is a total of 35,000 gpd. The existing permitted injection wells will be upgraded and used for effluent disposal.

Most of the impacts for the proposed project are expected to be short-term and related to construction activities, such as storm water, noise, dust, and traffic. Efforts to minimize such impacts will be taken to the extent practicable. Long-term impacts are improved environmental conditions related to upgraded wastewater treatment, including a reduction in potential wastewater overflows.

Findings and Conclusions

Based on the analysis of information in this EA, it has been determined that the proposed WWTP will have no significant impacts to the natural, built, or social environment. The results of the EA were compared with the significance criteria established by the State under HRS 343 (HAR Chapter §11-200.1-13). It is concluded that the construction and operation of the proposed WWTP do not meet any of the thirteen criteria. By not meeting these criteria, it is appropriate that the proposed project be issued a FONSI and that an EIS not be required.

TABLE OF CONTENTS

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
SECTION 1	INTRODUCTION	1-1
1.1	Purpose.....	1-1
1.2	General Information.....	1-1
1.3	Property Description	1-1
1.4	Property Location and Setting.....	1-2
1.5	Project Background	1-2
1.6	Description of Existing Facility	1-2
1.7	Consultation and Review During EA Process	1-3
SECTION 2	PROPOSED PROJECT DESCRIPTION	2-1
2.1	Electrical Supply	2-2
2.2	Wastewater Disposal and Sampling	2-2
2.3	Estimated Cost and Timing Phase of Construction	2-3
2.4	Alternatives to the Proposed Project.....	2-3
SECTION 3	PLANS, PERMITS, POLICIES, AND CONTROLS.....	3-1
3.1	Environmental Policies, Plans, Permits, and Controls.....	3-1
3.2	Social and Economic Policies, Plans, and Controls	3-9
3.3	North Shore Sustainable Communities Plan	3-11
3.4	North Shore Regional Wastewater Alternatives Plan	3-13
3.5	Building, Grading, and Fire Permits	3-13
SECTION 4	PHYSICAL ENVIRONMENT AND POTENTIAL IMPACTS.....	4-1
4.1	Potential Land Impacts	4-1
4.2	Potential Water Impacts.....	4-3
4.3	Potential Biological Impacts.....	4-4
4.4	Potential Air Quality Impacts.....	4-6
4.5	Potential Noise Impacts.....	4-7
4.6	Climatological Conditions and Impacts	4-8
4.7	Potential Environmental Impacts	4-11
SECTION 5	SOCIAL ENVIRONMENT AND POTENTIAL IMPACTS	5-1
5.1	Land Use.....	5-1
5.2	Social and Economic Issues.....	5-1
5.3	Historic, Archaeological, and Cultural Resources	5-2

5.4	Visual and Aesthetic Appeal	5-3
5.5	Recreational Activities and Areas	5-3
SECTION 6	INFRASTRUCTURE AND POTENTIAL IMPACTS	6-1
6.1	Traffic and Roads	6-1
6.2	Utilities.....	6-2
SECTION 7	DETERMINATION.....	7-1
7.1	Findings and Reasons Supporting the Determination	7-1
SECTION 8	REFERENCES	8-1

LIST OF TABLES

<u>NUMBER</u>	<u>TITLE</u>	<u>PAGE</u>
Table 7.1	Evaluation of Significance Criteria	7-2

LIST OF FIGURES

<u>NUMBER</u>	<u>TITLE</u>
Figure 1	Regional Location and Topographic Map
Figure 2	Tax Map [TMK No. (1) 6-8-011:058]
Figure 3a	State Land Use Map
Figure 3b	City & County of Honolulu LUO Zoning Map
Figure 4	Site Location
Figure 5a	Site Plan
Figure 5b	Site Plan & Aerial Map
Figure 5c	WWTP Elevation
Figure 6	UIC Line and Well Location Map
Figure 7	USFWS Wetlands Map
Figure 8	Benthic Map
Figure 9	Relative Sea Level Change Scenarios for Honolulu
Figure 10	Sea Level Rise Exposure Map
Figure 11	Flood Hazard Map
Figure 12	Storm Surge Hazard Map

APPENDICES

<u>APPENDIX</u>	<u>TITLE</u>
A	Site Photographs
B	As-Built Drawings for Original Wastewater Treatment System
C	Basis of Design Engineering Report
D	UIC Injection Well Status Report
E	Comments and Responses
F	DOH Safe Drinking Water Branch Approval to Construct, Three Injection Wells

LIST OF ACRONYMS AND ABBREVIATIONS

<u>Acronym</u>	<u>Definition</u>
AFONSI	Anticipated Finding of No Significant Impact
amsl	above mean sea level
AOAO	Association of Apartment Owners
BFE	base flood elevation
BMP	Best Management Practice
CWB	Clean Water Branch
CZM	Coastal Zone Management
dba	A-weighted decibel
DOH	State of Hawaii Department of Health
DPP	Department of Planning and Permitting
EA	Environmental Assessment
EIS	Environmental Impact Statement
ERP	Environmental Review Program
ESI	Environmental Science International, Inc.
FONSI	Finding of No Significant Impact
FRP	Fiber reinforced plastic
GIS	Geographic Information System
gpd	gallons per day
HAR	Hawaii Administrative Rules
HECO	Hawaiian Electric Company
HICRIS	Hawaii Cultural Resource Information System
HRS	Hawaii Revised Statutes
iPaC	Information for Planning and Consultation
LSB	Land Study Bureau
LUO	Land Use Ordinance
mg/L	milligram per liter
MBBR	Moving Bed Biofilm Reactor
MBR	Membrane Bioreactors
NOAA	National Oceanic and Atmospheric Administration
NPDES	National Pollutant Discharge Elimination System
NSRWWAP	North Shore Regional Wastewater Alternatives Plan
NSSCP	North Shore Sustainable Community Plan
O&M	Operation and Maintenance
OEQC	Office of Environmental Quality Control
ROH	Revised Ordinances of Honolulu
SAAQS	State Ambient Air Quality Standards
SDWB	Safe Drinking Water Branch
SHPD	State Historic Preservation Division
SMA	Special Management Area
TMK	Tax Map Key
TSS	total suspended solids
UIC	Underground Injection Control
USACE	U.S. Army Corp of Engineers

Acronym

USDA

USFWS

WWTP

Definition

U.S. Department of Agriculture

U.S. Fish and Wildlife Service

Wastewater treatment plant

SECTION 1 INTRODUCTION

This report describes the Environmental Assessment [EA] performed by Environmental Science International, Inc. [ESI], on behalf of the Ono Vista Condominiums Association of Apartment Owners [AOAO] for replacement of the aged existing wastewater treatment system at the Ono Vista Condominiums, which is located at 68-024 Apuhihi Street in Waialua, Hawaii, hereinafter referred to as the “Property” (Figure 1). The Property is owned by Ono Vista and is identified by the City and County of Honolulu Property Assessment Division as Tax Map Key [TMK] No. (1) 6-8-011:058 (Figure 2). It is located on land zoned as *Urban* by the State of Hawaii (Office of Planning, 2022) (Figure 3a). Under the City and County of Honolulu’s Land Use Ordinance [LUO], the Property is zoned as *A-2 Medium Density Apartment* (Figure 3b).

1.1 PURPOSE

This assessment was undertaken to determine whether the project has the potential to cause significant environmental impacts. The assessment was conducted in accordance with the requirements of the Hawaii Environmental Impact Statement [EIS] Law, which are contained in Hawaii Revised Statutes [HRS] Chapter 343 (HRS 343; State of Hawaii Department of Health [DOH], 1974a) and in Hawaii Administrative Rules [HAR] Title 11, Chapter 200.1 (HAR §11-200.1; DOH, 2019b).

1.2 GENERAL INFORMATION

The replacement project consists of replacing the existing wastewater treatment system with a new wastewater treatment plant [WWTP] that will be connected to the existing permitted injection wells disposal system. The approving agency for the proposed activity is the City and County of Honolulu Department of Planning and Permitting [DPP] Land Use Permits Division, which is responsible for administering the LUO and other regulations pertaining to land use within the City. The EA is necessary because the project is located within the Special Management Area [SMA] and requires an SMA Use Permit. An EA and Finding of No Significant Impact [FONSI] are required prior to applying for the SMA Use Permit. The EA is also required pursuant to HRS Section 343-5(9)(A) (propose any wastewater treatment unit serving at least 50 single-family dwellings or the equivalent).

1.3 PROPERTY DESCRIPTION

Ono Vista Condominiums consists of two residential condominium buildings, containing 32 living units per building. The buildings were built in 1973 and each building includes five floors. The two buildings (Ono Vista West and Ono Vista East) are on the east and west of a shared parking lot and pool (Figure 4). Photographs depicting the current site conditions are provided in Appendix A.

The Property occupies 1.19 acres of land on the northern side of Oahu, and it lies within the SMA (Figure 4). The Property is bordered by residential properties on the north and south sides, to the west is Apuhihi Street and to the east is Au Street (Figures 2 and 4). Agricultural land is located to the south across Waialua Beach Road. A site plan depicting the layout of the Property is provided in Figures 5a and 5b.

1.4 PROPERTY LOCATION AND SETTING

The Property is located at latitude 21°35'11"N, longitude 158°08'21"W, within a residential, mixed-use area in the Waialua District of Oahu. The area is developed with condominiums and single-family residences. The Property is below the underground injection control [UIC] line, on the northern coast of Oahu, at a surface elevation of approximately 4 feet above mean sea level [amsl] (Figure 6). The Property is approximately 300 feet from the Pacific Ocean to the north. Locally, the topographic surface gradient is relatively flat.

The Property is located in flood hazard area Zone VE (Office of Planning, 2022). This area is subject to inundation by the 1% annual chance flood event, with increased risk due to storm waves. Flood Zone VE is a Special Flood Hazard Area where homeowners are required to buy flood insurance if they have a federally backed mortgage. More information on the flood hazard zone is provided in Section 4.6.2.2.

1.5 PROJECT BACKGROUND

For wastewater treatment, Ono Vista Condominiums currently utilizes a system consisting of an influent lift (pump) station, grease trap/preloader, sludge and aeration tank, clarifier tank, and chlorine contact chamber, before conveying treated effluent to three injection wells located in the Ono Vista East parking lot. The current system was installed in the 1970s and is beyond the typical service life of 40 years. The injection wells are limited in capacity and operators have resorted to contracting a pumping company to haul wastewater offsite multiple times a week. Ono Vista Condominiums initiated this project to evaluate various alternatives to upgrade/replace its existing wastewater treatment system. The recommendation is to replace the existing wastewater treatment system with a new, larger and robust WWTP and use the existing injection wells disposal system (after upgrading the wells).

1.6 DESCRIPTION OF EXISTING FACILITY

According to the DOH Wastewater Branch records, Ono Vista Condominiums generates 22,600 gallons per day [gpd] of average daily flow of domestic wastewater by residents of the Property.

The existing wastewater system receives influent from 6-inch sewer laterals from each building, and wastewater is collected by an existing 6-foot diameter wet well equipped with dual submersible lift pumps (i.e., lift station). The wet well/lift station functions as a trash tank for preliminary treatment of the wastewater influent before it is pumped to a grease trap/preloader, then flows into a sludge and aeration tank, followed by the clarifier and chlorine contact tank. Treated, chlorinated effluent is then discharged into three injection wells in the east parking lot. The existing wastewater treatment system and injection wells are near the Property's pool, which is in the middle of the Property (Figures 5a and 5b). As-built drawings for the original wastewater treatment system are provided in Appendix B.

Aboveground components of the existing facility include the generator inside the machine room adjacent to the Pool House, and the system control panel and aeration blowers, which are located inside the Pool House (see Appendix A: Photographs 6, 13, and 14; and preliminary design plans included in Appendix C).

The three existing injection wells were permitted through the DOH Safe Drinking Water Branch [SDWB] UIC Program, Permit No. UO-1305. Each injection well is a 4-inch diameter shallow injection well (approximately 29 to 50 feet deep) that operates under gravity head. Effluent data shows that treated effluent from the existing wastewater treatment system complies with UIC permit effluent standards (< 60 milligrams per liter [mg/L] biochemical oxygen demand and total suspended solids [TSS]). The most recent UIC Injection Well Status Report is provided in Appendix D.

1.7 CONSULTATION AND REVIEW DURING EA PROCESS

1.7.1 Pre-Assessment Consultation

During preparation of the Draft EA, pre-consultation letters were mailed to the following agencies and organizations in October 2022 to request initial comments on the proposed project:

City and County of Honolulu

- DPP*
- Board of Water Supply*
- Department of Environmental Services
- Office of Climate Change, Sustainability and Resiliency
- Honolulu Fire Department*
- Honolulu Police Department
- Department of Emergency Management
- Department of Transportation Services
- Department of Design and Construction*
- Council Member Heidi Tsuneyoshi - Honolulu City Council District 2
- Office of the Mayor

State of Hawaii

- DOH, Environmental Management Division
 - Clean Water Branch [CWB]*
 - SDWB
 - Wastewater Branch
 - Clean Air Branch
- Department of Land and Natural Resources
 - Division of Aquatic Resources*
 - Engineering Division*
 - Land Division – Oahu District
 - Division of Forestry and Wildlife*
 - Office of Conservation and Coastal Lands
 - State Historic Preservation Division [SHPD]
 - Commission on Water Resources Management
- Office of Hawaiian Affairs
- Office of Planning and Sustainable Development [OPSD]*
- Department of Transportation, Highways Division

Federal Agencies

- U.S. Fish and Wildlife Service [USFWS]*
- U.S. Army Corps of Engineers
- National Marine Fisheries Service
- U.S. Department of Agriculture [USDA]

Community Organizations

- North Shore Neighborhood Board No. 27*

The agencies marked with an asterisk (*) provided comments (or responded with no comments). Copies of the comments received from the agencies/organizations and the follow-up responses are included in Appendix E. Comments received from the agencies were addressed during preparation of the Draft EA.

1.7.2 Public Review of Draft EA

A notice of availability for the Draft EA and Anticipated Finding of No Significant Impact [AFONSI] was published by the State of Hawaii Environmental Review Program [ERP] in the February 8, 2023 issue of The Environmental Notice. The published notice initiated the statutory 30-day public review and comment period. Copies of the Draft EA and AFONSI were available at the Hawaii State Library and at the Waialua Public Library during the review and comment period, which ended on March 10, 2023.

The following agencies/individuals provided comments on the Draft EA:

- DPP
- Mr. Steve Holmes, Former Honolulu City Councilmember

Copies of the comments and the follow-up responses are included in Appendix E. Additional information to address the comments was incorporated into the Final EA, as appropriate.

SECTION 2 PROPOSED PROJECT DESCRIPTION

The proposed WWTP will consist of the following:

- Existing Wet Well/Lift Station (belowground)
- Preloader/Equalization Tank (aboveground)
- Primary Treatment Tank/System (aboveground)
 - Integrated Clarifier Tank
 - Integrated Sludge Holding Tank
 - Electromagnetic Flowmeter
- UV Disinfection System
- Multiple Injection Well Disposal System (belowground)
 - One (1) Primary Deep Injection Well
 - One (1) 100% Backup Well
 - One (1) Well for Redundancy (A primary backup and the other for redundancy)

The new WWTP components will all be constructed in the current location of the existing wastewater treatment system (Figures 5a, 5b, and 5c). The system was designed based on the total amount of wastewater generated by Ono Vista Condominiums residents. The system will be designed to accommodate a design maximum daily flow of 22,600 gpd and 1.5 factor for safety, which is a total of 35,000 gpd. The wastewater computations are provided in the *Basis of Design Engineering Report* included as Appendix C.

Wastewater from the sewer laterals will be conveyed to the existing belowground wet well (lift station), which is equipped with dual submersible lift pumps that will pump the wastewater to the new preloader/equalization tank. The existing wet well and preloader will continue to separate inorganics as well as solids from the process flow.

The new preloader/equalization tank will be an 8,000 gallon two-compartment fiber reinforced plastic [FRP] tank with dual submersible pumps. The sediments/solids will settle in the first compartment of the tank and the second compartment will act as an equalization basin for flow equalization. The wastewater will then be pumped directly to the Kubota Technologies Johkasou System.

The Kubota Johkasou Package Treatment System incorporates the use of membrane bioreactors [MBRs] and by immersing membrane cartridges in an activated sludge basin, MBRs combine membrane technology with the biological process. High-standard treatment is completed in a single basin, replacing the traditional clarifier and filters required for tertiary treatment. Microorganisms are captured by the membranes' pore apertures, which range from 0.01 to 0.1 microns, lowering their concentration in the effluent. The membrane sheet for the Kubota Johkasou system is made from chlorinated polyethylene and features high porosity to enable high flow and is thicker than other membranes to provide durability. The Kubota Johkasou system will include a sludge holding tank at the end of the multi-stage process. The Kubota treatment system meets the requirements of HAR Chapter 11-62, Subchapter 2 WWTP. Effluent from the Kubota system will be treated to a maximum of 30 mg/L

in Biochemical Oxygen Demand, 5-day concentration and 30 mg/L in TSS. Manufacturer's literature and diagrams for the Kubota Johkasou system are provided as an attachment in Appendix C.

The existing emergency generator, which is located in the machine room attached to the Pool House, will be moved inside the Pool House, and the machine room will be demolished. The primary/standby blowers and WWTP control panels will also be installed inside the Pool House. A separate utility enclosure may be necessary should all components of the generator, blowers, and control panels not fit within the back room of the existing Pool House. The existing Pool House is a non-occupied structure. The existing 6-foot-high wooden fence with a locking access door will be retained and reinstalled around the perimeter of the WWTP tanks to limit access to the public.

Aboveground components of the new WWTP include the four Kubota FRP treatment tanks, which will be installed on four individual concrete pads, and the generator, blowers, and control panels contained in the back room of the existing Pool House. Dimensions of the four Kubota FRP treatment tanks are as follows:

- Tank 1 (1st Equalization Tank): 24.1'L x 8.2'W x 10.2'H
- Tank 2 (2nd Equalization Tank + Sludge Holding Tank): 24.1'L x 8.2'W x 10.2'H
- Tank 3 (Anoxic Tank): 20.7'L x 8.2'W x 10.2'H
- Tank 4 (MBR Tank + Disinfection & Effluent Tank): 24.6'L x 8.2'W x 10.2'H

Water conservation improvements, such as installation of low-flow water fixtures and toilets in several units, have already been initiated by the Ono Vista AOA. These conservation improvements will continue to be implemented in the remaining units in conjunction with the proposed WWTP.

2.1 ELECTRICAL SUPPLY

The electrical service will be provided by Hawaiian Electric Company [HECO] through a branch circuit from the Ono Vista Condominiums Circuit. The electrical components of the new WWTP will be connected to the existing onsite 208-volt three phase electrical lines.

Emergency power will be provided by a diesel generator or equivalent equipment. The existing diesel generator is planned to be used unless it does not meet the power requirements for the WWTP. Power requirements will be evaluated by an electrical engineer, and if necessary, the existing generator will be replaced with a new diesel generator. The existing (or new) generator will provide backup power to the WWTP blowers, and existing wet well/lift station.

2.2 WASTEWATER DISPOSAL AND SAMPLING

Based on an average daily flow of 22,600 gpd and an estimated 469 gallons of sludge produced a day, the sludge holding tank of 1,550 gallons of total volume can retain 5 days of sludge for the WWTP with a sludge concentration of 1.1%. Local pump companies will be contracted to extract and haul away sludge from the sludge holding tank to the nearest wastewater treatment plant.

After passing through the UV disinfection system, treated effluent will be disposed in the existing injection wells. There will be one (1) primary injection well (IW1), one (1) 100% backup well (IW2), and one (1) redundancy well (IW3), each with a maximum depth of 100 feet.

All three wells will be connected to the WWTP and all can be controlled using gate valves. Treatment system operators and technicians can easily test the effluent by taking wastewater samples via an access point included in all the injection wells. Per HAR Chapter §11-62 requirement (DOH, 2016), each injection well should be designed to handle the peak flow. The primary injection well is designed to accommodate the total daily flow of 22,600 gpd. The two backup wells are designed to provide 100% backup disposal. A 100% redundancy is required by HAR Chapter §11-62 (DOH, 2016).

The DOH SDWB UIC Program has granted “approval to construct” for upgrading of the three existing injection wells by redrilling. A copy of the approval is provided in Appendix F.

As an alternative to disposal, the Ono Vista AOA is exploring opportunities to reuse the treated effluent for irrigation.

2.3 ESTIMATED COST AND TIMING PHASE OF CONSTRUCTION

The estimated cost for the proposed WWTP is \$1.5 to 2 million (depending on contractor costs), including professional services. The source of funding for the project will be provided through loans obtained by the Ono Vista AOA and a supplemental grant through the USDA Water & Environmental Program (application in progress). The proposed project will take approximately eight months after completion of the EA and receipt of the SMA Use Permit and all agency approvals.

2.4 ALTERNATIVES TO THE PROPOSED PROJECT

2.4.1 No Action

The “no action” alternative would consist of leaving the existing wastewater treatment system as is. However, as described in Section 1.5, the existing system is beyond its useful life and not functioning is intended, which could lead to a risk of future wastewater spills and impaired water quality. If no upgrades are made to the existing wastewater treatment system to replace ageing components, nearby communities, water quality, and public health in this area will be impacted. This alternative was not selected due to the negative impacts.

2.4.2 Postponed Action

The “postponed action” alternative would consist of postponing replacement of the existing wastewater treatment system until a future date. As with the “no action” alternative, this would increase the risk of future wastewater spills and resulting environmental and public health problems. Postponing construction of the project could result in fines from the DOH; therefore, this is not a feasible option.

2.4.3 Alternative Wastewater Treatment Systems

The following two alternative, available wastewater treatment systems were evaluated, and a comparative analysis was performed prior to the selection of the proposed WWTP. For comparison purposes, the estimated cost for the proposed Kubota MBR wastewater treatment system is \$635,000.

1. Smith & Loveless FAST® fixed-film, aerobic wastewater treatment system (fixed bed biological reactor). The system consists of an above grade pre-engineered, factory-built packaged treatment plant, approximately 40 feet long by 12 feet wide by 9 feet high. The FAST® media creates a high surface area-to-volume ratio, which, combined with internal settling zones, maintains contestant bacterial growth during low-flow and peak usage. Cost for parts only is estimated at \$1,235,000. This system was not selected due to the prohibitive capital costs, building footprint flexibility, and Operation and Maintenance [O&M] complexity.
2. World Water Works Moving Bed Biofilm Reactor (MBBR™) fixed-film, aerobic wastewater treatment system. The MBBR™ system consists of a tank with submerged, but freely moving, specially designed bio-media, an aeration manifold providing both dissolved oxygen and mixing, and a sieve to retain the bio-media in the tank. The tank is approximately 37.5 feet long by 8 feet wide by 8 feet high. Cost for parts only is estimated at \$1,430,000. This alternative was not selected due to the prohibitive capital costs and O&M life cycle costs.

2.4.4 Alternative Onsite or Offsite Locations

Due to the existing condominium buildings, pool, and parking lots, there is insufficient space for an alternative onsite location for the proposed WWTP. The adjacent properties are developed with condominiums and single-family residences; therefore, no offsite locations were considered.

SECTION 3 PLANS, PERMITS, POLICIES, AND CONTROLS

The proposed project is in compliance with required government and community plans, permits, policies, and controls. These are described below.

3.1 ENVIRONMENTAL POLICIES, PLANS, PERMITS, AND CONTROLS

3.1.1 Environmental Review Policy

The requirements for performing an EA are contained within the Hawaii EIS Law, which is set forth in HRS 343 (DOH, 1974a) and HAR Chapter §11-200.1 (DOH, 2019b). According to HRS 343, the purpose of the Hawaii EIS Law is to establish a system of environmental review to ensure that environmental concerns are considered in decisions made by the State of Hawaii. The intent of the law was to implement the requirements under the federal National Environmental Policy Act.

The Hawaii EIS Law is administered and regulated by the State of Hawaii ERP, formerly known as the Office of Environmental Quality Control [OEQC]. The ERP oversees the implementation of these regulations in order to assess the environmental, social, and economic consequences of a proposed development project prior to allowing construction to begin. The Hawaii EIS Law ensures the public the right to participate in planning projects that may affect their communities. The OEQC has issued guidelines for the environmental review process (OEQC, 2012).

Nine types of actions trigger the environmental review process under the Hawaii EIS Law. The proposed WWTP is subject to an environmental review under HRS Section 343-5(a)(9)(A): Propose any wastewater treatment unit, except an individual wastewater system or a wastewater treatment unit serving fewer than 50 single-family dwellings or the equivalent." In addition, development within the SMA is subject to the regulations of Chapter 25, Revised Ordinances of Honolulu [ROH], related to the SMA. In accordance with Section 25-3.3(c)(1), "any proposed development within the SMA requiring a SMA use permit shall be subject to an assessment by the agency in accordance with the procedural steps set forth in HRS Chapter 343" (City and County of Honolulu, 2021a). The project is a wastewater treatment unit and also requires an SMA Use Permit; therefore, the project is subject to the requirements of the Hawaii EIS Law.

3.1.2 Project Consistency with City and County of Honolulu Department of Planning and Permitting Land Use Ordinance

The following discussion includes an analysis of the proposed project consistency with the applicable City and County of Honolulu LUO included in Chapter 21, ROH: *Land Use Ordinance*.

Article 3: Establishment of Zoning Districts and Zoning District Regulations

Section 21-3.80 of the ROH establishes the purpose and intent of the Residential Districts. The Property is zoned for A-2: Medium Density Apartment use. According to ROH 21-3.80(c), "[t]he intent of the A-2 Medium Density Apartment district is to provide areas for medium density and multifamily dwellings. It is intended primarily for concentrated urban areas where public services are centrally located and infrastructure capacities are adequate" (City and County of Honolulu, 2021a). The proposed WWTP

upgrades would not affect the existing residential unit density or land use at the Property, or within the surrounding area. Therefore, the proposed project would be consistent with ROH Section 21-3.80(c).

Section 21-3.80-1 of the ROH establishes apartment district uses and development standards. Table 21-3.3 establishes the apartment development standards. The proposed project would not include any changes to the existing lot area, lot width or depth, and would not include any changes to the existing yard sizes. The project would not include additional improvements that would result in a total building area greater than the maximum allowed building area for A-2 zoning included in Table 21-3.3 (40 percent of zoning lot). The proposed project would not exceed the allowable height, height setbacks, or maximum floor area ratio density established for A-2 zoning. Figure 5a shows how the proposed development components would comply with the provisions of the ROH Section 21-3 standards.

Article 4. General Development Standards

The proposed project would comply with applicable sections of ROH 21-4: General Development Standards. The proposed project components are planned to be sited within a fenced area within the Property (same location of existing wastewater treatment system), with the injection wells in the parking lot, and would not encroach into yard or street setbacks, or conflict with any landscaping requirements. All proposed structures would comply with the maximum height allowed under A-2 zoning. Figure 5a shows how the proposed development components would comply with the provisions of the ROH Section 21-4 standards.

Articles 5 through 8 of the ROH are not applicable to the proposed project.

Article 9. Special District Regulations

The Property is located in the SMA and flood hazard area Zone VE. This area is subject to inundation by the 1% annual chance flood event, with increased risk due to storm waves. Flood Zone VE is a Special Flood Hazard Area where homeowners are required to buy flood insurance if they have a federally backed mortgage. More information on the flood hazard zone is provided in Section 4.6.2.2. The permit application for the proposed project improvements will be submitted to DPP and reviewed for compliance with the flood hazard areas ordinance in accordance with ROH 21-9.10: Developments in Flood Hazard Areas.

3.1.3 Special Management Area

The SMA is administered and regulated by the City and County of Honolulu DPP. The requirements and regulations can be found in HRS 205A and Chapter 25, ROH. The purpose of these requirements is to regulate development along shorelines to avoid permanent losses of valuable resources and to ensure that access to publicly owned and publicly used beaches, recreational areas, and natural reserves is provided. As noted above, projects within the SMA must undergo the procedural steps set forth in HRS 343 prior to an SMA Use Permit being issued.

Ono Vista Condominiums is in the process of preparing an SMA major permit application for the proposed WWTP described in Section 2. The permit application will be submitted following acceptance of the Final EA and issuance of a FONSI.

3.1.3.1 Special Requirements Applicable to Shoreline Lots

Construction or activity on land within the shoreline area is subject to the regulations of Chapter 23, ROH, related to Shoreline Setbacks. In accordance with Section 23-1.2(b), "it is the specific purpose of this chapter to establish standards and to authorize the department of land utilization to adopt rules pursuant to HRS Chapter 91, which generally prohibit within the shoreline area any construction or activity which may adversely affect beach processes, public access along the shoreline, or shoreline open space" (City and County of Honolulu, 2021a). The shoreline setback waiver line established by Chapter 23, ROH is defined as 75 feet inland from the presumed shoreline. The WWTP system will be approximately 300 feet from the shoreline (see Figure 4). The project is not within 75 feet of the presumed shoreline and therefore meets the shoreline setback requirements.

In accordance with ROH Section 25-6.3(a), "All exterior lighting on a shoreline lot shall be shielded to reduce the possibility that seabirds and other marine life forms may become disoriented and harmed by the lighting. Shielded exterior lighting shall be implemented both during and after any construction work on a shoreline lot. Any wall-mounted exterior lighting on buildings on a shoreline lot shall be shielded by wall directors or other acceptable shielding, and all shielding shall be specified on building permit plans. Artificial light from exterior lighting fixtures, including, but not necessarily limited to floodlights, uplights, or spotlights used for decorative or aesthetic purposes on a shoreline lot shall be prohibited if the light directly illuminates or is directed to project across property boundaries toward the shoreline and/or ocean waters, except as may otherwise be permitted by HRS Section 205A-71(b)" (City and County of Honolulu, 2021a). All exterior lighting associated with the project will be shielded and will be indicated on building permit plans. No artificial light will be directed to travel across the property boundary toward the shoreline.

In accordance with ROH Section 25-6.3(b), "All landscaped areas, landscaping, and irrigation on or for any shoreline lot shall be contained and maintained within the property boundaries of the shoreline lot of origin, and shall under no circumstances extend: (1) seaward of the shoreline as depicted on the current shoreline survey for the shoreline lot; or, in the event there is no current shoreline survey for the lot, seaward of the presumed shoreline; and (2) into any adjoining beach access right-of-way, public or private" (City and County of Honolulu, 2021a). The project does not include landscaping near the shoreline or a beach access right-of-way.

3.1.4 Water Pollution Control

Water pollution control requirements and regulations governing the Property are administered and regulated by the DOH CWB. The requirements and regulations are contained in HAR Chapters §11-54 and §11-55 (DOH, 2014b, 2019a). The purpose of these regulations is to prevent the discharge of contaminants into the navigable waters of the United States or adjoining shorelines.

The Property and the planned construction activities meet the State's *Antidegradation Policy* (HAR Section §11-54-1.1), which states that "existing uses and the level of water quality necessary to protect the existing uses shall be maintained and protected." By "existing uses," the policy refers to the existing uses of the receiving State water. In addition, the Property and the planned construction activities comply with the State's water quality standards (HAR Chapter §11-54), and the planned construction

activities will not adversely impact water quality. The project does not require a Section 401 Water Quality Certification (Title 40 CFR §122.2; HAR Chapter §11-54).

In addition to State water pollution control requirements and regulations, the City and County of Honolulu Rules Relating to Water Quality apply to all Development and Land Disturbing Activities within the City and County of Honolulu and establish minimum requirements for the selection, design, implementation and maintenance of Best Management Practices [BMPs] to protect the Municipal Separate Storm Sewer System and Receiving Waters from pollutants that are associated with land disturbance, surface hardening, and land use activities. The pollutants of concern addressed by these rules include, but are not limited to, sediment, nutrients, trash, pathogens, pesticides, oil, grease, hazardous waste, toxic waste, metals, and organic compounds (City and County of Honolulu, 2018a).

The project will comply with the prevailing Rules Relating to Water Quality. Appropriate BMPs will be used during construction of the WWTP to prevent the discharge of the aforementioned pollutants of concern into coastal waters. Specific mitigation measures to prevent pollution and protect water quality are discussed in Section 4.2.2. The project site is not connected to the City's Municipal Separate Storm Sewer System.

3.1.4.1 Water Quality

Water quality in the State of Hawaii is under the oversight of the DOH CWB. According to the CWB (State of Hawaii CWB, 2022), its mission is as follows.

“The mission of the CWB is to protect the public health of residents and tourists who recreate in and on Hawaii's coastal and inland water resources, and to also protect and restore inland and coastal waters for marine life and wildlife. The mission is to be accomplished through statewide coastal water surveillance and watershed-based environmental management through a combination of permit issuance, monitoring, enforcement, sponsorship of polluted runoff control projects, and public education.”

The objectives of the CWB are as follows.

1. Control point source discharges by issuing the appropriate National Pollutant Discharge Elimination System [NPDES] permits to maintain the designated uses of State receiving waters.
2. Ensure that permitted activities under Section 404 of the Clean Water Act will not adversely impact the designated uses of the State receiving waters.
3. Identify impaired water bodies and restore them to their designated uses.
4. Ensure expeditious compliance with the State water pollution rules.
5. Control polluted runoff through public and private partnerships.
6. Improve water quality in priority watersheds.
7. Develop appropriate Water Quality Standards.

The CWB is particularly concerned with the beneficial uses of State waters. Some examples include the capturing and reuse of storm water runoff so that (1) important groundwater resources can be replenished, rather than having storm water discharge directly to the ocean, and (2) landscaping and crops can be irrigated, rather than using potable water resources for irrigation. Other examples include the reuse of greywater and the protection of coastal waters from contamination caused by non-point source runoff.

Construction of the proposed project will be in accordance with State and Federal water quality regulations. The proposed project will not change the impervious surface area at the Property and therefore will not cause an increase in runoff quantities. The injection wells associated with the proposed project are already permitted by the DOH SDWB (see Section 3.1.4.3).

3.1.4.2 Storm Water Associated With Construction Activity

The project will not disturb more than an acre of land and, therefore, does not require an NPDES permit for discharges of storm water associated with construction activity.

3.1.4.3 Drinking Water Sources

The protection of Hawaii's drinking water sources is under the oversight of the DOH SDWB. According to the SDWB (State of Hawaii SDWB, 2022), its mission is as follows.

“The mission of the SDWB is to safeguard public health by protecting Hawaii's drinking water sources (surface water and groundwater) from contamination and assure that owners and operators of public water systems provide safe drinking water to the community. This mission is accomplished through the administration of the Safe Drinking Water Program, UIC Program, Groundwater Protection Program, and the Drinking Water State Revolving Fund.”

The UIC program serves to protect the quality of Hawaii's underground sources of drinking water from chemical, physical, radioactive, and biological contamination that could originate from injection well activity. Underground injection wells are wells used for injecting water or other fluids into a groundwater aquifer. HAR Chapter §11-23 (DOH, 1992) provides conditions governing the location, construction, and operation of injection wells so that injected fluids do not migrate and pollute underground sources of drinking water.

The Property is located below (makai of) the UIC line, indicating that the underlying shallow aquifer is not considered a drinking water source. Approval from the SDWB's UIC program was obtained for installation and operation of the three existing injection wells associated with the proposed project (UIC permit No. UO-1305).

According to the Mink and Lau Aquifer Classification, the Property is located on two aquifers. Both aquifers are classified on the *North* aquifer sector of the *Waialua* aquifer system. The two aquifers are both currently in use, the upper aquifer is of ecological importance and the lower aquifer is for drinking water, both are irreplaceable and have low salinity. The Property is not located within the *North-Central Oahu Basal Aquifer*.

3.1.5 Wastewater System

Wastewater system requirements and regulations are administered and regulated by the DOH Wastewater Branch. The requirements and regulations can be found in HAR Chapter §11-62 (DOH, 2016). The purpose of these regulations is to ensure that the use and disposal of wastewater and wastewater sludge do not contaminate or pollute valuable water resources, do not give rise to public nuisance, and do not become a hazard or potential hazard to public health, safety, and welfare. The proposed WWTP design plans and specifications must be reviewed and approved by the DOH Wastewater Branch prior to construction and must conform to applicable provisions of HAR Chapter §11-62.

3.1.6 Air Quality Standards

Air quality standards are administered and regulated by the DOH Clean Air Branch. The requirements and rules can be found in HAR Chapters §11-59 (DOH, 2001) and §11-60.1 (DOH, 2014a). The purpose of these standards is to protect public health and welfare and to prevent significant deterioration of air quality.

The proposed project is not anticipated to be a significant source of air pollution. Construction and operation of the WWTP will be required to comply with all applicable air quality standards. The potential impacts to air quality are addressed in Section 4.4.

3.1.7 Coastal Zone Management

The purpose of the Hawaii Coastal Zone Management [CZM] Program (HRS 205A; Office of Planning, 1977) is to provide for the effective management, beneficial use, protection, and development of the coastal zone. The CZM area encompasses all lands of the State and the offshore area out to the limit of the State's police power and management authority. The CZM Program's objectives and policies include recreational resources, historic resources, scenic and open space resources, coastal ecosystems, economic uses, coastal hazards, development management, public participation, beach protection, and marine resources.

The Property is within the CZM area and the proposed project conforms to CZM Program objectives and policies, as it will not have any significant impacts or conflict with the resources and activities associated with the CZM Program, as described below.

3.1.7.1 Recreational Resources

The proposed project will not generate additional demands on existing public parks or beaches. It will not restrict access to or adversely affect the existing coastal recreational resources or their uses by the public. Thus, the proposed WWTP is not in conflict with the State's objective of providing coastal recreational opportunities that are accessible to the public. The potential impacts to recreational resources are addressed in Section 5.5.

3.1.7.2 Historic Resources

The proposed project is not located in an area where there are man-made or natural historic resources. Thus, the proposed WWTP is not in conflict with the State's objective of protecting, preserving, and restoring historic and prehistoric resources that are significant in Hawaiian and American history and culture. The potential impacts to historical and cultural resources are addressed in Section 5.3.

3.1.7.3 Scenic and Open Space Resources

The proposed project is not located along the coastline and there are no open views to the ocean from the Property due to the presence of other existing buildings and homes in the area. The proposed WWTP is not in conflict with the State's objective of protecting, preserving, restoring, or improving the quality of coastal scenic and open space resources. The potential impacts to visual and aesthetic appeal are addressed in Section 5.4.

3.1.7.4 Coastal Ecosystems

The proposed project is not located in an area where there are sensitive coastal ecosystems that could be threatened. Operation of the proposed WWTP will mitigate future potential spills of wastewater that could possibly reach the nearby coastal waters. Thus, the proposed WWTP is not in conflict with the State's objective of protecting valuable coastal ecosystems from disruption and minimizing adverse impacts to coastal ecosystems. The potential impacts to coastal ecosystems are addressed in Section 4.3.

3.1.7.5 Economic Uses

The proposed project is not located in an area where there are economic uses that could be threatened. Thus, the proposed WWTP is not in conflict with the State's objective of providing public or private facilities and improvements important to the State's economy in suitable locations. Land use and economic issues are addressed in Sections 5.1 and 5.2.

3.1.7.6 Coastal Hazards

The proposed project is located in an area where there are coastal hazards and it potentially could be threatened by tsunamis or by potential hazards related to climate change, such as sea level rise. The proposed WWTP is unlikely to be threatened by storm waves, flooding, erosion, subsidence, or pollution from coastal sources. The proposed WWTP is not in conflict with the State's objective of reducing the hazards to life and property posed by tsunami, storm waves, stream flooding, erosion, subsidence, and pollution. The potential impacts posed by coastal hazards, including sea level rise, are addressed in Section 4.6.

3.1.7.7 Managing Development

The proposed project is located in an area where there is little ongoing development. The proposed WWTP is not a significant coastal development and is not in conflict with the State's objective of

improving the development review process, communication, and public participation in the management of coastal resources and hazards.

3.1.7.8 Public Participation

State and City permits and approvals required by the proposed project include provisions for public participation and ensure protection of coastal resources. The public was provided the opportunity to participate in the review of the Draft EA and provide comments, as discussed in Section 1.7.2. Thus, the proposed WWTP is not in conflict with the State's objective of stimulating public awareness, education, and participation in coastal management.

3.1.7.9 Beach Protection

The proposed project will not adversely impact beaches for public use and recreation. Thus, the proposed WWTP is not in conflict with the State's objective of protecting beaches for public use and recreation. The potential impacts to coastal waters and recreational resources are addressed in Sections 4.2 and 5.5.

3.1.7.10 Marine Resources

The proposed project is not anticipated to affect marine resources. The long-term impacts of the proposed project will be beneficial to near shore water quality and marine habitat. Thus, the proposed WWTP is not in conflict with the State's objective of promoting the protection, use, and development of marine and coastal resources to ensure their sustainability. The potential impacts to these resources are addressed in Sections 4.2 and 4.3.

3.1.8 State Environmental Policy

The State Environmental Policy was developed to establish a policy that will encourage productive and enjoyable harmony between people and their environment, promote efforts to prevent or eliminate damage to the environment and the biosphere, stimulate the health and welfare of humanity, and enrich the understanding of the ecological systems and natural resources important to the people of Hawaii (HRS 344; DOH, 1974b). One of the mandates of the policy is to conserve natural resources so that natural resources, such as land, water, mineral, visual, and air, are protected by controlling pollution, by preserving or augmenting natural resources, and by safeguarding the State's natural environmental characteristics.

The proposed project does not conflict with the State Environmental Policy. The proposed replacement of the existing wastewater treatment system will provide better protection of the natural resources and is anticipated to positively impact land, air, and water quality by mitigating potential pollution due to wastewater spills. The environmental resources identified in the area and the potential impacts to these resources are addressed in Section 4.

3.1.9 Flood Hazard Areas

Because the proposed project is located in a flood hazard area (Zone VE), it is subject to the provisions of Chapter 21A, ROH (Flood Hazard Areas), which imposes restrictions on construction in areas subject to flood hazards in order to protect life and property and reduce public costs for flood control, rescue, and relief efforts. The project will comply with the applicable provisions and development standards of Chapter 21A, ROH. Specific mitigation measures to minimize damage from flood hazards are discussed in Section 4.6.2.3.

3.1.10 Climate Change

The *Sea Level Rise Vulnerability and Adaptation Report* was mandated initially by Act 83 in 2014 and expanded by Act 32 in 2017 (Hawaii Climate Change Mitigation and Adaptation Commission, 2017). The initiative expands previous efforts to protect the State's economy, health, environment, and way of life from the impacts of climate change. The Hawaii Climate Commission is the State's body leading this initiative and the Climate Change Commission is the City's leading body.

In June 2018, the City and County of Honolulu adopted the *Sea Level Rise Guidance* document (City and County of Honolulu, 2018b), which provides findings and recommendations with regard to adapting to sea level rise. In July 2018, the Mayor issued a directive that establishes policies for the City and County to address, minimize the risks from, and adapt to the impacts of climate change and sea level rise (City and County of Honolulu, 2018c). The Mayor's directive notes that a 3.2-foot sea level rise would impact 9,400 acres of land, cause \$12.9 billion in lost property values, and affect 13,300 residents, 3,880 structures, and 17.7 miles of roadways. The recommendations from the report and guidance are addressed in Section 4.6.

3.2 SOCIAL AND ECONOMIC POLICIES, PLANS, AND CONTROLS

3.2.1 Hawaii State Plan

The Hawaii State Plan, which is set forth in the *Hawaii State Planning Act* (HRS 226; Office of Planning, 1978), is a comprehensive, long-term plan that identifies the goals, objectives, policies, and priorities for the State. It provides guidelines for growth, development, and the allocation of State resources. The plan contains diverse policies and objectives on topics of State interest, including the population, the economy (e.g., agriculture, the visitor industry), the physical environment (e.g., natural resources, historic resources, quality of the environment), facility systems (e.g., solid and liquid wastes, water, energy), socio-cultural advancement (e.g., housing, health, culture), and sustainability.

The proposed project is consistent with the goals, objectives, policies, and priority guidelines listed in the Hawaii State Plan, and directly supports multiple objectives and policies of the Plan by decreasing the risk of wastewater spills and protecting environmental resources. The most relevant sections of the Hawaii State Plan in relationship to the proposed project include the following: land-based, shoreline, and marine resources (HRS 226-11); land, air, and water quality (HRS 226-13); and facility systems – solid and liquid wastes (HRS 226-15). These sections are described below.

3.2.1.1 Land-Based, Shoreline, and Marine Resources

The proposed project is not in conflict with the State's two objectives.

1. Prudent use of Hawaii's land-based, shoreline, and marine resources.
2. Effective protection of Hawaii's unique and fragile environmental resources.

The proposed project will have no long-term negative impact on land-based, shoreline, or marine resources. No unique and fragile environmental resources have been identified in the area. The potential impacts to these resources are addressed in Section 4.

3.2.1.2 Land, Air, and Water Quality

The proposed project is not in conflict with the State's two objectives.

1. Maintenance and pursuit of improved quality in Hawaii's land, air, and water resources.
2. Greater public awareness and appreciation of Hawaii's environmental resources.

The proposed project will have no negative impact on land, air, or water resources. The potential impacts to these resources are addressed in Section 4.

3.2.1.3 Facility Systems - Solid and Liquid Wastes

The proposed project is not in conflict with the State's two objectives.

1. Maintenance of basic public health and sanitation standards relating to treatment and disposal of solid and liquid wastes.
2. Provision of adequate sewerage facilities for physical and economic activities that alleviate problems in housing, employment, mobility, and other areas.

The proposed project will replace the existing wastewater treatment system to provide improved treatment and disposal of solid and liquid wastes.

3.2.2 Hawaii State Land Use Controls and City and County of Honolulu Zoning Regulations

Land in the State of Hawaii is divided into the following four classifications: (1) urban, (2) agriculture, (3) rural, and (4) conservation. The project location is designated as an urban district. The urban district generally includes lands characterized by "city-like" concentrations of people, structures, and services. This district also includes vacant areas for future development. Generally, lot sizes and uses permitted in the district area are established by the respective county through ordinances or rules. The City and County of Honolulu zoning designation for the project location is *A-2 Medium Density Apartment*. According to the City and County of Honolulu LUO (Chapter 21, ROH), the intent of the A-2 Medium Density Apartment district is to provide areas for medium density, multifamily dwellings. It is intended primarily for concentrated urban areas where public services are centrally located and infrastructure

capacities are adequate. The proposed project is consistent with the prescribed land use classification and zoning regulations for the area.

3.2.3 Oahu General Plan

The Oahu General Plan (City and County of Honolulu, 2021b) is a comprehensive statement of objectives and policies that sets forth the long-range aspirations of Oahu's residents and the strategies to achieve them. It is the first tier of and lays the foundation for a comprehensive planning process that addresses physical, social, cultural, economic, and environmental concerns affecting the City and County of Honolulu. The most recent version of the plan was adopted by the City Council on December 1, 2021, as Resolution 21-023, CD1, and signed by the Mayor on January 14, 2022.

The Oahu General Plan seeks to protect and enhance Oahu's natural beauty and environmental attributes by mitigating against the degradation of these assets. The proposed project directly supports multiple objectives and policies listed in the General Plan. The key areas that will be addressed by the proposed project are *Housing and Communities* as well as *Transportation and Utilities*.

Under the *Housing and Communities* key area, Objective A, Policies 3 and 4 are relevant to the proposed project. The project will encourage more efficient use of land and infrastructure as well as support and encourage programs to maintain and improve conditions of existing housing.

Under the *Transportation and Utilities* key area, Objective B, Policies 3 and 6, and Objective C, Policies 1, 2, and 3 are relevant to the proposed project. The project supports Objective B, Policies 3 and 6 by utilizing a technology that provides waste disposal services at a reasonable cost and in a manner that addresses environmental and community impacts, and by providing safe, reliable, efficient, and environmentally sound waste disposal services that consider the near- and long-term impacts of climate change during the siting and construction. The project supports Objective C, Policies 1, 2, and 3 by upgrading a utility system to avoid major breakdowns and service interruptions, providing improvements to utilities in existing neighborhoods to reduce substandard conditions and increase resilience to use fluctuations, natural hazards, extreme weather, and other climate impacts, and facilitating timely and orderly upgrades and expansions of a utility system.

3.3 NORTH SHORE SUSTAINABLE COMMUNITIES PLAN

Oahu is divided into eight geographic planning areas and each area has developed a Development Plan or Sustainable Communities Plan that has been adopted by City Council ordinance. The North Shore Sustainable Communities Plan [NSSCP] (City and County of Honolulu, 2011) presents the vision for the North Shore region, which is to retain the unique qualities that have defined the region's attractiveness to locals and visitors alike and its natural, cultural, scenic, and agricultural resources. The NSSCP designates the project area as "Low Density Apartment" land use. The project area is also within the Community Growth Boundary, which was established to define, protect, and contain communities in areas that the General Plan designates "rural" and that exhibit the physical characteristics of rural lifestyles, as well as preserves the areas outside the boundary for agriculture, other resource, or open space values (City and County of Honolulu, 2011).

Guidelines for the Low Density Apartment developments include the following (Section 3.5.2.3; City and County of Honolulu, 2011):

- Maintain the existing apartment district boundaries.
- Densities range from 10 to 20 units per acre. Buildings should not be more than three stories or exceed 40 feet in height.
- Where possible, enhance the compatibility of development within apartment districts with adjacent residential uses.
- Employ building form, orientation, location of entries and landscape screening that reflects single-family residential character and provides greater privacy and individual identity for housing units.
- Ensure compatibility of building scale, roof form and the quality of materials with those of adjacent residential areas.

Overall, the proposed WWTP is consistent with the NSSPC's general policies and guidelines regarding land use. The proposed WWTP will have minimal impact on the area's rural character because it will be located adjacent to a current parking lot, in an area that already has two existing multi-story apartment buildings. The proposed WWTP is designed to have a height of approximately 11 feet above the level of the parking lot (concrete slab on grade plus tank height), which is well below the building height limit of 40 feet. The existing 6-foot-high wooden fence with a locking access door will be retained and reinstalled around the perimeter of the WWTP tanks to screen the WWTP from public view.

The NSSCP establishes policies and guidelines for infrastructure, including wastewater treatment. The specific policies that are applicable to the proposed project include the following (Section 4.3; City and County of Honolulu, 2011):

- The highest priority is to provide adequate public and private wastewater treatment facilities and improve the existing wastewater management services on the North Shore to protect the North Shore's water resources and the health of the community.
- Support alternative wastewater technologies that reflect the community's values and rural character.

The specific guidelines that are applicable to the project include:

- Identify appropriate areas and technologies for future wastewater facilities that maintain the rural character and are proportionate to future population projections.
- Do not permit an ocean outfall for treated wastewater effluent in the North Shore area.

The proposed WWTP is consistent with the NSSPC's general policies and guidelines regarding wastewater treatment. The current wastewater treatment system is aged and deteriorating and is in need of replacement. The proposed WWTP uses newer technologies and will provide better wastewater treatment and will reduce the risk of wastewater spills to nearshore waters.

3.4 NORTH SHORE REGIONAL WASTEWATER ALTERNATIVES PLAN

The North Shore Regional Wastewater Alternatives Plan [NSRWWAP] (Brown and Caldwell, 2012) was prepared for the City and County of Honolulu, to evaluate alternatives for wastewater collection, treatment, and disposal for the North Shore region due to concerns for public and environmental health. Section 6.5 (*Neighborhood Cluster System with Reuse*) and Section 6.6 (*Upgrading Existing Private or Municipal Wastewater Treatment Systems*) of the NSRWWAP describe and evaluate potential wastewater treatment alternatives for small or private wastewater treatment plants, similar to the proposed project. Section 6.5 discusses the potential for reuse of the treated effluent instead of disposal, and proposes the effluent could be used to irrigate landscape, parks, and playgrounds using subsurface drip irrigation.

The Ono Vista AOA is exploring opportunities to reuse the treated effluent for subsurface drip irrigation, either onsite or at the nearby Dole Private Beach Park.

3.5 BUILDING, GRADING, AND FIRE PERMITS

Prior to construction of the replacement WWTP at the Property, the necessary permits will be obtained from the appropriate State of Hawaii and City and County of Honolulu Agencies.

DOH, SDWB:

- *UIC Permit* No. UO-1305 has previously been issued for the installation and operation of the three existing injection wells. Approval to construct has been granted for upgrading of the three existing injection wells by redrilling. A copy of the approval is provided in Appendix F.

DOH, Wastewater Branch:

- Review of *Basis of Design Engineering Report and Plan Set for the New WWTP* for the design and construction of the WWTP.

City and County of Honolulu, Honolulu City Council:

- *SMA Use Permit* for the construction of the wastewater treatment system. The project location is within the SMA area, which extends inland from and along the shoreline. It is the most sensitive area of the coastal zone.

City and County of Honolulu, DPP:

- *Building/Grading Permit* for the construction of the wastewater treatment system (includes review by HECO, Board of Water Supply, and Honolulu Fire Department).

City and County of Honolulu Fire Department:

- *Tank Installation Permit* for the diesel tank associated with the emergency backup generator.

SECTION 4 PHYSICAL ENVIRONMENT AND POTENTIAL IMPACTS

Wastewater treatment facilities potentially can have negative impacts on the physical environment in which they are constructed and operated and on the surrounding area. One of the principal objectives of an EA is to assess whether such impacts could be significant. The areas of potential concern that have been identified regarding the construction and operation of the WWTP are as follows: (1) land impacts, (2) water impacts, (3) biological impacts, (4) air quality impacts, and (5) noise impacts. In addition, potential impacts related to climate change should be evaluated.

4.1 POTENTIAL LAND IMPACTS

4.1.1 Existing Topographic and Geological Conditions

The Property is located on a relatively flat coastal plain, at a surface elevation of approximately 4 feet amsl. There is no significant elevation change across the Property. No unique topographical features are located on the Property.

Oahu consists of the eroded remnants of three shield volcanoes, Kaena, Waianae, and Koolau. Kaena is the oldest of the three volcanoes and it was predominantly submarine (Sinton et al., 2014). The Property is located along the coastline on the western side of the Koolau volcanic shield (Koolau mountain range) and northeast of the Waianae volcanic shield (Waianae mountain range).

The principal lithologic unit underlying the Property consists of Holocene surficial beach deposits (Sherrod et al., 2007). These deposits consist of sand and gravel worked by surf into unconsolidated strand-line deposits along the coastline; chiefly cream-colored and calcareous in composition, derived from comminuted coral, shells, and foraminifera. They also contain minor sandstone, known in Hawaii as beach rock and typically form deposits parallel to the coast, in contrast to alluvium, that extends up drainages perpendicular to the coast.

The soil in the area of the Property belongs to the *Jaucas Series*, specifically *Jaucas sand*, which consists of excessively drained, calcareous soils that occur as narrow strips on coastal plains adjacent to the ocean. These soils developed in wind- and water-deposited sand from coral and seashells. They are nearly level to strongly sloping (Foote et al., 1972).

The Land Study Bureau (LSB) of the University of Hawaii prepared an inventory and evaluation of the State's land resources during the 1960s and 1970s. The Bureau grouped undeveloped lands in the State into homogeneous units of land types; described their condition and environment; rated the land on its overall quality in terms of agricultural productivity; appraised its performance for selected alternative crops; and delineated the various land types and groupings based on soil properties and productive capabilities. From these criteria, overall ratings of A through E were created; with A having the overall highest soil productivity rating and E having the lowest (University of Hawaii, 1972). The Property was omitted from the LSB study since it was already developed at the time of the study. Therefore, the Property does not contain any listed LSB rated soils. There are Type B rated LSB soils across Waiialua Beach Road, well inland of the Property. The proposed project would not result in any disturbance to these or any other LSB rated soils (Office of Planning, 2022).

4.1.2 Potential Topographic and Geological Impacts and Mitigation

Figure 5a shows the work areas where soil disturbance will occur, which corresponds to the area of the existing system to be demolished. The only area of subsurface excavation will be for regrading of the existing footprint to install concrete slabs for each of the four WWTP tanks. The area of disturbance is roughly a 30-foot by 70-foot area, or approximately 2,100 square feet. There will be no new trenches, as the existing sewer laterals will remain. Clean soil will be imported to backfill the area of the existing system following demolition. The project does not currently include offsite export of soil. However, if future plans entail partially burying the WWTP tanks, offsite soil export may be necessary.

Less than significant short-term impacts to ground topography and soils are anticipated from the proposed project. Minor short-term excavation and grading will be required during construction of the WWTP. *The City and County of Honolulu Stormwater Construction Best Management Practice [BMP] Manual* will be followed during construction, in addition to the provisions of the grading permit that will need to be obtained. Adherence to these regulatory guidelines, which would include protecting exposed soils from runoff through the use of filter socks, silt and dust fences, tarping soil stockpiles, and other appropriate BMPs, would mitigate potential impacts of soil erosion and fugitive dust during grading or excavation.

Future operation of the proposed WWTP will mitigate future potential spills of wastewater to the soils of the Property. There would be no long-term adverse impacts to site soils, topography, or geological resources from the proposed WWTP upgrades.

4.1.3 Existing Storm Water Conditions

The area of the proposed WWTP is where the current system is in place. The current space is a landscaped area and paved parking lot. There are no storm drains located in the parking lot. Storm water runs off the Property via surface sheet flow, southeast towards Au Street.

4.1.4 Potential Storm Water Impacts and Mitigation

Less than significant short-term impacts from storm water runoff are anticipated during construction. BMPs will be used during construction of the WWTP to prevent soil generated by construction activities from discharging beyond the project site as storm water runoff. Upon completion of construction activities, the area surrounding the WWTP will be restored to its previous condition.

There will be no impact to long-term storm water runoff quantities at the Property or the surrounding area compared to existing conditions due to the proposed project. All areas disturbed during construction will be planted with grass or covered with gravel or concrete in accordance with the building permits. The project will not increase impervious surfaces, except for the addition of concrete slabs for each of the four WWTP tanks. No parking spaces will be lost and the proposed project will comply with the landscaping requirement of a minimum five-foot landscape strip adjacent to any adjoining street right-of-way (Section 21-4, ROH). There will be no changes to existing surface water drainage patterns.

4.2 POTENTIAL WATER IMPACTS

Waters of potential concern in the area of the Property include (1) shallow groundwater, (2) coastal waters, and (3) deep, basal, drinking water. Of these, shallow groundwater and the coastal waters adjacent to the Property are the principal concerns.

4.2.1 Existing Hydrogeological Conditions

Groundwater in Hawaii exists in two principal types of aquifers. The first and most important type, in terms of drinking water resources, is the basal aquifer. The basal aquifer exists as a lens of fresh water floating on and displacing seawater within the pore spaces, fractures, and voids of the basalt that forms the underlying mass of each Hawaiian island. In parts of Oahu, including the area of the Property, groundwater in the basal aquifer is confined by the overlying caprock and is under pressure. Water that flows freely to the surface from wells that tap the basal aquifer is referred to as *artesian*.

The second type of aquifer is the caprock aquifer, which consists of various kinds of unconfined and semi-confined groundwater. The nearly impermeable sediments that form the caprock separate the caprock aquifer from the basal aquifer. The impermeable nature of these materials and the artesian nature of the basal aquifer severely restrict the downward migration of groundwater from the upper caprock aquifer.

Groundwater in the area of the Property is part of a basal aquifer within the *Waialua Aquifer System* of the *North Aquifer Sector* (Mink and Lau, 1990). The upper aquifer is classified as an unconfined aquifer that occurs in sedimentary nonvolcanic lithology. It is currently used and is ecologically important, but is not used as a drinking water source. It is highly vulnerable to contamination, is irreplaceable, and has low salinity. The lower aquifer is classified as a confined aquifer that occurs in flank lavas. It is currently used as a drinking water source. It has low vulnerability to contamination, is irreplaceable, and has low salinity.

Based on a review of well logs for deeper wells installed nearby, the caprock extends to approximately 93 feet below ground surface (University of Hawaii, 2022). Therefore, it is assumed that the basal drinking water aquifer in the area of the Property occurs at a depth of 93 feet or greater. The direction of groundwater flow in the area is most likely to the north, towards the Pacific Ocean. Shallow groundwater at the Property may be tidally influenced based on its proximity to the ocean.

The nearest drinking water supply well is approximately 2 miles southeast and upgradient of the Property, and there are no water wells of any kind downgradient (Figure 6). Based on the distance and direction to the nearest drinking water supply wells and the depth to the basal (drinking water) aquifer, it is unlikely that contaminants originating at the Property have impacted or could impact drinking water sources.

The coastal waters adjacent to the Property are classified as Class A, which precludes any discharge which has not received the best degree of treatment or control compatible with the criteria established for this class. The specific criteria applicable to marine waters are included in HAR Chapter §11-54 (DOH, 2014b).

4.2.2 Potential Hydrogeological Impacts and Mitigation

The proposed WWTP is anticipated to have no adverse impacts on shallow groundwater or the basal (drinking water) aquifer. There will likely be beneficial water quality impacts since the new WWTP will retain and treat wastewater more effectively compared to the existing treatment system. The proposed WWTP design will far surpass the regulatory compliance requirements which will provide much improved treatment of solid and liquid wastes. The effluent that will be disposed in the injection wells must meet the requirements of HAR Chapter §11-62, “Wastewater Systems” (DOH, 2016).

The proposed WWTP is anticipated to have no adverse impacts on coastal waters. The proposed project will not cause an increase in runoff quantities, nor increase the volume of treated wastewater effluent. Construction and operation of the WWTP will be conducted in accordance with the State’s water quality standards (HAR Chapter §11-54). During construction, barriers (e.g., sediment fences, silt screens, bags, or environmental filter socks) will be used as needed to limit sediment and land-based sources of pollution from discharging into the coastal waters. Operation of the proposed WWTP will mitigate future potential spills of wastewater that could possibly reach the nearby coastal waters. Based on communication with the DOH CWB, an NPDES permit is not currently required for the disposal of treated wastewater via the injection wells. However, the CWB indicated they are currently working on regulations for subsurface discharges into State waters in light of the Supreme Court decision regarding Lahaina Wastewater Treatment Plant. When DOH CWB determines the designating factors for a functional equivalent of a direct discharge, affected facilities will be notified that NPDES permit coverage is required. A copy of the correspondence with the DOH CWB is included in Appendix E. Additionally, due to the oxygen supplied for the biological process within the treatment system, complete nitrification is anticipated based on the system design. The long-term impacts of the proposed project will be beneficial to near shore water quality and marine habitat.

4.3 POTENTIAL BIOLOGICAL IMPACTS

There are numerous recognized ecosystems in Hawaii. Because so many Hawaiian species are highly specialized, populations are small and many of Hawaii’s plants and animals are listed as threatened or endangered species by the USFWS. For the purposes of this EA, the following three biological communities of potential concern in the area of the Property have been identified: (1) floral, (2) faunal, and (3) marine.

4.3.1 Existing Biological Conditions

4.3.1.1 Floral (Plant Communities)

The project site is situated within a coastline residential area of Waiialua. The Property was entirely graded during its development in the mid-1970s. There are no native rare or endangered floral species found on the Property; therefore, the proposed project will not adversely affect endangered or threatened plant species. The State of Hawaii Geographic Information System [GIS] “threatened and endangered plants map” and “critical habitat map” show little to no threatened and endangered species are currently found within the Property (Office of Planning, 2022).

The USFWS Critical Habitat for Threatened and Endangered Species online GIS map was also reviewed. No critical habitats were present at or surrounding the Property (USFWS, 2022b). The USFWS Wetlands Inventory Mapper was also reviewed in order to determine if wetland species habitats may be present at or surrounding the Property. No inland wetlands were identified within the vicinity of the Property (USFWS, 2022c) (Figure 7).

Based on a review of the USDA Natural Resources Conservation Services soil map and soil description for where the project site is located, the soil type present is *Jaucas sand*. *Jaucas sand* is not considered important farmland or wetland soil types. This type of soil has a slope of 0 to 15 percent, is excessively drained, and categorized as low runoff class.

4.3.1.2 Faunal (Animal Communities)

Wildlife in the area of the Property is limited to mammals and birds which have adapted to the urban environment. The State of Hawaii GIS critical habitat map shows no Federal or State listed or candidate threatened or endangered animal species currently within the Property (Office of Planning, 2022).

According to the USFWS' Information for Planning and Consultation [IPaC] tool, the USFWS noted that federal data indicate a federally endangered Hawaiian hoary bat (*Lasiurus cinereus semotus*), Band-rumped Storm-petrel (*Oceanodroma castro*), Hawaii Akepa (*Loxops coccineus*), Hawaiian Duck (*Anas Wyvilliana*), Hawaiian Common Gallinule (*Gallinula galeata sanvicensis*), Hawaiian Coot (*Fulica americana alai*), Hawaiian Petrel (*Pterodroma sandwichensis*), Hawaiian Stilt (*Himantopus mexicanus knudseni*), and the Newell's Townsend's Shearwater (*Puffinus auricularis newelli*) (USFWS, 2022a). However, there is no known habitat for these species on the Property (USFWS, 2022b).

4.3.1.3 Marine (Ocean Floral and Faunal Communities)

The offshore area north of the Property is characterized by expansive reefs. According to the State GIS benthic habitat map, just offshore, the benthic waters consist of a large 10-50% macroalgae zone. No live coral reefs are present in the shallow reef flat. The reef flats are classified as "Pavement" (Office of Planning, 2022) (Figure 8).

In addition, the Property is located approximately 300 feet from the Pacific Ocean; therefore, no threatened or endangered marine species are present in the vicinity of the Property, including the federally threatened green sea turtle (*Chelonia mydas*).

4.3.2 Potential Biological Impacts and Mitigation

There would be a less than significant impact to biological resources from the proposed project. None of the plants within the Property are known to be Federal or State threatened or endangered or candidate species. Since the Property is developed and mostly paved or covered by buildings, there is no known habitat for the Hawaiian hoary bat or protected seabird species. The following mitigation measures will be implemented to minimize potential impacts to biological resources:

- 1) Construction activities will be limited to daylight hours to avoid the use of construction work lights which may attract and disorient migrating seabirds. All exterior lighting associated with the project will be shielded (per Section 25-6.3(a), ROH). These mitigation measures will be implemented to avoid potential impacts to migrating seabirds.
- 2) To protect Hawaiian hoary bats or birds that may use the trees on the Property for roosting, (a) avoid trimming or removal of trees taller than 15 feet between June 1 and September 15 (Hawaiian hoary bat's pupping season), when juvenile Hawaiian hoary bat that are not yet capable of flying may be roosting in the trees, and (b) restrict working at night under bright lights to avoid attracting insects that bats and birds feed on.
- 3) In order to reduce the presence of bird predators at the Property, feral cats will be removed from the Property, bait stations for rodents and mongoose will be installed, and covered trash receptacles should be used.
- 4) To reduce the possibility of spreading invasive species, pathogens, or pests, all equipment, materials, and personnel should be cleaned of excess soil and debris and the movement of plant or soil material between worksites should be avoided.

With these mitigation measures in place, the construction of the proposed WWTP is expected to result in no significant adverse impacts to existing plant species or native wildlife species or their habitat.

During operation of the proposed WWTP, the treated wastewater effluent will be discharged to the onsite injection wells disposal system. Of the three injection wells, the one nearest the ocean is located approximately 350 feet from the shoreline. Due to the distance from the shoreline, it is improbable that groundwater mixes with seawater at the Property location. However, the wastewater treatment process is anticipated to significantly reduce nitrogen and phosphorus levels in the effluent. Due to the oxygen supplied for the biological process within the treatment system, complete nitrification is anticipated based on the system design. With proper operation of the treatment system, no significant impact to marine wildlife species is anticipated.

4.4 POTENTIAL AIR QUALITY IMPACTS

Air pollution is caused by many different man-made and natural sources. To determine if emissions generated at the Property would adversely affect air quality conditions, potential air quality impacts were evaluated in accordance with National and State air quality standards.

4.4.1 Existing Air Quality Conditions

The DOH Clean Air Branch has established the State Ambient Air Quality Standards [SAAQS]. The DOH Clean Air Branch regularly samples ambient air quality at monitoring stations throughout the State, and annually publishes this information. On Oahu, there are four monitoring stations. The closest station to the Property that measures multiple parameters is located in Kapolei in the Kapolei Business Park. This station measures sulfur dioxide, carbon monoxide, nitrogen dioxide, lead, ozone, and particulate matter.

Air quality in the State of Hawaii continues to be one of the best in the nation, and criteria pollutant levels remain well below SAAQS. According to the *Annual Summary 2020 Hawaii Air Quality Data*, air quality monitoring data compiled by the DOH indicates that the established air quality standards for all monitored parameters are consistently met throughout the State and on the island of Oahu (DOH, 2021).

Present air quality in the vicinity of the Property is primarily affected by emissions from motor vehicles and residential and agricultural sources. Air quality data from the nearest monitoring stations suggest that all National and State air quality standards are currently being met, although occasional exceedances of the more stringent State standards for carbon monoxide may occur near congested roadway intersections.

4.4.2 Potential Air Quality Impacts and Mitigation

Impacts on air quality are anticipated to be less than significant and short-term. Installation of the proposed WWTP may require machinery that generates dust, and emissions from construction equipment and vehicles may impact air quality in the immediate area. The prevailing northeasterly trade winds are expected to disperse emissions and prevent elevated concentrations.

The short-term effects on air quality during construction will be mitigated by compliance with the DOH rules on air pollution. Fugitive dust emission will be controlled by implementing BMPs, such as watering active work areas, keeping adjacent paved roads clean, covering open-bodied trucks, and limiting the area to be disturbed at any given time.

Long-term O&M of the WWTP is not expected to have any adverse impacts on air quality. The pumps and blowers associated with the WWTP are electric-powered and will not discharge air pollutants. There isn't a strong quantitative way to measure odors from any activated sludge plant. The process will be strictly aerobic, covered, and contain no zones where denitrification should occur. The likelihood of anything going septic and producing foul odors is very low as long as the plant is operated properly. Any well operated wastewater plant will have a faint lingering earthy scent, which would reasonably be expected for the proposed WWTP, but the proposed treatment system should not produce any strong odors.

4.5 POTENTIAL NOISE IMPACTS

Noise pollution can result from construction activities and heavy equipment operation. To determine if noise generated at the Property would adversely affect noise quality in the area, potential noise impacts were evaluated in accordance with State noise control standards of HAR Chapter §11-46 (DOH, 1996).

The maximum permissible sound level for areas zoned as residential is 55 A-weighted decibels [dBA] during the daytime (7 am to 10 pm) and 45 dBA during the nighttime (10 pm to 7 am) (DOH, 1996). The maximum permissible sound level can be exceeded for short periods but not for more than ten percent of the time within any twenty-minute period. The maximum permissible sound level for impulsive noise is 10 dBA above the maximum permissible sound level. Backup alarm devices on vehicles are exempt

from the maximum permissible sound levels, where such devices are required by the Occupational Safety and Health Administration (DOH, 1996).

4.5.1 Existing Noise Conditions

Currently, noise levels in the vicinity of the Property are low, as land uses in the area are primarily residential. Sources of ambient noise are vehicular traffic, ocean waves, and periodic activity of the Ono Vista Condominiums occupants.

4.5.2 Potential Noise Impacts and Mitigation

There will be less than significant short-term intermittent noise impacts generated during construction of the WWTP. However, noise levels are not expected to adversely affect residents at or near the project site. All work is anticipated to be done during the daytime hours, between 7:00 am and 6:00 pm. Construction activities must comply with the provisions of HAR Chapter §11-46, "Community Noise Control" (DOH, 1996). The contractor will be required to obtain a noise permit if the noise levels from construction activities are expected to exceed 55 dBA.

Blowers and pumps will be utilized during long-term operation of the WWTP and may generate low levels of noise. However, the noise from this system is not anticipated to exceed the maximum permissible sound levels. The noise generating equipment (i.e., emergency generator, blowers, and pumps) will be housed inside the existing Pool House. Therefore, there would be less than significant long-term noise impacts from the proposed project.

Operation of the emergency generator is exempt from the rules of HAR Chapter §11-46.

4.6 CLIMATOLOGICAL CONDITIONS AND IMPACTS

4.6.1 Existing Climatological Conditions

Climatological conditions in the area of the Property consist of warm to moderate temperatures and moderate rainfall. The Property is on the North Shore of Oahu, which has prevailing northeasterly trade winds. The average annual precipitation in the area is approximately 31 inches, occurring mainly between November and April (Giambelluca et al., 2013). The evapotranspiration rate is approximately 37 inches (Giambelluca et al., 2014a). Average temperatures range from the low to high 70s (degrees Fahrenheit) (Giambelluca et al., 2014b).

4.6.2 Potential Impacts Related to Climate Change

The potential impacts of climate change on Hawaii's infrastructure and natural environment have become a significant concern. As a reflection of this concern, the December 2017 update to the Oahu General Plan (City and County of Honolulu, 2017) included new policies that emphasize the need to recognize and prepare for long-term impacts of climate change. The General Plan now also contains an objective on climate change and sea level rise. It calls for all public and private organizations to prepare for the future problems caused by rises in sea level, rises in groundwater levels, and more

frequent and severe storms, shifts in local rainfall patterns, and higher urban temperatures. The Climate Change Adaptation Policy Guidelines of the Hawaii State Planning Act, HRS §226-109, support planning and preparing for future disruptions and dislocations due to climate change.

Two principal concerns have been identified that pose a potential hazard to the Property. First, a significant sea level rise due to climate change could impact coastal structures, infrastructure, and properties. Second, changing weather patterns in the Pacific Ocean could result in localized increased precipitation severity and flooding. Although not directly related to climate change, tsunami and hurricane hazards and impacts are included below.

4.6.2.1 Sea Level Rise

Planning for sea level rise is challenging due to changing variables including some of which are unknown variables. In December 2013, the U.S. Army Corp of Engineers [USACE] issued Engineering Regulation 1100-2-8162 titled “*Incorporating Sea level Changes in Civil Works Programs*”, which provided the “guidance for incorporating the direct and indirect physical effects of projected future sea level change across the project life cycle in managing, planning, engineering, designing, constructing, operating, and maintaining USACE projects and systems of projects”. The guidance provided by the regulation can also be used in assessing the potential sea level rise which may be experienced at the Property.

Potential sea level rise at the Property has been predicted using the online Sea Level Change Calculator provided by USACE. The graph in Figure 9 shows the potential sea level rise from year 2000 to 2100 at the Honolulu mean sea level gauge (Station ID 1612340) located approximately 26 miles southeast from the Property. The graph shows the relative sea level rise which can be expected under differing prediction scenarios as determined by U.S. Department of Commerce National Ocean Service Center for Operational Oceanographic Products and Service (National Oceanic and Atmospheric Administration [NOAA] et. al., 2017). Included in the graph is the elevation of the proposed WWTP location.

According to USACE Sea Level Change Calculator, the proposed WWTP may be impacted by significant sea level rise by year 2060. The graph and table in Figure 9 illustrate that under the extreme climate change scenario, sea level rise could inundate the WWTP unless effective mitigative measures are implemented at the Property. A 4-foot sea level rise equal to the WWTP elevation may occur by year 2060; however, this is beyond the expected lifetime of the WWTP. The anticipated operational lifespan of the system/equipment is as follows: 1) Kubota Johkasou system (blowers, membrane cartridges, tank and media) has a typical life of 20 years; 2) emergency generator has a typical 20-year lifespan/warranty; 3) lift station tanks have a typical life of 40-50 years; and 4) pumps typically need to be replaced at 10-15 years.

Additionally, the *Hawaii Sea Level Rise Vulnerability and Adaptation Report* indicates that recent observations and predictions suggest that a 3.2-foot sea level rise could occur as early as year 2060 under more recently published highest-end scenarios (Hawaii Climate Change Mitigation and Adaptation Commission, 2017). According to the Hawaii Sea Level Rise Viewer, a 3.2-foot sea level rise would not impact the portion of the Property where the proposed WWTP will be located (Figure 10)

(Office of Planning, 2022). Similarly, according to the City and County of Honolulu, Climate Ready Oahu Web Explorer (City and County of Honolulu, 2022), a 3.2-foot sea level rise would only impact the surrounding area north and east of the Property.

4.6.2.2 Flooding, Tsunami, and Hurricane Hazards

According to the State GIS flood hazard zones map, the Property is located in flood hazard area Zone VE (Figure 11), which is defined as a coastal area subject to inundation by the 1% annual chance flood event in any given year which exceeds the defined base flood elevation [BFE], with increased risk due to storm waves (Office of Planning, 2022). The WWTP will be located in Zone VE with a BFE of 12 feet amsl.

Tsunamis and inundations of the low-lying coastal areas are natural phenomena that occur infrequently in Hawaii. The location of the Islands in the Pacific Ocean exposes them to waves generated from geologic activity of the Pacific Ring of Fire. The Property is located in the County's Tsunami inundation evacuation zone.

According to sea level rise predictions, there is potential for a 3.2-foot sea level rise by 2060 and a 6.9-foot sea level rise by 2080 at the Property. The increase in sea level elevation and the potential for increase in monsoonal weather patterns brought by climate change will increase the chance of inundation by floodwaters at the Property.

According to the NOAA National Storm Surge Hazards Map (NOAA, 2022), the Property is not within an area of inundation due to storm surges associated with hurricanes (Figure 12).

4.6.2.3 Flood, Tsunami, and Sea Level Rise Impacts and Mitigation

The WWTP will be designed to withstand tsunami inundations as well as floods from inland. The WWTP will be designed, located, and constructed to minimize or eliminate flood damage, impairment, and/or contamination during and subsequent to flooding by the regulatory flood. The aboveground tanks housing the treatment system below the BFE will be constructed of FRP and will be watertight with walls impermeable to the passage of water. In addition, structural components will have the capability of resisting hydrostatic and hydrodynamic loads and effects of buoyancy due to the regulatory flood. The pumps and blower panels will be protected from potential flooding by having them installed in a weatherproof housing. By incorporating these project design features there would be less than significant impacts from flooding and tsunamis. The proposed WWTP improvements would result in beneficial impacts compared to existing conditions since the WWTP components would be more resilient to flood waters from land and sea.

Currently, the impacts of minor flooding events are minimal; however, the impacts of a major tsunami at the Property could be significant. The chance of impacts will increase with the increase in sea level rise and climate change. The combination of sea level rise compounded by increased precipitation associated with climate change will increase the chances of major flooding events at the Property. Major flooding could cause an overflow of the effluent disposal system (i.e., injection wells), which would result in a potential spill of treated wastewater to the Ono Vista Condominiums parking lot and Au Street. To

reduce the threat of flooding to the injection wells, the following mitigation measures can be implemented as necessitated:

- 1) The effluent can be pumped directly to a temporary holding tank or removed using a pumping service.
- 2) Temporary or permanent flood barriers can be added around the wells.

By the year 2060, if the WWTP is still in operation, measures will be taken to protect the WWTP from rising sea water, or the WWTP will be decommissioned. Conditions of the UIC permit require annual inspection, testing, and monitoring of the injection wells to evaluate their performance and prevent injection well failures. These observations will be used to determine if sea level rise is compromising the performance of the injection well system.

If sea level rise impacts the performance of the treatment system components or the injection well system, all applicable regulations in place at the time will be followed. If it is determined that the WWTP should be decommissioned, it will be decommissioned in accordance with DOH Wastewater Branch regulations.

4.7 POTENTIAL ENVIRONMENTAL IMPACTS

A site assessment has not been conducted for the presence of hazardous materials at the Property. However, no hazardous materials were observed in the parking lot area where the proposed WWTP will be constructed. The proposed project does not involve demolition of building components that may contain hazardous materials (e.g., asbestos-containing material).

An existing emergency backup generator is currently present on the Property and is planned to be used as part of the proposed project. Depending on the power requirements for the proposed WWTP, the existing generator will be replaced with a new generator if necessary. The emergency backup generator is an all-in-one design and contains a 210-gallon aboveground diesel fuel tank. Although unlikely, in case of an accidental spill of diesel fuel from the aboveground tank, absorbent pads or booms will be used to contain the spill and divert the spill away from nearby storm drains. Once the spill is contained, absorbent will be sprinkled over the spill and allowed to sit until the diesel is absorbed. Once the diesel is absorbed, the diesel/absorbent debris will be swept up and properly disposed.

SECTION 5 SOCIAL ENVIRONMENT AND POTENTIAL IMPACTS

5.1 LAND USE

5.1.1 Existing Land Use

The Property and surrounding land are zoned as *Urban*, under State Land Use designations (Figure 3a). The City and County of Honolulu DPP zoning designates the Property as *A-2 Medium Density Apartment* (Figure 3b) and the NSSCP designates the project area as *Low Density Apartment* land use (City and County of Honolulu, 2011).

The Property is occupied by Ono Vista Condominiums, two residential condominiums with an asphalt paved parking lot, and pool. The area surrounding the Property is occupied by residential properties (Figure 4). Agricultural land is located across Waialua Beach Road to the south (Figure 3b).

The general area surrounding the Property is developed with condominiums, single-family residences, and agricultural farms. Based on available planning documents, the Property and surrounding area will continue to be used for residential and agricultural purposes for the foreseeable future.

5.1.2 Potential Land Use Issues

The Property and surrounding areas are zoned for residential, agricultural, and preservation uses, and its current and future use are consistent with the types of land use at surrounding properties. The Property has not had a significant impact on existing land use in the area. The proposed project does not involve changes to the Property's principal operations/land use and therefore, is not expected to have any impact to land use.

The proposed project will be located within a fenced area in the middle of the Property and will not affect any of the Property's parking stalls. The aboveground WWTP and concrete slab will be located a minimum of 10 feet from the property boundary (Figure 5a), in accordance with the 10-foot yard space requirement as set in LUO Section 21-3.80-1.

5.2 SOCIAL AND ECONOMIC ISSUES

5.2.1 Existing Social and Economic Conditions

The project site is located in Waialua, Oahu in Census tract 99.06. In 2020, the Census tract had a residential population of approximately 1,921, which was approximately 0.13% of Oahu's total population. The Waialua population in this Census tract is similar in age to the overall age of the Oahu population as a whole. The racial mix of the area is comprised of mostly Caucasians. The median income in 2020 for the Waialua household was \$74,463 and 8.7% live below the poverty line. The areas near the Property consist primarily of condominium and single-family residences, and agricultural lands are present to the south across Waialua Beach Road. Waialua's small commercial area is located about 1 mile to the southeast.

5.2.2 Potential Social and Economic Impacts

The proposed project is anticipated to have no adverse impacts to socio-economic resources. The project will not result in an increase of dwelling units or the population of the Waiialua area. Construction of the WWTP will generate short-term economic benefits through expenditures for construction materials and employment of workers.

5.3 HISTORIC, ARCHAEOLOGICAL, AND CULTURAL RESOURCES

5.3.1 Existing Historic, Archaeological, and Cultural Resources

No known archaeological or historic sites are located on the proposed WWTP project site. According to the Hawaii Cultural Resource Information System [HICRIS] database (SHPD, 2022), there are no records of historical properties or archaeological assessments on or near the Property. Consultation with SHPD was initiated to determine if historic, archaeological, or cultural resources would be impacted by the proposed project. The HRS §6E Form and associated project documents were submitted to the SHPD on November 15, 2022, to formally begin their review process. The purpose of this review is to both identify historic resources and to avoid or mitigate potential negative affects to them. Upon receipt of the HRS §6E Form, the SHPD responded that they cannot initiate review of the proposed project until they receive a copy of the SMA permit application. The SHPD will be consulted during the SMA permitting process.

A review of the ERP EA and EIS Library was performed to search for reports that contain information for historical, archaeological, or cultural resources in the vicinity of the Property. According to a Final EIS prepared for the Waiialua-Haleiwa Wastewater Facilities Plan (Belt Collins & Associates, 1987), most of the readily accessible land within the Waiialua District has been modified in the course of the urban and agricultural development that has taken place there over the past 150 years. These changes have resulted in the destruction of many of the physical remains of previous aboriginal Hawaiian settlements.

5.3.2 Potential Impacts to Historic, Archaeological, and Cultural Resources

The proposed project is not expected to result in adverse impacts to historical, archaeological, or cultural resources since the project is being constructed within the footprint of the existing wastewater treatment system (Figure 5a). The new WWTP system components will all be constructed aboveground, and the existing wet well/lift station and effluent disposal system (i.e., injection wells) are already in an area that has had extensive ground disturbance. The excavation activities to install concrete slabs are not anticipated to disturb any archaeological or cultural features. The existing wastewater treatment system will be demolished and removed, but this is an area that was previously disturbed when the system was installed.

If any archaeological or cultural resources, or burials, are inadvertently discovered during excavation, all construction work will cease immediately and subsequent work shall proceed only upon an archaeological clearance from the SHPD.

5.4 VISUAL AND AESTHETIC APPEAL

5.4.1 Existing Visual and Aesthetic Appeal

Ono Vista Condominiums is located within a residential area surrounded by other houses and condominiums. The existing wastewater treatment system is located in the center of the Property between the two main parking lots, and is surrounded by a 6-foot-high wooden fence. The existing system is primarily visible only to Ono Vista residents. Various palm trees and ornamentals are planted along the eastern side of the fenced-in area, and a *Jatropha* tree and papaya trees are planted along the western side of the fenced-in area (see Appendix A: Photographs 5, 6, and 7). In the immediate area of the proposed WWTP there is not a scenic vista or an open view to the ocean due to the presence of the existing fence and surrounding buildings.

5.4.2 Potential Impacts to the Visual and Aesthetic Appeal

Most of the components of the existing wastewater treatment system are belowground, except for the emergency generator inside the machine room adjacent to the Pool House, and the system control panel and aeration blowers, which are located inside the Pool House. The existing underground treatment tank is 60 feet long by 8 feet in diameter. The underground tank will be removed and replaced by four aboveground treatment tanks, which will be installed on four individual concrete pads. Other aboveground components of the new WWTP include the generator, blowers, and control panels, which will be contained in the back room of the existing Pool House. The dimensions of the treatment tanks are provided in Section 2. The machine room adjacent to the Pool House is planned to be demolished.

The four aboveground treatment tanks of the proposed WWTP are designed to have a height of approximately 11 feet above the level of the parking lot (concrete slab on grade plus tank height), as shown in Figure 5c. The current height limitation for areas zoned as *A-2 Medium Density Apartment*, which includes the Property, is 40 feet (City and County of Honolulu, 2021a). The proposed WWTP is well within the A-2 zone height limitation.

The entire WWTP will be enclosed by a 6-foot-high wooden fence to screen the WWTP from public view. Because the new treatment tanks will be aboveground, there is no available room for existing trees to remain. The limited available landscaping areas will be grass or gravel. Gravel provides a low maintenance option. The visual and aesthetic appeal of the rural area will be maintained by locating the WWTP within the existing footprint and retaining and reinstalling the existing 6-foot-high wooden fence. Therefore, the proposed project improvements will not result in significant impacts to visual and aesthetic resources.

5.5 RECREATIONAL ACTIVITIES AND AREAS

5.5.1 Existing Recreational Activities and Areas

Dole's private beach park is located approximately 150 feet east of the Property but is not visible from the Property due to other adjacent buildings. A public beach access is located further to the east,

approximately 0.4 miles from the Property. Aweoweo Beach Park is located approximately 700 feet west-northwest of the Property.

5.5.2 Potential Impacts to Recreational Activities and Areas

Because of the presence of surrounding buildings and the distance to public/private beaches and parks, the proposed project will have no adverse impact on current recreational activities during the construction period, or during the long-term operation of the WWTP.

SECTION 6 INFRASTRUCTURE AND POTENTIAL IMPACTS

The Property has the potential to impact the following two public services: (1) transportation and (2) utilities. Owing to the location of the Property and the nature of its operations, it is not expected that other public services will be affected.

6.1 TRAFFIC AND ROADS

6.1.1 Existing Transportation Infrastructure

Waiialua Beach Road is the main roadway serving the shoreline area of Waiialua. Primary vehicle access to the Property is from Waiialua Beach Road, Apuhihi Street, and Au Street. There are two driveways, one at the southwestern side of the Property from Apuhihi Street and one at the southeastern side of the Property from Au Street. The proposed WWTP is located in the central portion of the Property and would be accessed by the southeastern driveway (Figures 5a and 5b).

Bus service is provided to the Property by Route 521, which runs along Waiialua Beach Road and Apuhihi Street. Generally, smooth traffic flow is characteristic along these routes. Traffic is typically busiest during weekday commuter periods and weekend afternoons.

6.1.2 Potential Impacts to Traffic and Roads and Mitigation

All construction activities associated with the proposed WWTP will take place within the Property boundaries. No work will be performed within the State Right-of-Way. Construction activities will not alter public roadways or affect bus service or bike/pedestrian access to the State Right-of-Way. There will be no modifications to site access/egress on Apuhihi Street or Au Street. While the project is not expected to have significant traffic impacts, traffic on and adjacent to the Property may be impacted on a short-term basis during transportation of construction equipment and supplies to the project site. Construction vehicles will add to the traffic on the roadways during these short periods. The following mitigation measures are recommended for optimal traffic conditions during construction:

- Construction activities and construction materials should be located and stored away from vehicular traffic. Sight lines for drivers on the roadway should be carefully maintained.
- Trucks delivering construction materials should be scheduled on weekdays during times of non-peak commuter periods (8:30 AM to 3:30 PM).

With these mitigation measures in place, the project would result in less than significant impacts to traffic and roads.

6.2 UTILITIES

6.2.1 Existing Utilities in the Area

6.2.1.1 *Electrical Supply*

Electrical power is provided to the Property by HECO overhead service lines along Apuhihi Street and a HECO-owned transformer located on the northeastern side of the parking lot within the Property. The electrical components of the proposed WWTP will be connected to the onsite 208 volts 3-phase electrical lines, through a branch circuit from the Ono Vista building circuit. In the event of a commercial power outage, the existing (or new) emergency generator will be linked to an automatic transfer switch so that essential loads will automatically transfer to emergency power.

6.2.1.2 *Water Supply*

Potable water is provided to the Property by the Honolulu Board of Water Supply water line on Apuhihi Street. Daily water usage consists of domestic uses for the condominium residents and landscape irrigation. Fire suppression water supply is also provided on the Property.

6.2.2 Potential Impacts to Utilities in the Area

The proposed project is not anticipated to require any offsite improvements. Utility service, such as potable water and electricity, to the surrounding area will not be affected. However, onsite utilities may be affected during construction activities. Additional electricity needed for operation of the proposed WWTP will be supplied by the onsite transformer. Therefore, there would be short-term, less than significant impacts to utilities from the proposed project.

SECTION 7 DETERMINATION

Based on the analysis of information in this EA, it has been determined that the proposed Ono Vista Condominiums WWTP project will not have significant negative impacts to the natural, built, or social environment. Therefore, a FONSI will be issued and an EIS will not be required.

7.1 FINDINGS AND REASONS SUPPORTING THE DETERMINATION

The potential effects of the proposed project were evaluated based on the thirteen *significance criteria* identified in HAR Title 11, Chapter 200.1-13. All phases and expected consequences of the proposed project have been evaluated, including potential primary, secondary, short-term, long-term, and cumulative impacts. Table 7.1 summarizes the significance criteria and the evaluation of the potential effects of the project.

It is concluded that the proposed project does not meet any of the thirteen criteria. By not meeting these criteria, it is appropriate that the proposed project be issued a FONSI and that an EIS not be required.

Table 7.1
Evaluation of Significance Criteria
Ono Vista Condominiums
Final Environmental Assessment

No.	Significance Criterion	Yes	No	Reason for Determination
1	Irrevocably commits a natural, cultural, or historic resource?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not expected to irrevocably commit any natural, cultural, or historic resource. The proposed WWTP will be installed in an area that has been previously disturbed by residential development and is the location of the existing wastewater treatment system. There are no known significant cultural or historic resources in the project area and recommendations by the SHPD will be followed to protect cultural or historic resources.
2	Curtails the range of beneficial uses of the environment?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project will not permanently curtail the beneficial uses of the environment. The proposed WWTP conforms to the land use designation for the Property and will be located within the existing property boundary of the Ono Vista Condominiums.
3	Conflicts with the State's environmental policies or long-term environmental goals established by law?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project will be in conformance with the State's environmental policies and goals established by law. The proposed WWTP will provide better treatment of Ono Vista's wastewater and will accommodate present day flows. This is anticipated to reduce the risk of future wastewater spills.
4	Has a substantial adverse effect on the economic welfare, social welfare, or cultural practices of the community and State?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not anticipated to have any adverse effects on the economic and social welfare or cultural practices of the community or State. Rather, it will benefit the residents of Ono Vista by providing an improved wastewater treatment system.
5	Has a substantial adverse effect on public health?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not anticipated to have any adverse effects on public health. Rather, it will have a positive impact on public health by improving treatment of wastewater and reducing the risk of future wastewater spills.
6	Involves adverse secondary impacts, such as population changes or effects on public facilities?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not anticipated to result in adverse secondary impacts. The project is designed only to accommodate present day wastewater flows at the Ono Vista Condominiums, and to reduce the risk of future wastewater spills.
7	Involves a substantial degradation of environmental quality?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not anticipated to degrade environmental quality; it is anticipated to protect environmental quality by providing upgraded wastewater treatment. The project is intended to replace the existing wastewater treatment system to accommodate present day flows in order to reduce the risk of future wastewater spills.

No.	Significance Criterion	Yes	No	Reason for Determination
8	Is individually limited but cumulatively has substantial adverse effect upon the environment or involves a commitment for larger actions?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not anticipated to result in a significant cumulative negative impact on the environment. The project site has already been developed and any adverse impacts related to the proposed project will be limited within the property boundary. Due to the rural nature of the general area, other significant development projects are not anticipated. Therefore, the incremental effects of the proposed project combined with the effects of other past, present, and reasonably foreseeable future actions will not be cumulatively substantial. The project does not involve a commitment for larger actions. In fact, it will replace Ono Vista's existing wastewater treatment system, which will help reduce the need for additional actions.
9	Has a substantial adverse effect on a rare, threatened, or endangered species, or its habitat?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not anticipated to adversely affect any rare, threatened, or endangered species or habitat. There are no known significant biological resources or habitats in the project area.
10	Has a substantial adverse effect on air or water quality or ambient noise levels?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is not anticipated to adversely affect long-term air quality, water quality, or ambient noise levels. The project may temporarily affect air, water, or noise quality during construction, but BMPs will be implemented to minimize any impacts.
11	Has a substantial adverse effect on or is likely to suffer damage by being located in an environmentally sensitive area such as a flood plain, tsunami zone, sea level rise exposure area, beach, erosion-prone area, geologically hazardous land, estuary, fresh water, or coastal waters?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project is located within the SMA and appropriate permits will be obtained for the SMA. The proposed WWTP is located within the 100-year flood hazard area and in the County's Tsunami inundation evacuation zone. The WWTP will be designed, located, and constructed to minimize or eliminate flood damage, impairment, and/or contamination during and subsequent to flooding by the regulatory flood. In addition, structural components will have the capability of resisting hydrostatic and hydrodynamic loads and effects of buoyancy due to the regulatory flood or a tsunami. BMPs will be used during construction to minimize any impacts on coastal waters. The project is not located within the sea level rise exposure area.
12	Has a substantial adverse effect on scenic vistas and view planes, during day or night, identified in county or State plans or studies?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	In the immediate area of the proposed WWTP there is not a scenic vista or an open view to the ocean due to the presence of the existing fence and surrounding buildings. The aboveground tanks of the proposed WWTP will occupy an area approximately 30 feet wide by 50 feet long, with a height of approximately 11 feet above the level of the parking lot. A fence will be used around the WWTP to maintain the visual and aesthetic appeal of the rural area. The proposed WWTP will not interfere with scenic vistas or view planes.

No.	Significance Criterion	Yes	No	Reason for Determination
13	Requires substantial energy consumption or emits substantial greenhouse gases?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	The project will not require substantial energy consumption. A slight increase in energy use will result from the proposed WWTP and will be accommodated by the existing HECO power supply on the Property. The project will not emit substantial greenhouse gases.

SECTION 8 REFERENCES

Belt Collins & Associates, 1987, Final Environmental Impact Statement Waialua-Haleiwa Wastewater Facilities Plan, prepared for Division of Wastewater management, Department of Public Works, City and County of Honolulu, May 1987.

Brown and Caldwell, 2012, North Shore Regional Wastewater Alternatives Plan, prepared for City and County of Honolulu, February 29, 2012.

City and County of Honolulu, 2011, North Shore Sustainable Communities Plan, Department of Planning and Permitting, City and County of Honolulu, May 2011.

City and County of Honolulu, 2018a, Rules Relating to Water Quality, Title 20, Chapter 3, Department of Planning and Permitting, City and County of Honolulu, amended September 17, 2018.

City and County of Honolulu, 2018b, Sea Level Rise Guidance: City and County of Honolulu, Climate Change Commission, June 5, 2018.

City and County of Honolulu, 2018c, City and County of Honolulu Actions to Address Climate Change and Sea Level Rise: City and County of Honolulu Memorandum, Directive No. 18-2, July 16, 2018.

City and County of Honolulu, 2021a, The ROH Online, City and County of Honolulu, Office of Council Services, updated March 19, 2021.

City and County of Honolulu, 2021b, Oahu General Plan, Department of Planning and Permitting, City and County of Honolulu, November 2021.

City and County of Honolulu, 2022 Climate Ready Oahu Web Explorer. Viewer: <http://cchnl.maps.arcgis.com/apps/View/index.html?appid=6694193a396f40fb87f78e98fbad7d73>
(Accessed November 21, 2022)

CFR, 2020, Title 40 - Protection of the Environment, Chapter I – Environmental Protection Agency, Subchapter D – Water Programs, Part 122 – EPA Administered Permit Programs: the National Pollutant Discharge Elimination System, Electronic Code of Federal Regulations as of June 15, 2020.

DOH, 1974a, Environmental Impact Statements: State of Hawaii Department of Health, Hawaii Revised Statutes, Chapter 343 (revised August 31, 1996).

DOH, 1974b, State Environmental Policy: State of Hawaii Department of Health, Hawaii Revised Statutes, Chapter 344 (revised 1993).

DOH, 1992, Underground Injection Control: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 23, November 12, 1992.

DOH, 1996, Community Noise Control: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 46, September 23, 1996.

DOH, 2001, Ambient Air Quality Standards: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 59, September 5, 2001.

DOH, 2014a, Air Pollution Control: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 60.1, June 20, 2014.

DOH, 2014b, Water Quality Standards: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 54, November 15, 2014.

DOH, 2016, Wastewater Systems: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 62, March 21, 2016.

DOH, 2019a, Water Pollution Control: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 55, Amended February 9, 2019.

DOH, 2019b, Environmental Impact Statement Rules: State of Hawaii Department of Health, Hawaii Administrative Rules, Title 11, Chapter 200.1, August 9, 2019.

DOH, 2021, State of Hawaii Annual Summary 2020 Air Quality Data, State of Hawaii Department of Health, Clean Air Branch, December 2021.

Foote, D. E., Hill, E. L., Nakamura, S. and Stephens, F., 1972, U.S. Department of Agriculture. Soil Survey of the Islands of Kauai, Oahu, Maui, Molokai, and Lanai, State of Hawaii: Soil Conservation Service in Cooperation with the University of Hawaii Agricultural Experiment Station, August 1972.

Giambelluca et al., 2013, Giambelluca, T.W., Q. Chen, A.G. Frazier, J.P. Price, Y.-L. Chen, P.-S. Chu, J.K. Eischeid, and D.M. Delparte, 2013: Online Rainfall Atlas of Hawaii. Bull. Amer. Meteor. Soc. 94, 313-316, doi: 10.1175/BAMS-D-11-00228.1.

Giambelluca et al., 2014a, Giambelluca, T.W., X. Shuai, M.L. Barnes, R.J. Alliss, R.J. Longman, T. Miura, Q. Chen, A.G. Frazier, R.G. Mudd, L. Cuo, and A.D. Businger. 2014. Evapotranspiration of Hawaii. Final report submitted to the U.S. Army Corps of Engineers—Honolulu District, and the Commission on Water Resource Management, State of Hawaii.

Giambelluca et al., 2014b, Giambelluca, T.W., X. Shuai, M.L. Barnes, R.J. Alliss, R.J. Longman, T. Miura, Q. Chen, A.G. Frazier, R.G. Mudd, L. Cuo, and A.D. Businger. 2014. Evapotranspiration of Hawaii. Final report submitted to the U.S. Army Corps of Engineers—Honolulu District, and the Commission on Water Resource Management, State of Hawaii.

Hawaii Climate Change Mitigation and Adaptation Commission, 2017, Hawaii Sea Level Rise Vulnerability and Adaptation Report. Prepared by Tetra Tech, Inc. and the State of Hawaii Department

of Land and Natural Resources, Office of Conservation and Coastal Lands, under the State of Hawaii Department of Land and Natural Resources Contract No: 64064.

Mink, J. F. and Lau, L. S., 1990, Aquifer Identification and Classification for the Island of Oahu, Groundwater Protection Strategy for Hawaii: Water Resources Research Center Technical Report No. 179, February 1990.

National Oceanic and Atmospheric Administration et. al., 2017, Global and Regional Sea Level Rise Scenarios for the United States, NOAA Technical Report NOS CO-OPS 083, Silver Spring, Maryland, January 2017.

National Oceanic and Atmospheric Administration, 2022, NOAA National Weather Service, National Hurricane Center Storm Surge Unit, National Storm Surge Hazard Maps, Viewer: <http://noaa.maps.arcgis.com/apps/MapSeries>. Accessed October 2022.

OEQC, 2012, Guide to the Implementation and Practice of the Hawaii Environmental Policy Act: State of Hawaii Office of Environmental Quality Control, January 2012.

Office of Planning, 1977, Coastal Zone Management: State of Hawaii Office of Planning, Hawaii Revised Statutes, Chapter 205A, 1977 (revised January 2006).

Office of Planning, 1978, Hawaii State Planning Act: State of Hawaii Office of Planning, Hawaii Revised Statutes, Chapter 226, 1978 (revised 1986, 2011).

Office of Planning, 2022, State of Hawaii Office of Planning, Hawaii Statewide GIS Program website: <http://planning.hawaii.gov/gis/>. Accessed October 2022.

Sherrod, David R., Sinton, John M., Watkins, Sarah E., and Brunt, Kelly M., 2007, Geologic Map of the State of Hawaii, Sheet 3, Island of Oahu: U.S. Department of Interior, U.S. Geological Survey, Open File Report 2007-1089.

Sinton, John M., Eason, Deborah E. Eason, Tardona, Mary, Pyle, Douglas, van der Zander, Iris, Guillou, Herve, Clague, David A., and Mahoney, John J., 2014, Kaena Volcano – A Precursor Volcano of the Island of Oahu, Hawaii: Geological Society of America Bulletin, May 2, 2014.

State of Hawaii Clean Water Branch, 2022, History and Mission Statement, <https://health.hawaii.gov/cwb/clean-water-branch-home-page/about-cwb/history-and-mission-statement/>. Accessed September 20, 2022.

State of Hawaii State Historic Preservation Division, 2022, HICRIS Application, <https://shpd.hawaii.gov/hicris>. Accessed October 2022.

State of Hawaii Safe Drinking Water Branch, 2022, SDWB Home Page, <https://health.hawaii.gov/sdwb/>. Updated February 9, 2022.

University of Hawaii, 1972, Detailed land classification: Island of Oahu, Honolulu: Land Study Bureau, University of Hawaii, Jan. 1963 and Dec. 1972.

University of Hawaii, 2022, Hawaii Groundwater and Geothermal Resources Center, Hawaii State Water Wells, <https://www.higp.hawaii.edu/hggrc/projects/hawaii-state-waterwells/>. Accessed September 8, 2022.

USFWS, 2022a, IPaC - Information for Planning and Consultation. Accessed at: <https://ecos.fws.gov/ipac/>


USFWS, 2022b, United States Fish and Wildlife Service Critical Habitat Mapper. Accessed at: <https://fws.maps.arcgis.com>

USFWS, 2022c, United States Fish and Wildlife Service National Wetlands Inventory Mapper. Accessed at: <https://www.fws.gov/wetlands/data/mapper.html>

FIGURES



PACIFIC OCEAN

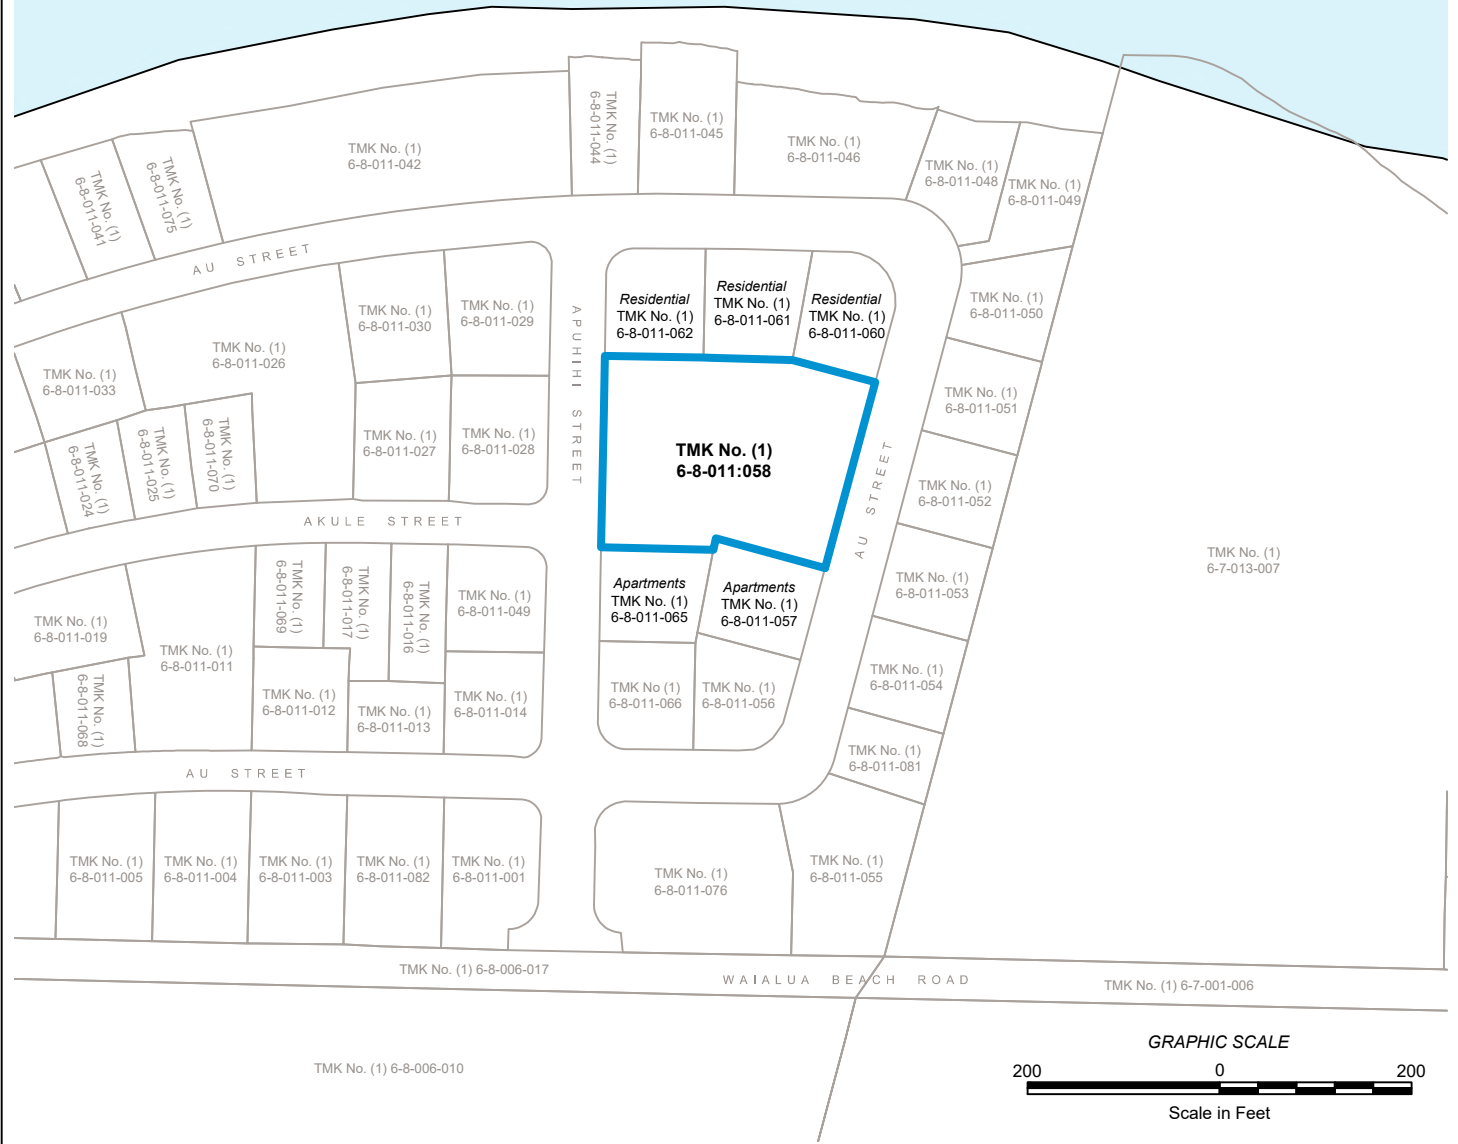

LEGEND

- ▬ ONO VISTA CONDOMINIUMS
TMK No. (1) 6-8-011:058
- TMK BOUNDARY

NOTES


The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

<http://planning.hawaii.gov/gis/>, 2022.


FIGURE 2
TAX MAP
[TMK No. (1) 6-8-11:058]

ENVIRONMENTAL ASSESSMENT
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street, Waialua, Hawaii
TMK No. (1) 6-8-011:058





LEGEND

 ONO VISTA CONDOMINIUMS
TMK NO. (1) 6-8-011:058

 NON-PERENNIAL STREAM

STATE LAND USE DISTRICT BOUNDARY CODE

 AGRICULTURAL

 URBAN

NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.


SOURCES

Aerial Map, 21°34'58.5"N 158°08'15.0"W, Imagery Date: April 21, 2021. Google Earth Pro, September 13, 2022.

<http://planning.hawaii.gov/gis/>, 2022.

FIGURE 3
STATE LAND USE MAP

ENVIRONMENTAL ASSESSMENT
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street, Waialua, Hawaii
TMK No. (1) 6-8-011:058

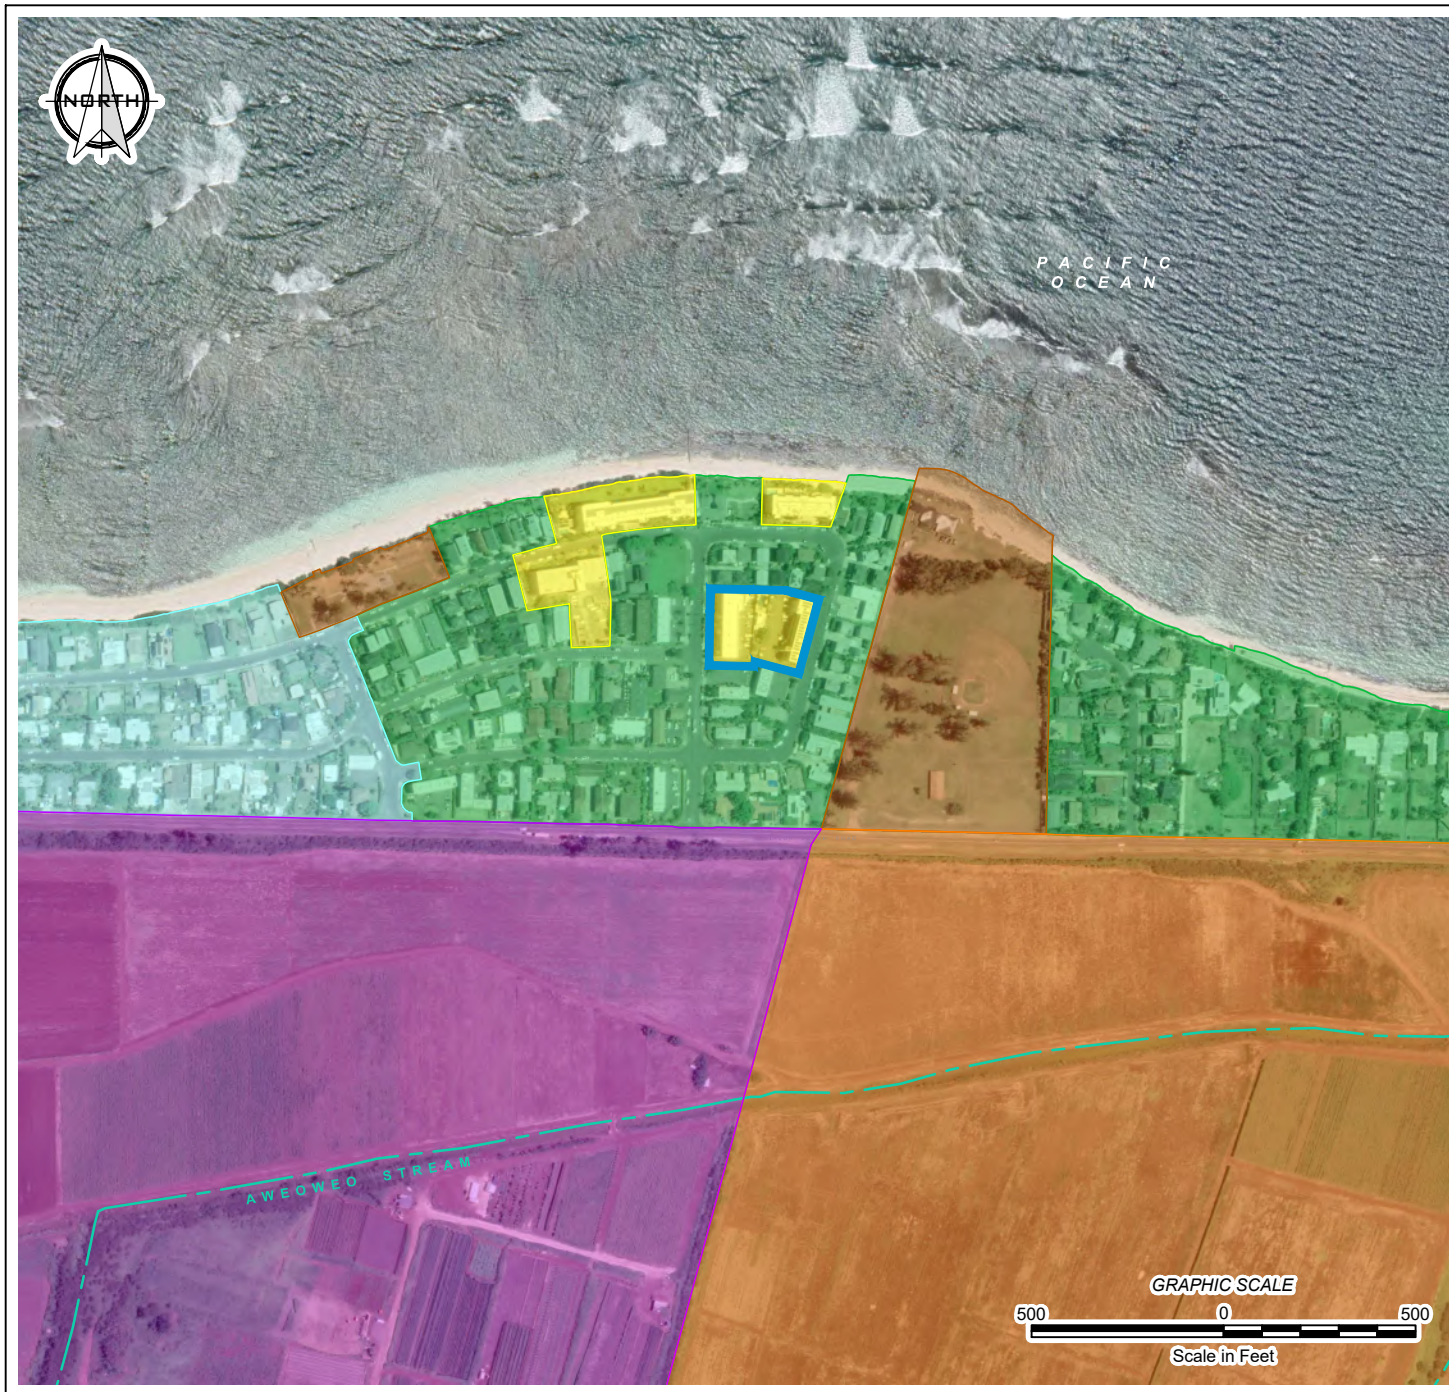

LEGEND

- ONO VISTA CONDOMINIUMS
TMK NO. (1) 6-8-011:058
- NON-PERENNIAL STREAM
- CITY & COUNTY OF HONOLULU
LAND USE ORDINANCE [LUO] ZONING CODE
- A-1, Low-density Apartment District
- A-2, Medium-density Apartment District
- AG-1, Restricted Agriculture District
- AG-2, General Agriculture District
- P-1, Restricted Preservation District
- P-2, General Preservation District
- R-5, Residential District
- R-7.5, Residential District

NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.


SOURCES

Aerial Map, 21°34'58.5"N 158°08'15.0"W, Imagery Date: April 21, 2021. Google Earth Pro, September 13, 2022.

<http://planning.hawaii.gov/gis/>, 2022.

FIGURE 3b
CITY & COUNTY OF HONOLULU
LUO ZONING MAP

ENVIRONMENTAL ASSESSMENT
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street, Waialua, Hawaii
TMK No. (1) 6-8-011:058

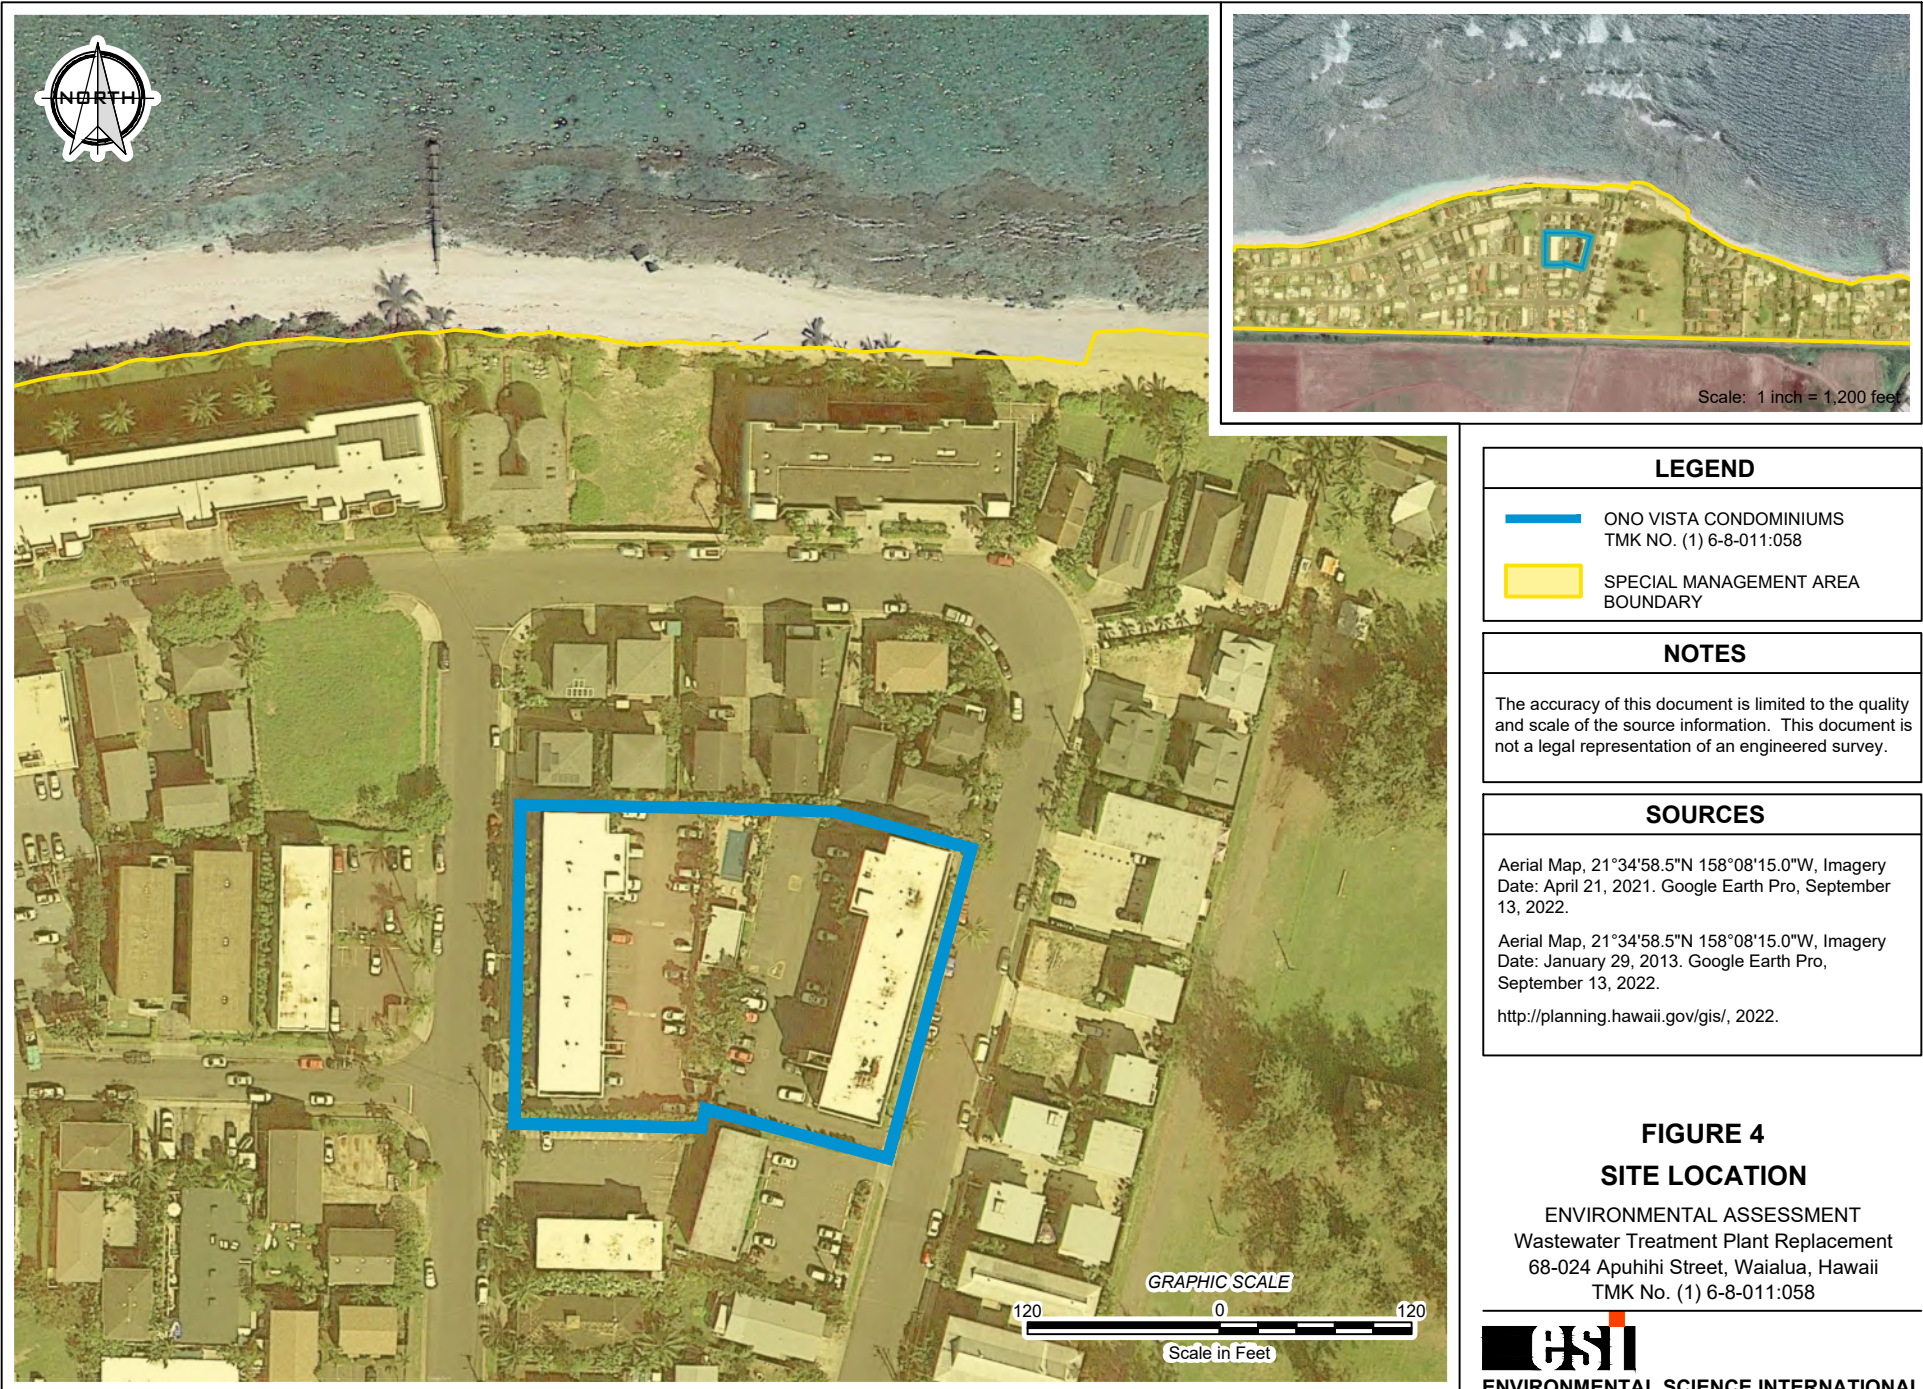



LEGEND	
	ONO VISTA CONDOMINIUMS BOUNDARY, TMK NO. (1) 6-8-011:058
	BUILDING/STRUCTURE
	CONCRETE
	CRM WALL
	AREA OF NEW WWTP SYSTEM

NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

Drawing - C-100, General Site Plan, Ono Vista Condominium WWTP Replacement, 68-242 Apuhihi Street, Waialua, Oahu, Hawaii 96791, TMK: (1) 6-8-011:058, Project Number 22023_22035, Date: March 16, 2023.

<http://planning.hawaii.gov/gis/>, 2022.


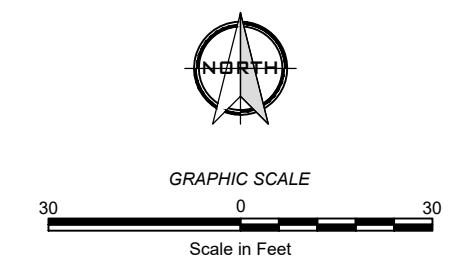


FIGURE 5a
SITE PLAN
 ENVIRONMENTAL ASSESSMENT
 Wastewater Treatment Plant Replacement
 68-024 Apuhihi Street, Waialua, Hawaii
 TMK No. (1) 6-8-011:058

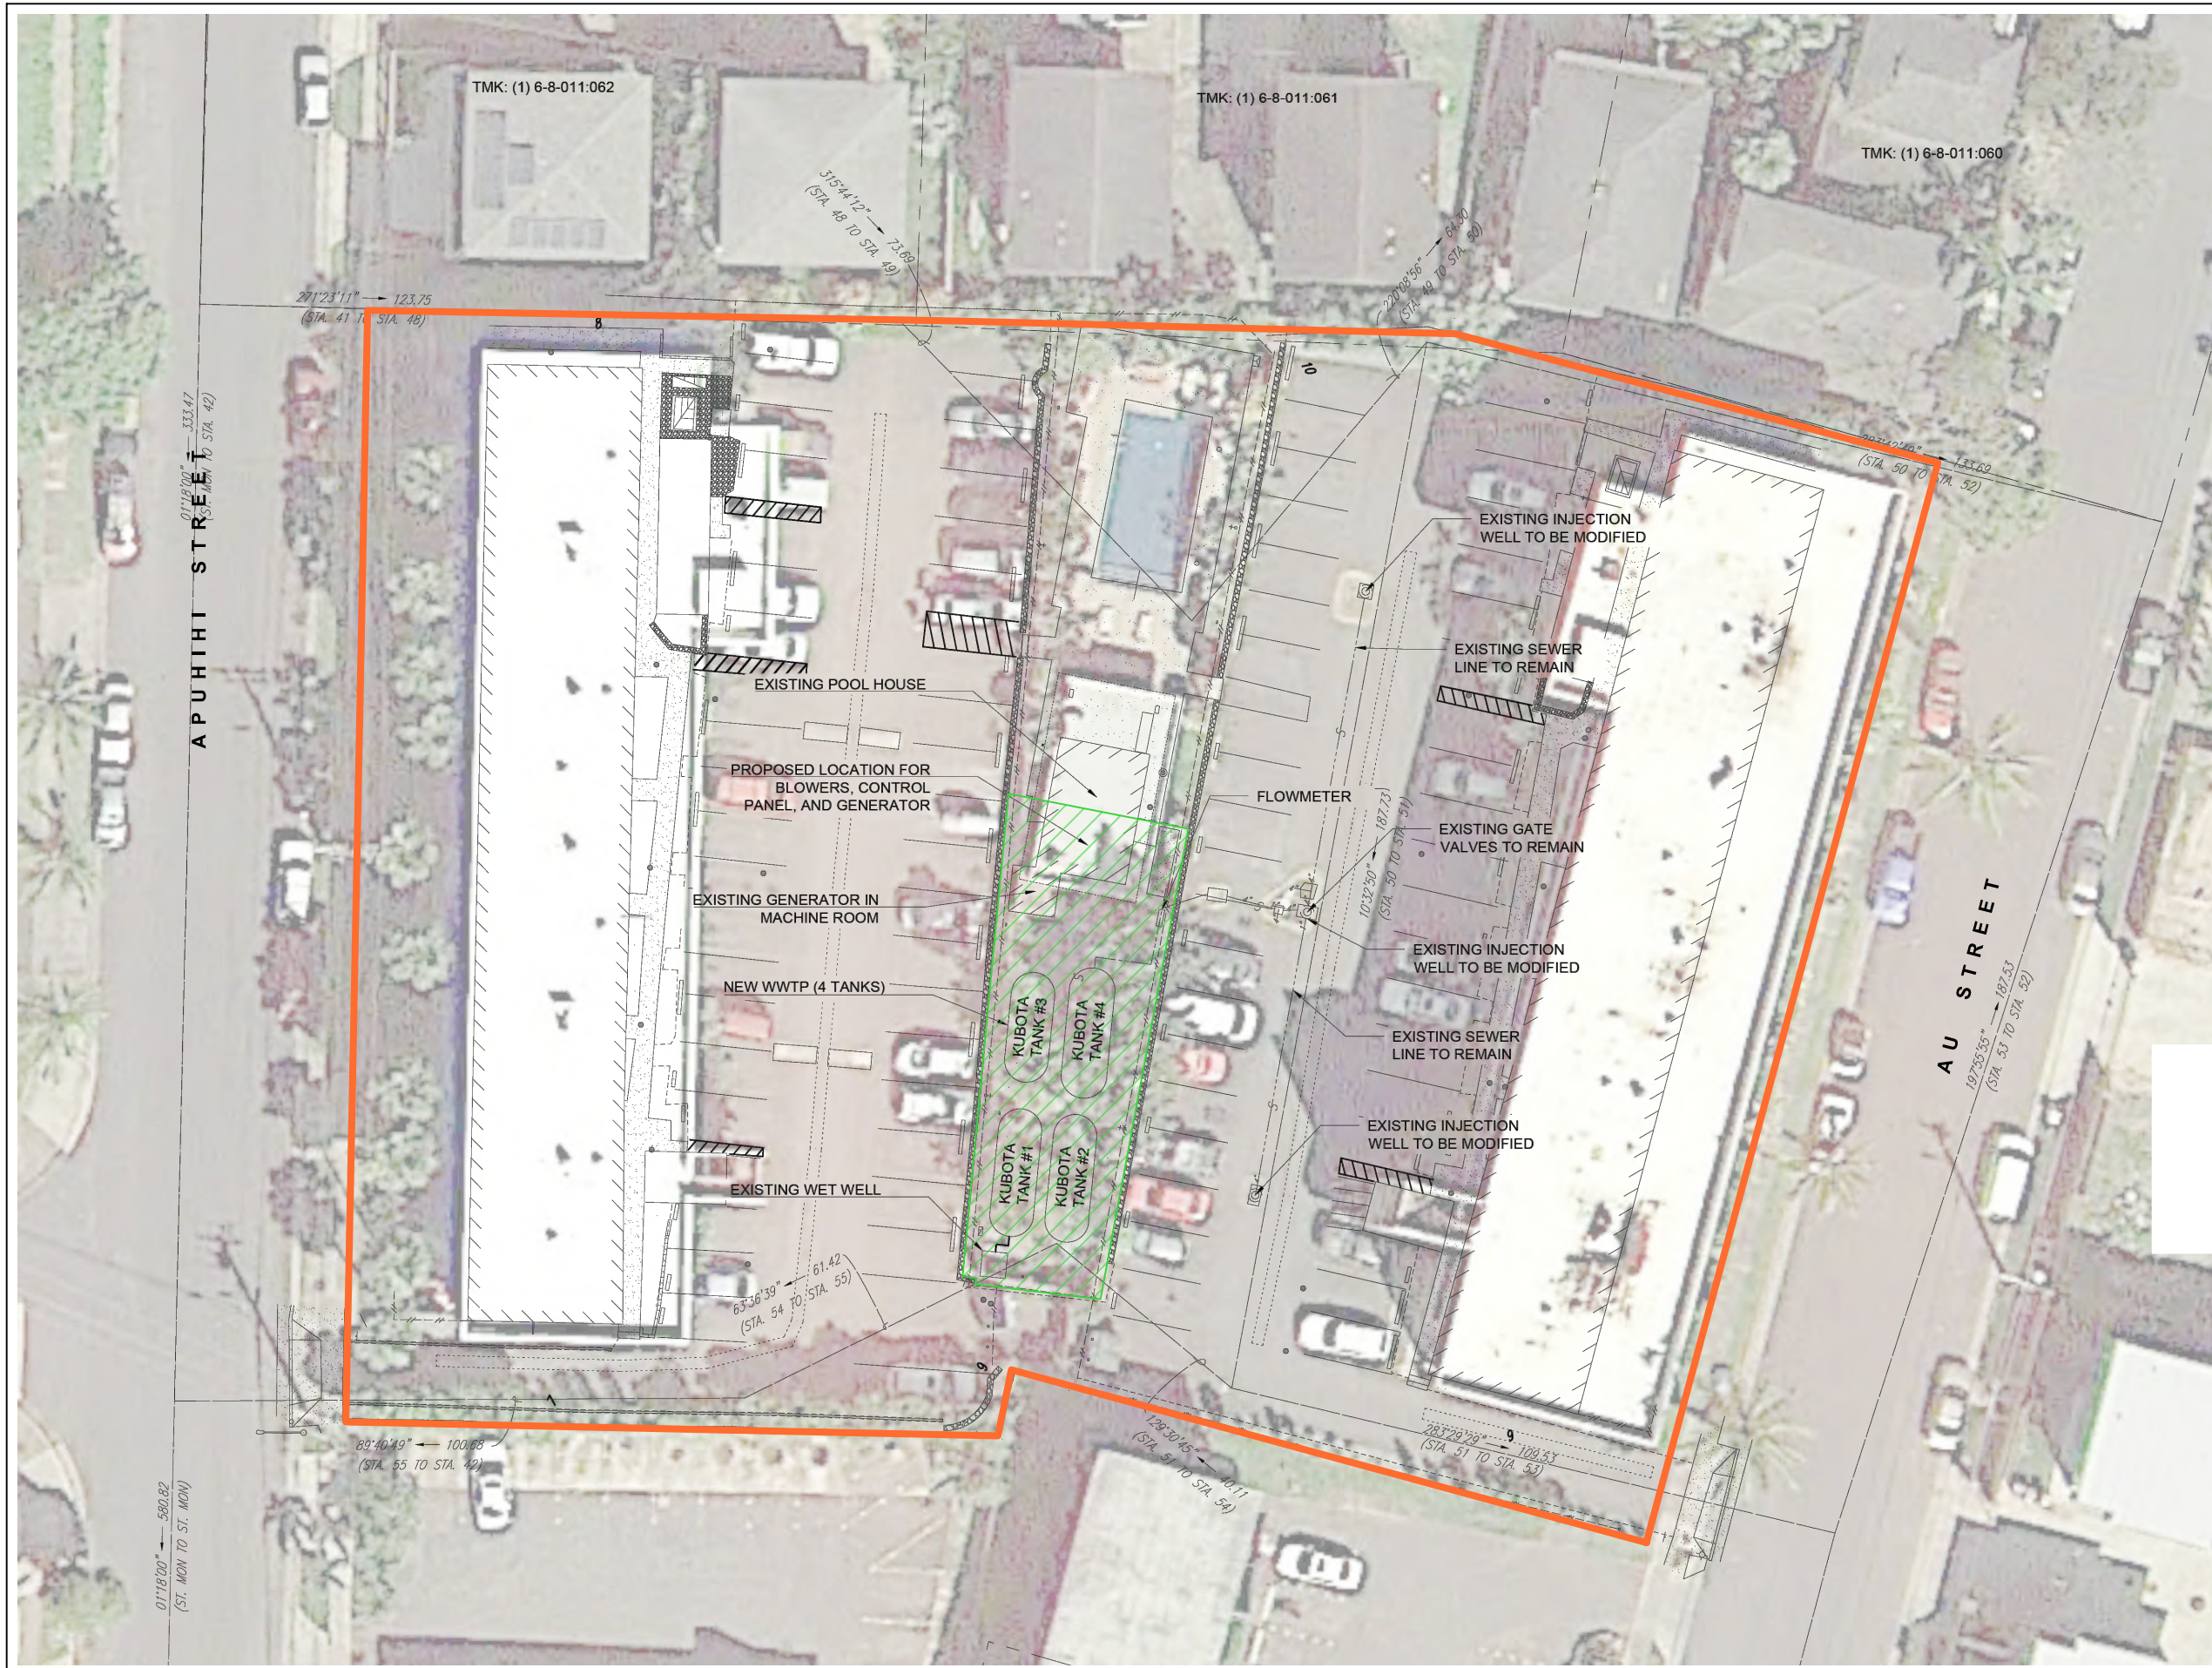

LEGEND	
	ONO VISTA CONDOMINIUMS BOUNDARY, TMK NO. (1) 6-8-011:058
	BUILDING
	CONCRETE
	CRM WALL
	AREA OF NEW WWTW SYSTEM

NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

Drawing - C-001 Ono Vista Condominium WWTW Replacement (Permanent), 68-90 Au Street, Waialua, Oahu, Hawaii 96791, TMK: (1) 6-8-001:058, Project Number 222023_22035, Date: October 10, 2022.

<http://planning.hawaii.gov/gis/>, 2022.





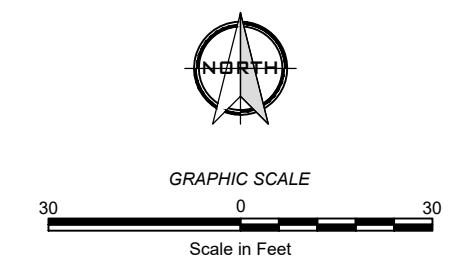


FIGURE 5b
SITE PLAN & AERIAL MAP
 ENVIRONMENTAL ASSESSMENT
 Wastewater Treatment Plant Replacement
 68-024 Apuhihi Street, Waialua, Hawaii
 TMK No. (1) 6-8-011:058

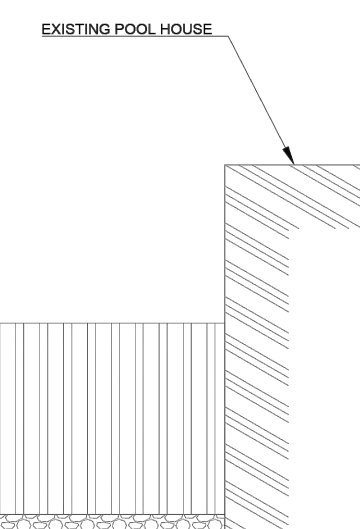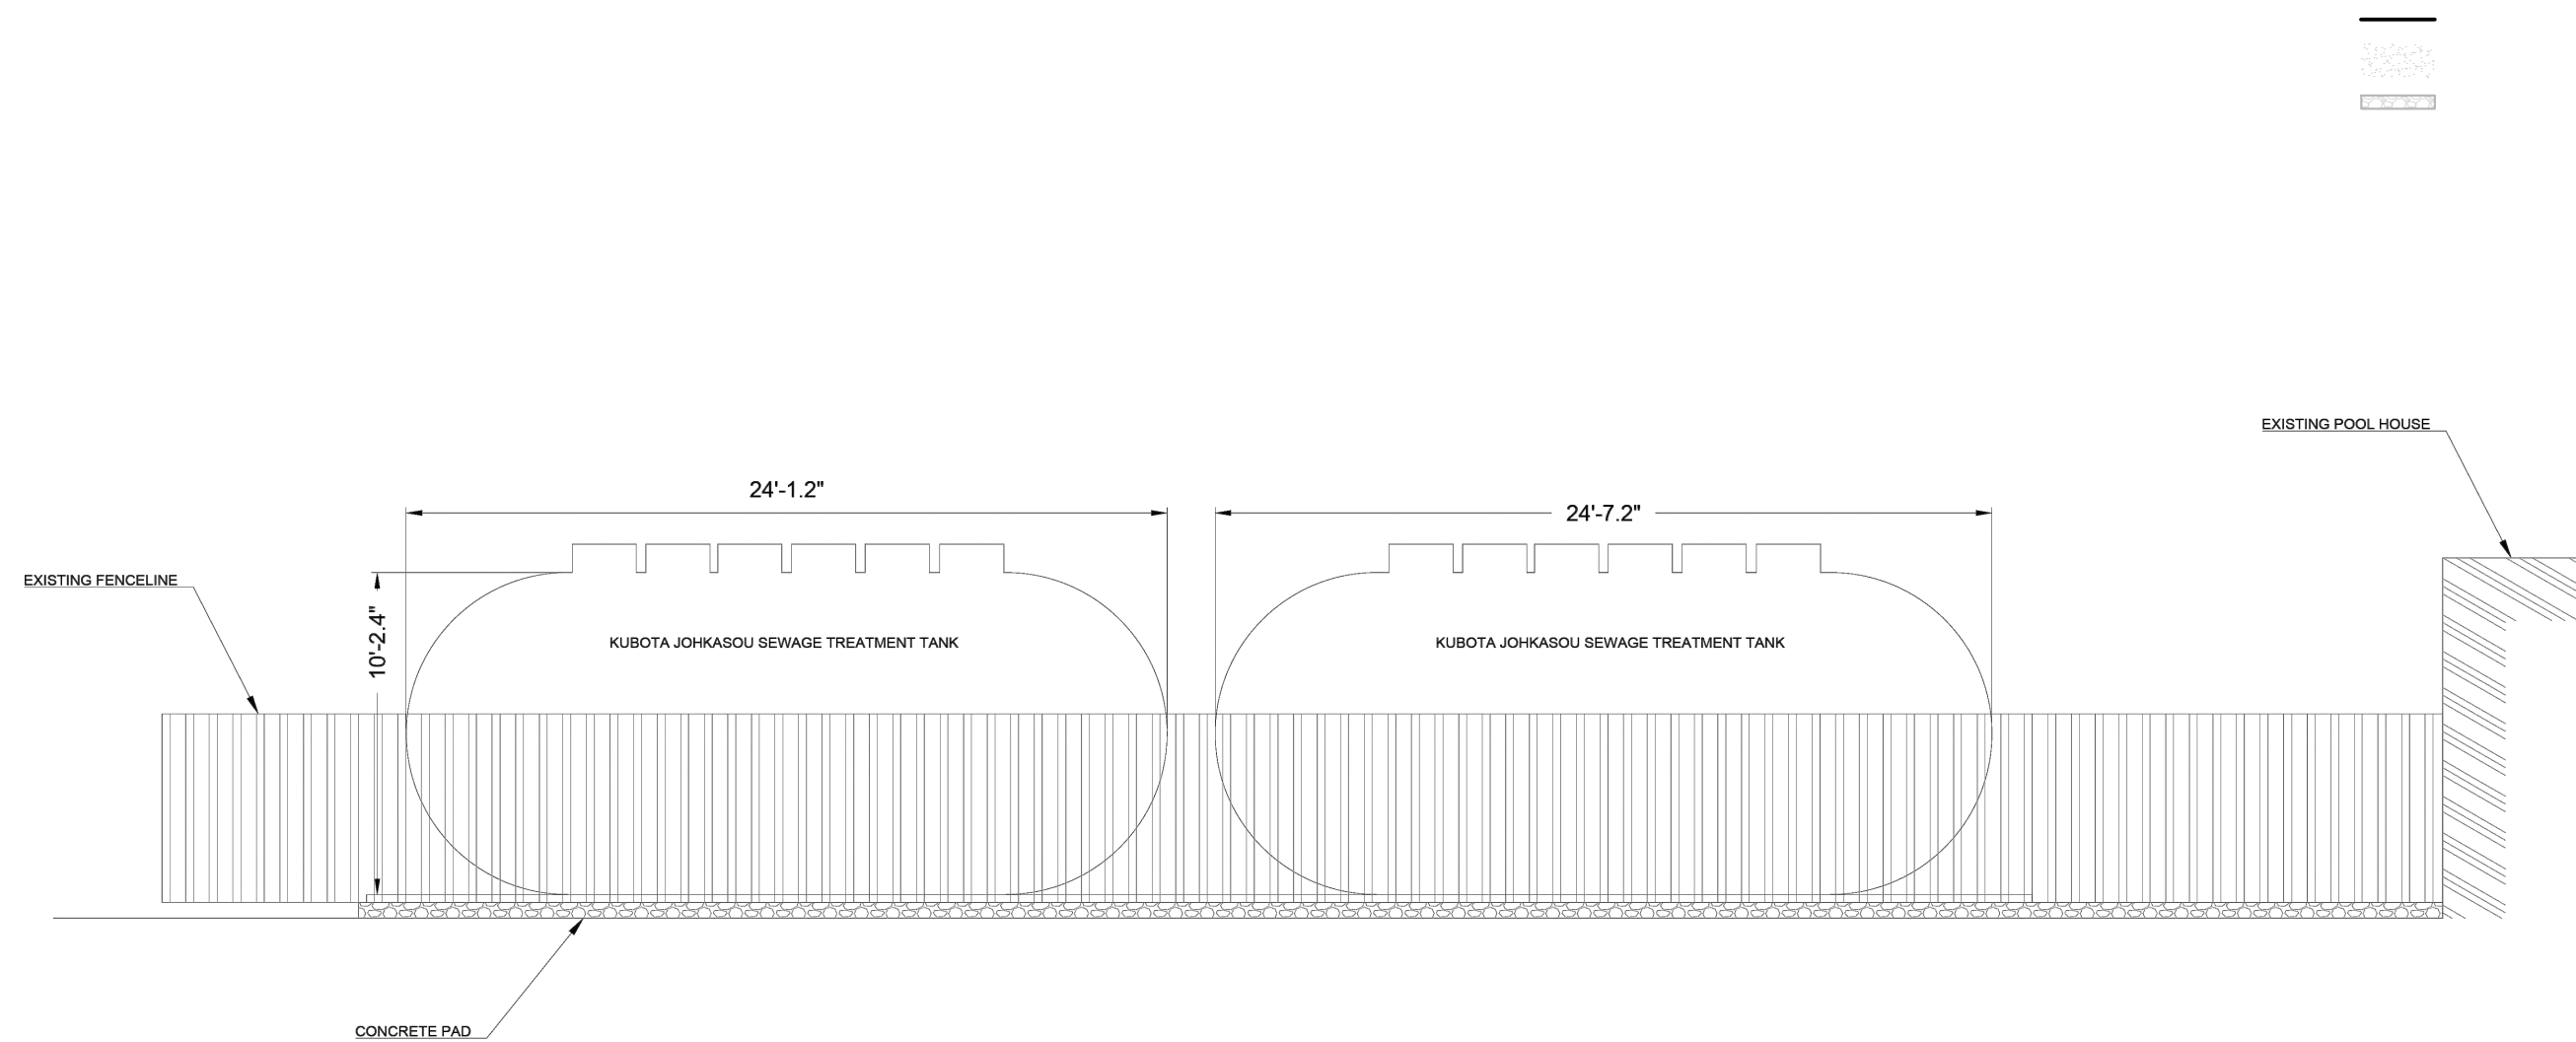


NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

Drawing - C-411, WWTP Elevation View, Ono Vista Condominium WWTP Replacement, 68-242 Apuhihi Street, Waialua, Oahu, Hawaii 96791, TMK: (1) 6-8-011:058, Project Number 22023_22035, Date: March 16, 2023.

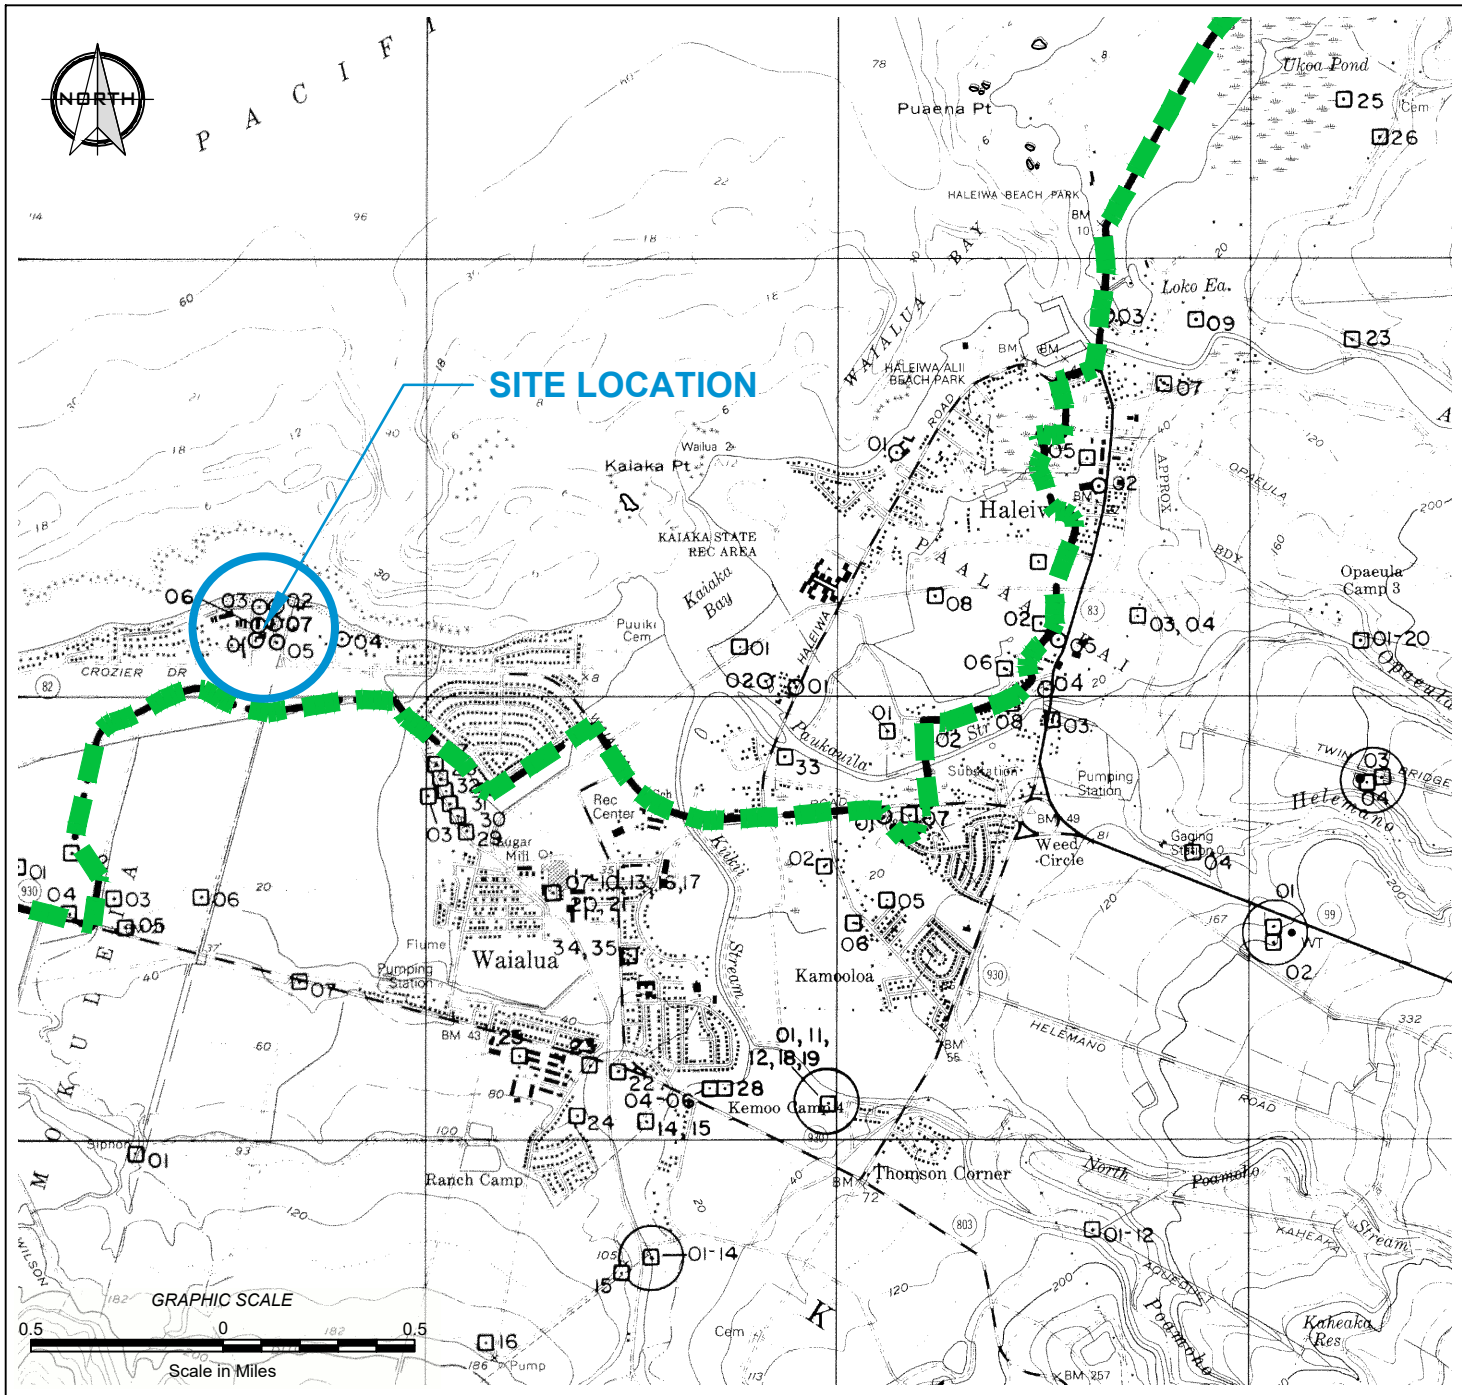

LEGEND	
	ONO VISTA CONDOMINIUMS TMK NO. (1) 6-8-011:058
	UNDERGROUND INJECTION CONTROL [UIC] LINE
	DRINKING SOURCE WELL
	INJECTION WELL
	OTHER WELL

NOTES


The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

O-4 Haleiwa, Hawaii, State of Hawaii, Department of Health, Underground Injection Control Program, Effective - July 6, 1984, U.S. Department of the Interior Geological Survey, 1984.

<http://planning.hawaii.gov/gis/>, 2019.

FIGURE 6
UIC LINE & WELL LOCATION MAP
 ENVIRONMENTAL ASSESSMENT
 Wastewater Treatment Plant Replacement
 68-024 Apuhihi Street, Waialua, Hawaii
 TMK No. (1) 6-8-011:058

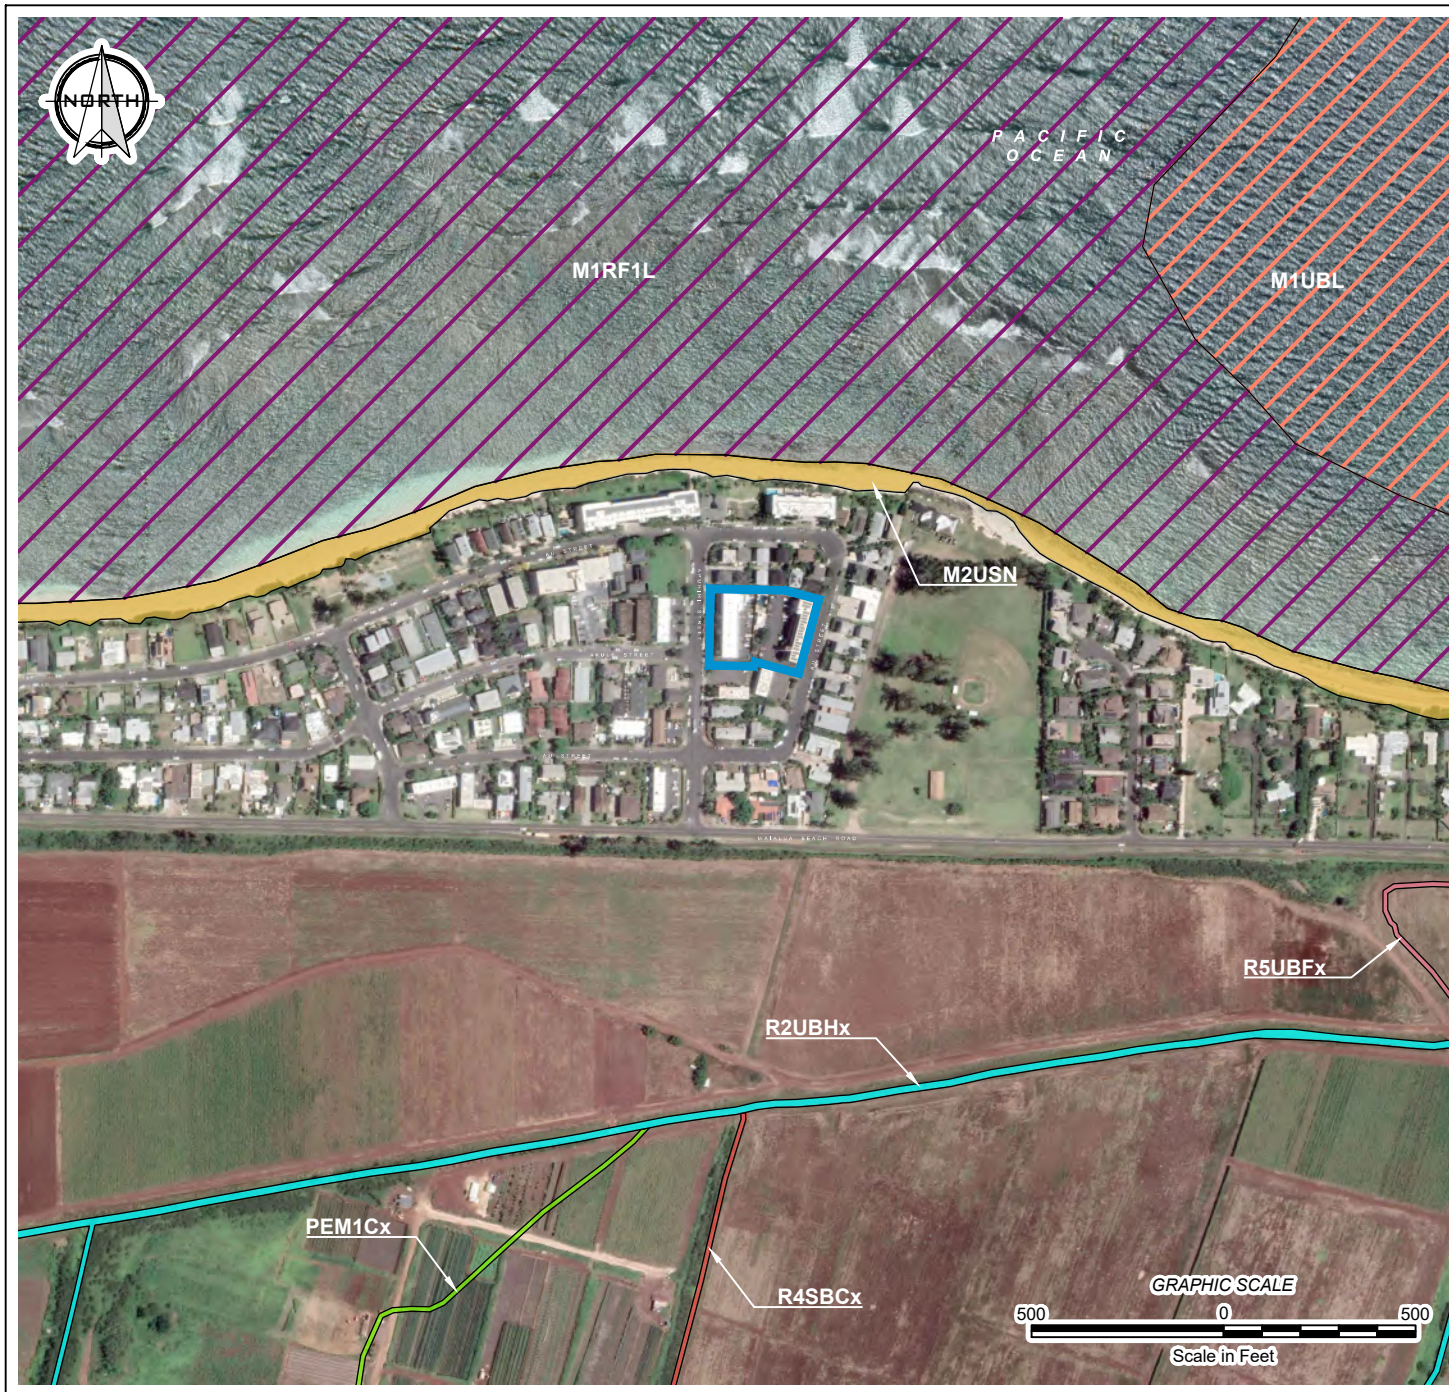

LEGEND

- ONO VISTA CONDOMINIUMS
TMK NO. (1) 6-8-011:058
- M1RF1L - Estuarine and Marine Deepwater
- M1UBL - Estuarine and Marine Deepwater
- M2USN - Estuarine and Marine Wetland.
- PEM1Cx - Freshwater Emergent Wetland
- R2UBHx - Riverine
- R4SBCx - Riverine
- R5UBFx - Riverine

NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

Aerial Map, 21°34'58.5"N 158°08'15.0"W, Imagery Date: April 21, 2021. Google Earth Pro, September 13, 2022.


USFWS, 2022c, United States Fish and Wildlife Service National Wetlands Inventory Mapper. Accessed at: <https://www.fws.gov/wetlands/data/mapper.html>, 2023.

<http://planning.hawaii.gov/gis/>, 2022.

FIGURE 7

USFWS WETLANDS MAP

ENVIRONMENTAL ASSESSMENT
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street, Waialua, Hawaii
TMK No. (1) 6-8-011:058

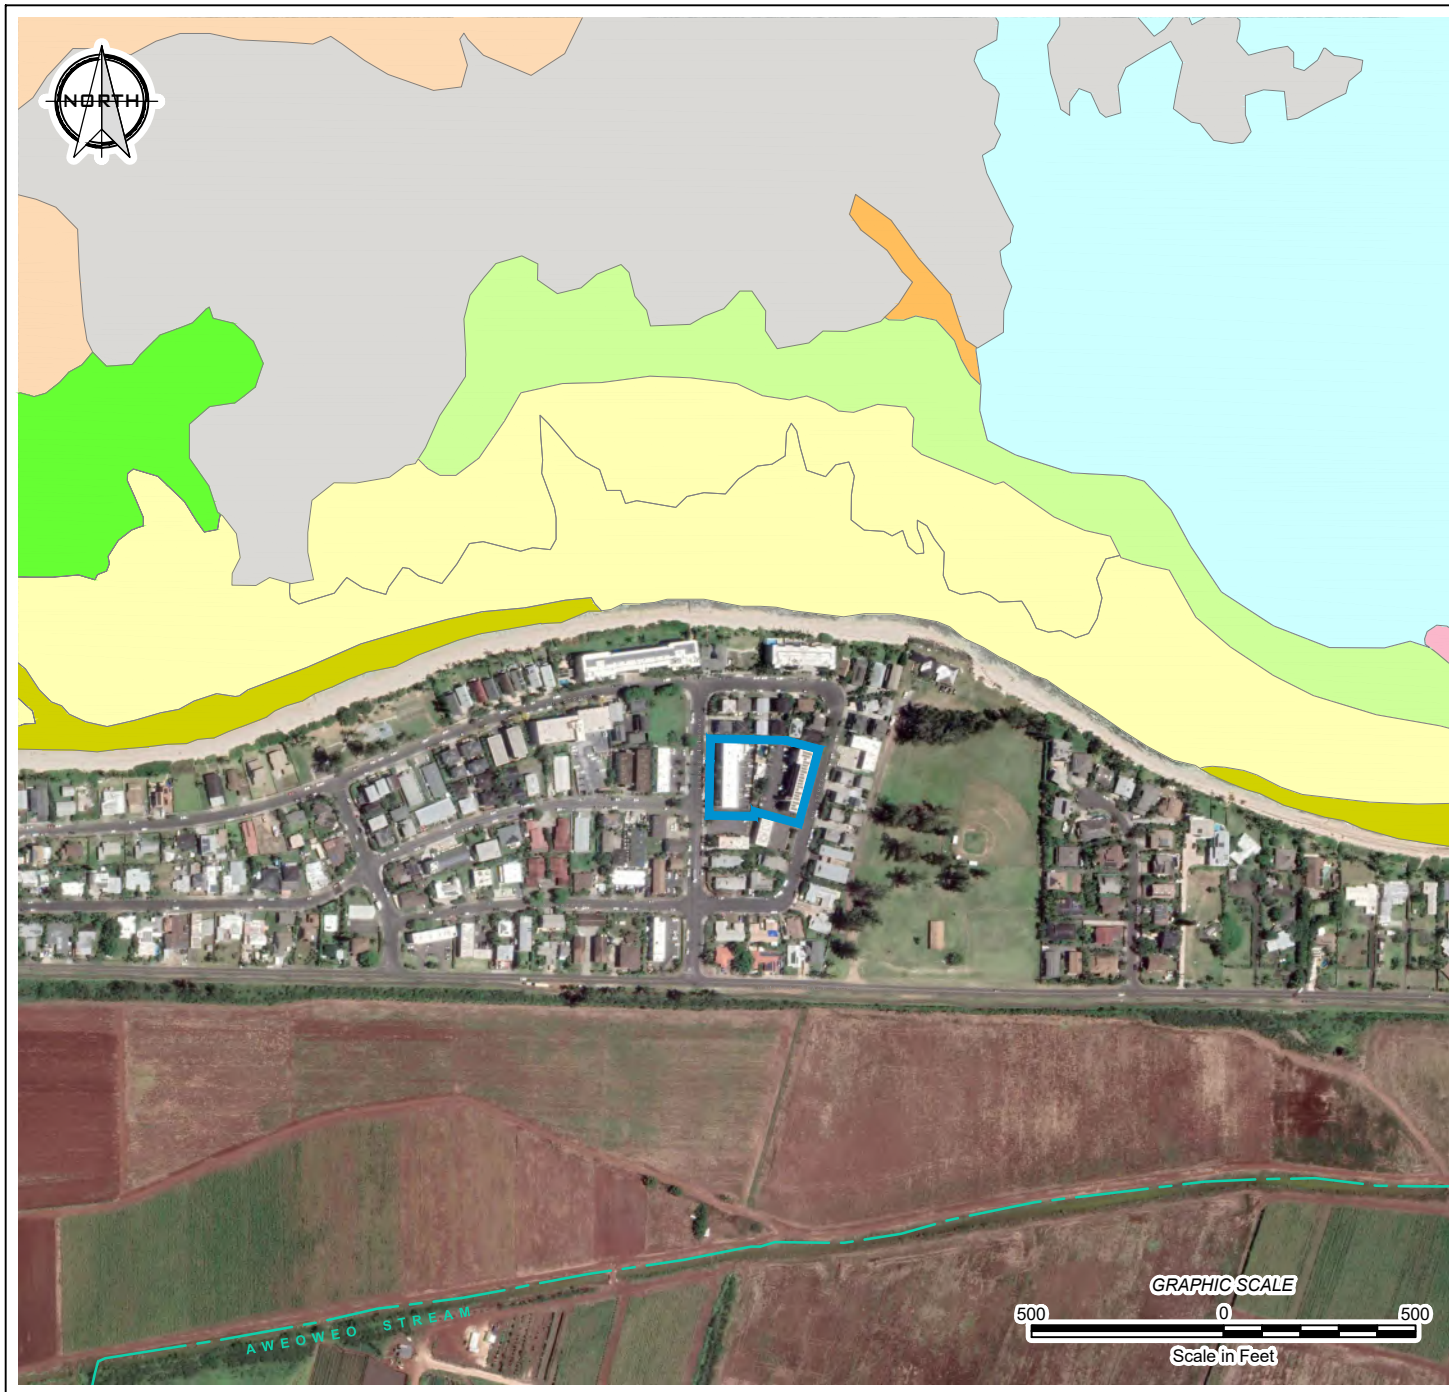

LEGEND

- ONO VISTA CONDOMINIUMS
TMK NO. (1) 6-8-011:058
- NON-PERENNIAL STREAM
- BANK/SHELF, Uncolonized 90%-100%
- CHANNEL, TURF 50%-<90%
- FORE REEF, TURF 50%-<90%
- FORE REEF, UNKNOWN
- REEF CREST, CORALLINE ALGAE
10%-<50%
- REEF CREST, CORALLINE ALGAE
50%-<90%
- REEF FLAT, MACROALGAE
10%-<50%
- REEF FLAT, UNCOLONIZED
90%-100%
- UNKNOWN

NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

Aerial Map, 21°34'58.5"N 158°08'15.0"W, Imagery Date: April 21, 2021. Google Earth Pro, September 13, 2022.


<http://planning.hawaii.gov/gis/>, 2022.

FIGURE 8

BENTHIC MAP

ENVIRONMENTAL ASSESSMENT
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street, Waialua, Hawaii
TMK No. (1) 6-8-011:058

NOAA et al. 2017 Relative Sea Level Change Scenarios for : HONOLULU

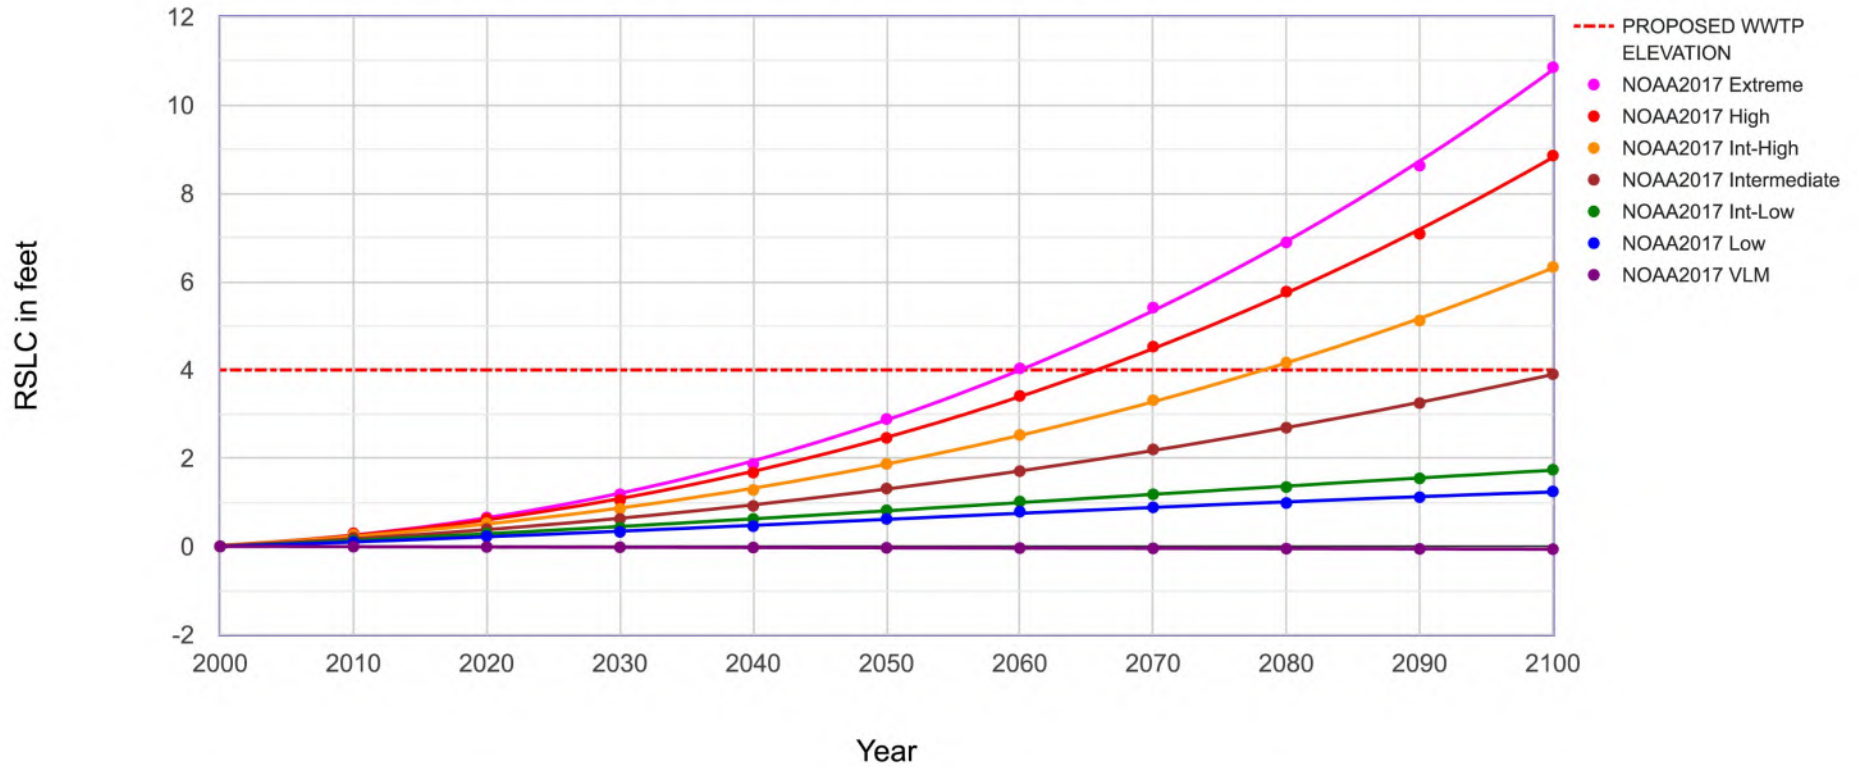

ONO VISTA CONDOMINIUMS
Scenarios for HONOLULU
NOAA2017 VLM: -0.00062 feet/yr
All values are expressed in feet



Year	NOAA2017 VLM	NOAA2017 Low	NOAA2017 Int-Low	NOAA2017 Intermediate	NOAA2017 Int-High	NOAA2017 High	NOAA2017 Extreme
2000	0.00	0.00	0.00	0.00	0.00	0.00	0.00
2010	-0.01	0.10	0.13	0.20	0.26	0.30	0.30
2020	-0.01	0.23	0.30	0.39	0.52	0.62	0.66
2030	-0.02	0.33	0.43	0.62	0.85	1.05	1.18
2040	-0.02	0.46	0.62	0.92	1.28	1.67	1.87
2050	-0.03	0.62	0.82	1.31	1.87	2.46	2.89
2060	-0.04	0.79	1.02	1.71	2.53	3.41	4.04
2070	-0.04	0.89	1.18	2.20	3.31	4.53	5.41
2080	-0.05	0.98	1.35	2.69	4.17	5.77	6.89
2090	-0.06	1.12	1.54	3.25	5.12	7.09	8.63
2100	-0.06	1.25	1.74	3.90	6.33	8.86	10.86

SOURCES: NOAA et. al. 2017
USACE Sea level Change Curve Calculator (2022.60),
https://cwbi-app.sec.usace.army.mil/rccslc_slcc_calc.html

- NOTES:
- Honolulu is a permanent service for mean sea level [MSL] station.
 - LMSL 83-01 is the local mean sea level from 1993 to 2001 which adjusts the MSL datum by 0.084 feet.
 - RSLC = Relative Sea Level Change
VLM = Vertical Land Movement (feet/year)

FIGURE 9
RELATIVE SEA LEVEL CHANGE SCENARIOS FOR HONOLULU
ENVIRONMENTAL ASSESSMENT
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street, Waialua, Hawaii
TMK No. (1) 6-8-011:058




LEGEND	
	ONO VISTA CONDOMINIUMS TMK NO. (1) 6-8-011:058
	SEA LEVEL RISE EXPOSURE AREA - 3.2 FEET SCENARIO

NOTES
The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES
Aerial Map, 21°34'58.5"N 158°08'15.0"W, Imagery Date: April 21, 2021. Google Earth Pro, September 13, 2022.
http://planning.hawaii.gov/gis/ , 2022.

FIGURE 10
SEA LEVEL RISE EXPOSURE MAP

ENVIRONMENTAL ASSESSMENT
Wastewater Treatment Plant Replacement
68-024 Apuhihi Street, Waialua, Hawaii
TMK No. (1) 6-8-011:058

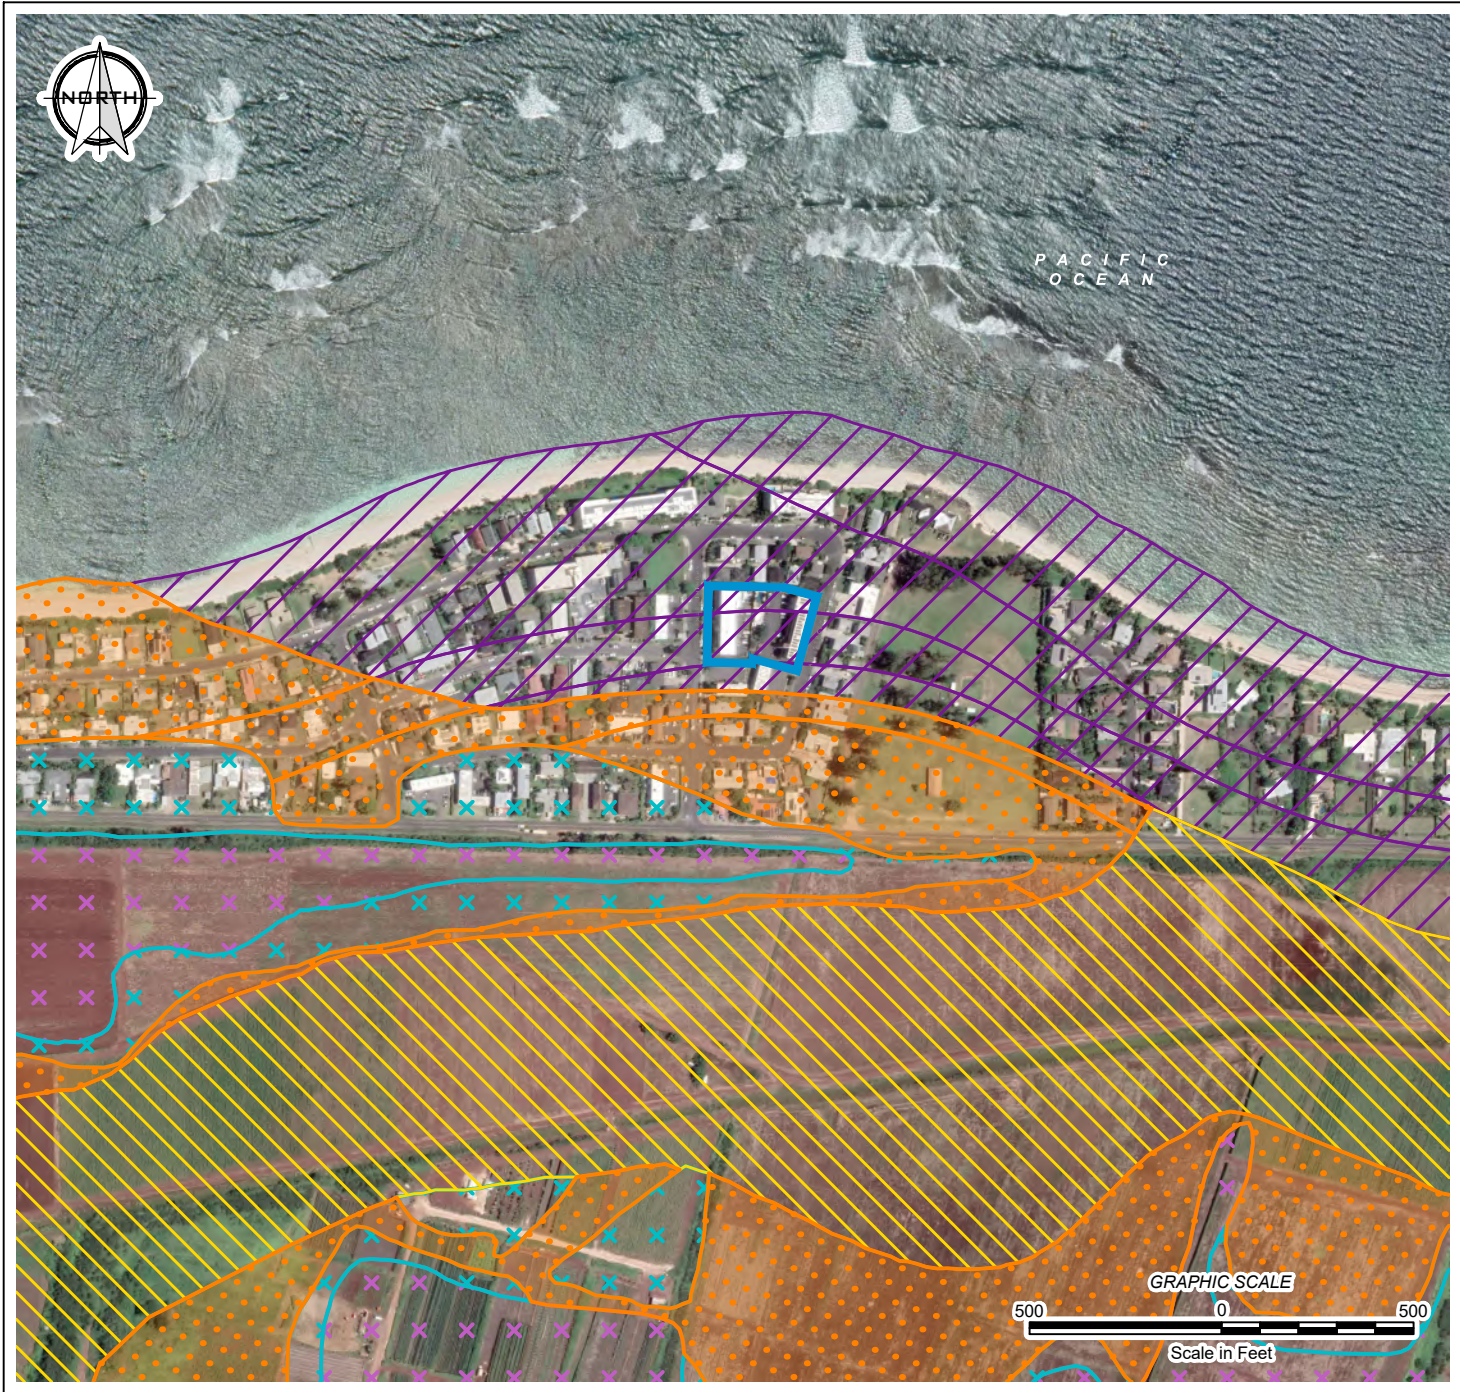

LEGEND

- ONO VISTA CONDOMINIUMS
TMK NO. (1) 6-8-011:058
- AE - Area subject to inundation by the 1%-annual-chance flood event for which Base Flood Elevations [BFEs] have been determined.
- AEF - Floodway areas in Zone AE. The floodway is the channel of stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without increasing the BFE.
- VE - Coastal flood zone with velocity hazard (wave action); BFE determined.
- X - Areas determined to be outside the 0.2% annual chance floodplain.
- XS (X shaded) - Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of <1 foot or with drainage areas <1 square mile; & areas protected by levees from 1% annual chance flood.

NOTES


The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

Aerial Map, 21°34'58.5"N 158°08'15.0"W, Imagery Date: April 21, 2021. Google Earth Pro, September 13, 2022.
 Flood hazard Assessment Tool, <http://gis.hawaiiifip.org/FHAT/>, 2022
<http://planning.hawaii.gov/gis/>, 2022.

**FIGURE 11
FLOOD HAZARD MAP**

ENVIRONMENTAL ASSESSMENT
 Wastewater Treatment Plant Replacement
 68-024 Apuhihi Street, Waialua, Hawaii
 TMK No. (1) 6-8-011:058

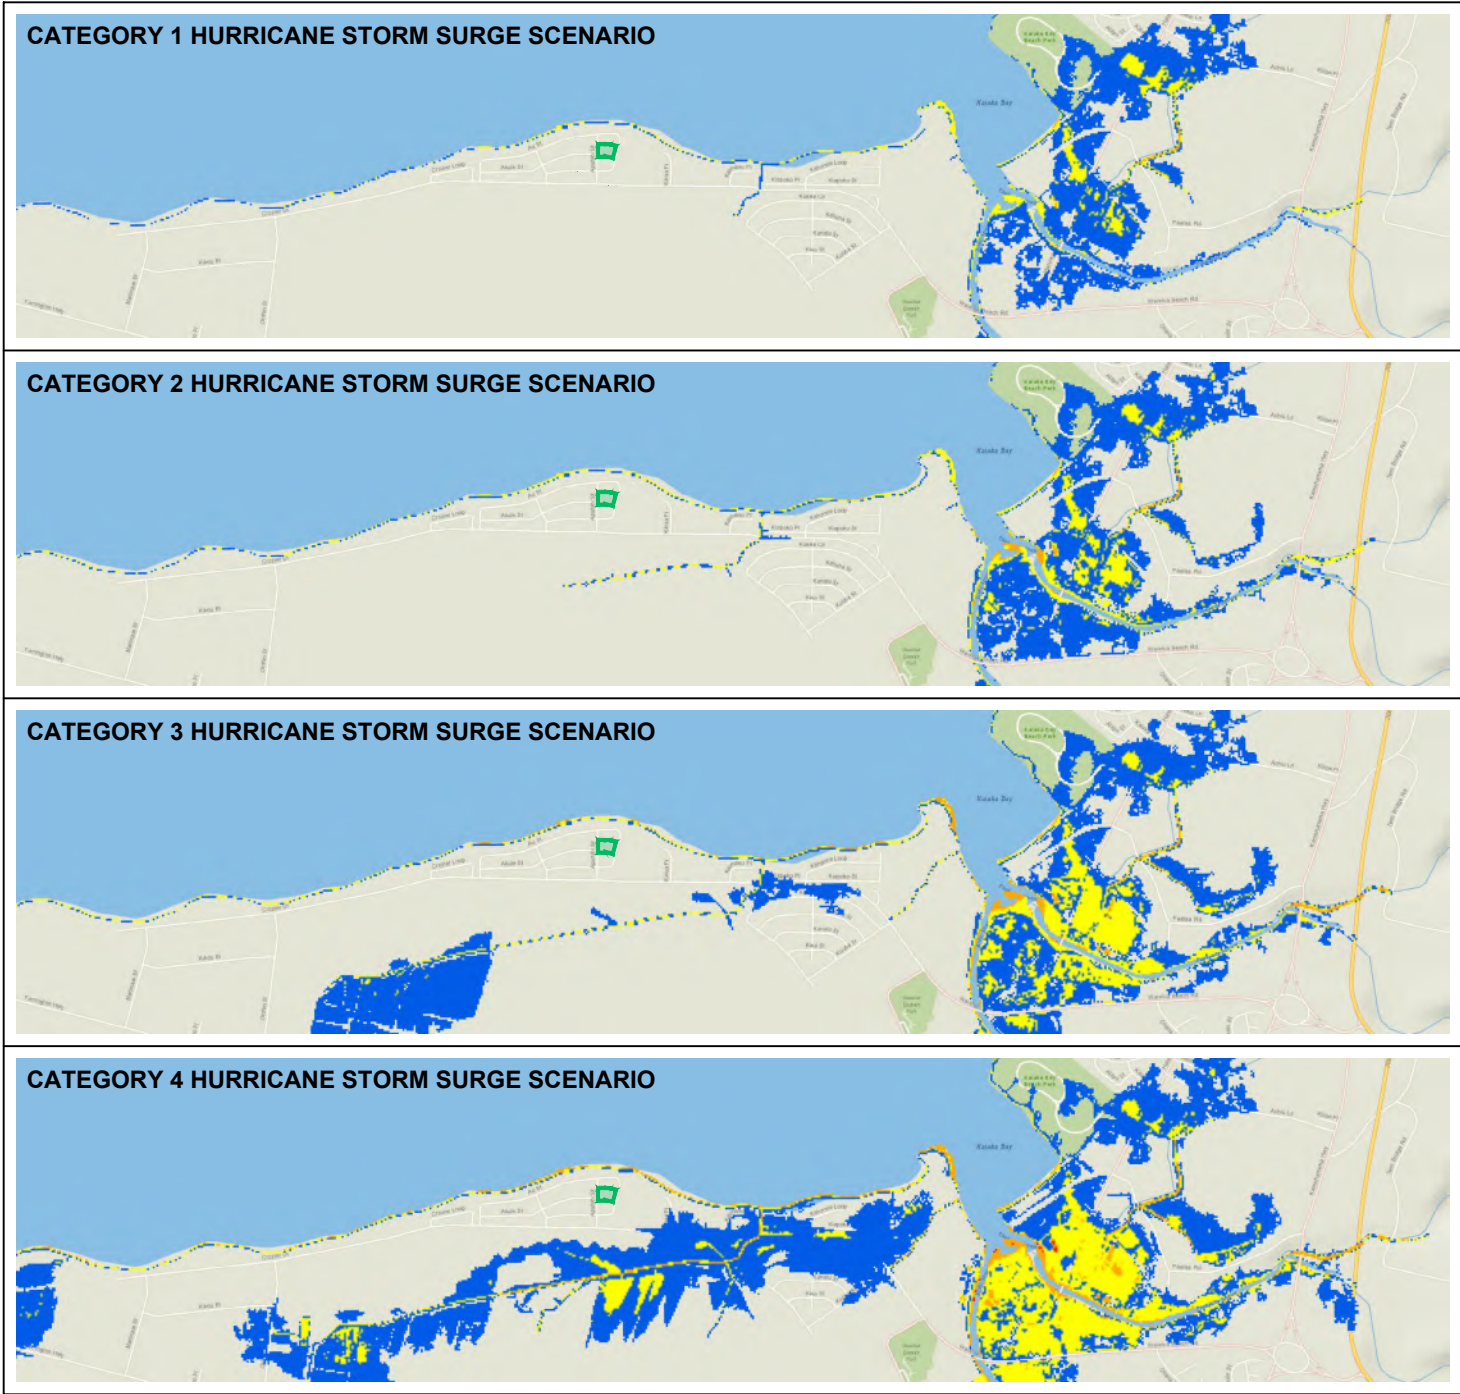

LEGEND

- ONO VISTA CONDOMINIUMS
TMK NO. (1) 6-8-011:058
- HAWAII STORM SURGE INUNDATION HEIGHT**
- UP TO 3 FEET ABOVE GROUND
- GREATER THAN 3 FEET ABOVE GROUND
- GREATER THAN 6 FEET ABOVE GROUND
- GREATER THAN 9 FEET ABOVE GROUND

NOTES

The accuracy of this document is limited to the quality and scale of the source information. This document is not a legal representation of an engineered survey.

SOURCES

Tile Layer - Category 1, 2, 3, & 4 Hurricane Storm Surge Risk Maps. NOAA/NWS/NHC/Storm Surge Unit, Map Date: 06/13/2022.
 Basemap - National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.
<http://planning.hawaii.gov/gis/>, 2022.




FIGURE 12
STORM SURGE HAZARD MAP

ENVIRONMENTAL ASSESSMENT
 Wastewater Treatment Plant Replacement
 68-024 Apuhihi Street, Waialua, Hawaii
 TMK No. (1) 6-8-011:058

APPENDIX A

Site Photographs



Photo 1: Condo building.



Photo 2: East parking lot facing north.



Photo 3: East parking lot facing south.



Photo 4: Gate to wastewater treatment system enclosure.



Appendix A – Site Photographs

Ono Vista Condominium WWTP

Draft Environmental Assessment

Photos 1-4

Waialua, Hawaii

ESI Project No. 122067



Photo 5: Inside current wastewater treatment system area - facing north.



Photo 6: North portion of wastewater treatment system enclosure - facing north. Generator enclosure/machine room and Pool House in background.



Photo 7: Inside current wastewater treatment system enclosure - facing south.



Photo 8: Pump station in parking lot.



Appendix A – Site Photographs

Ono Vista Condominium WWTP

Draft Environmental Assessment

Photos 5-8

Waialua, Hawaii

ESI Project No. 122067



Photo 9: Interior of lift station.



Photo 10: Eastern parking lot where three injection wells are located – facing north.



Photo 11: In parking lot, injection well #2 - facing north.



Photo 12: Interior of injection well #2.



Appendix A – Site Photographs

Ono Vista Condominium WWTP

Draft Environmental Assessment

Photos 9-12

Waialua, Hawaii

ESI Project No. 122067



Photo 13: Interior of blower room inside Pool House.



Photo 14: Emergency back-up generator inside machine room attached to Pool House.



Photo 15: Driveway into east parking lot from Au Street - facing east.



Photo 16: Driveways of Ono Vista Condominium and adjacent property – facing west.



Appendix A – Site Photographs

Ono Vista Condominium WWTP

Draft Environmental Assessment

Photos 13-16

Waialua, Hawaii

ESI Project No. 122067



Photo 17: Street adjacent to east side of property (Au St.) - facing north.



Photo 18: Street adjacent to east side of property (Au St.) - facing south.



Appendix A – Site Photographs

Ono Vista Condominium WWTP

Draft Environmental Assessment



Photos 17-18

Waialua, Hawaii

ESI Project No. 122067

APPENDIX B

As-Built Drawings for Original Wastewater Treatment System

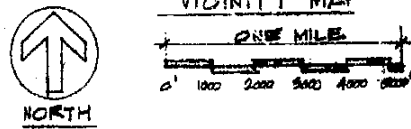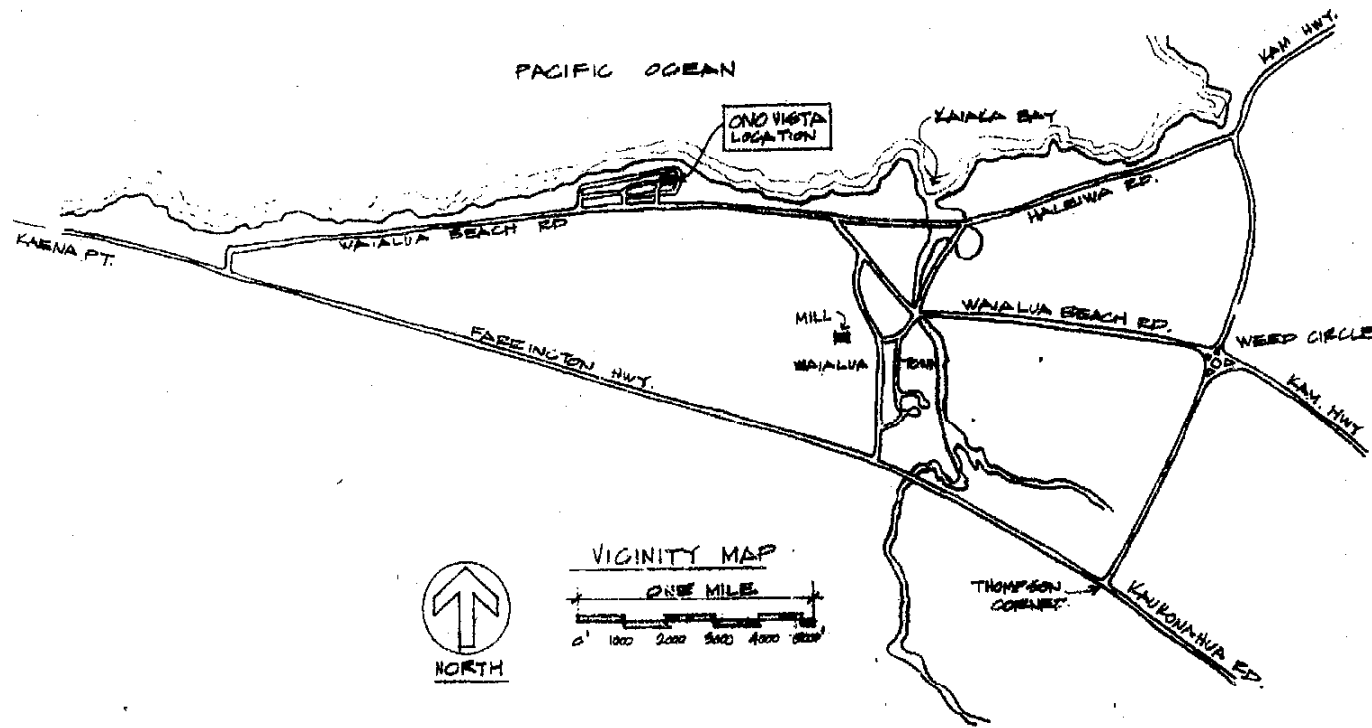

PROJECT DATA

MAP KEY: 6-8-11: 58, 50, 63, 64
 AREA: 51,600 #
 ZONING: A-2
 SETBACK: FRONT YARD 10'
 SIDE YARDS - 10' PLUS 1' FOR EA 10' ABOVE 30' = 11' MAX
 HEIGHT LIMIT: 40 FT.
 U.I. RATING: G7
 PARKING: REQ'D. = 1.25 x 64 UNITS = 80
 PROVIDED = 80 SPACES (64 REGULAR & 16 COMPACT)


CZC CALCULATIONS

U.I.: G7
 F.A.R.: 1.30
 ZONING LOT = 51,600 #
 1/2 STREETS = 11,200 # (400' x 28')
 62,800 # = LAND AREA
 1.30 x 62,800 = 81,764 # MAX. FLOOR AREA ALLOWED

ACTUAL FLOOR AREA

24,718 # x 2 BLDGS = 49,436 # TOTAL
 1ST FLR: 4880 #
 2ND FLR: 5300 #
 3RD FLR: 4540 #
 4TH FLR: 5300 #
 5TH FLR: 4540 #
 2.6 R: 52 x 40,436 # = 26,706 # REQ'D
 LAND AREA MINUS BLDG AREA = 53,236 # O.K.
 3 R: 32 x 40,436 # = 15,020 # REQ'D
 ZONING LOT MINUS BLDGS & PARKING = 17,264 # O.K.
 4.5 R: 476 x 40,436 # = 3757 # REQ'D
 RECREATION AREA PROVIDED = 5,010 # O.K.
 LESS AREA OF REC. BLDG = 384 #
 4636 # TOTAL

SHEET NUMBER	SHEET INDEX
A 1	SITE PLAN, VICINITY MAP, PROJECT DATA, SHEET INDEX
A 2	GROUND FLOOR PLAN
A 3	2ND & 4TH FLR. PLAN, 3RD & 5TH FLR. PLANS & CROSS SECTIONS
A 4	1/4" SCALE FLR. PLAN & INTERIOR ELEVATIONS
A 5	EXTERIOR ELEVATIONS
A 6	STAIR DETAILS, ROOF PLAN & RECREATION BUILDING
A 7	INTERIOR FINISH, DOOR & WINDOW SCHEDULES & DETAILS
S 1	FOUNDATION & GRD. FLR. PLAN & DETAILS
S 2	2ND & 4TH FLOOR, 3RD & 5TH FLOOR FRAMING PLANS
S 3	ROOF FRAMING PLAN - SECTIONS & DETAILS
S 4	GENERAL NOTES, STAIR & TYPICAL DETAILS
M 1	SEWERAGE TREATMENT PLANT SITE PLAN & DETAILS
M 2	SEWERAGE TREATMENT PLANT DETAILS
M 3	"
M 4	GROUND FLOOR PLAN
M 5	2ND & 4TH FLOOR PLAN AND 3RD & 5TH FLOOR PLAN
M 6	ROOF PLAN & DETAILS
M 7	DETAIL PLANS
M 8	DETAIL PLAN AND DETAILS
M 9	SOIL, WASTE & VENT PIPING AND D.S.P. DIAGRAMS
M 10	C.W. & H.W. PIPING DIAGRAMS, W.S.P. PIPING DIAGRAM & W.S.P. CALCULATIONS
M 11	EQUIP. SCHEDULE, FIXTURE LOCAL CORR. SCHEDULE, MECH. LEGEND, REC. BLDG. FLOOR PLAN & DIAGRAM
E 1	ELECTRICAL SITE PLAN & LEGEND & NOTES
E 2	FIRST FLOOR PLAN & DETAIL
E 3	2ND, 3RD, 4TH, 5TH AND ROOF FLOOR PLANS
E 4	TYPICAL UNITS LAYOUT PLANS, N.E.C. CALCS, SCHEDULES
E 5	DIAGRAMS

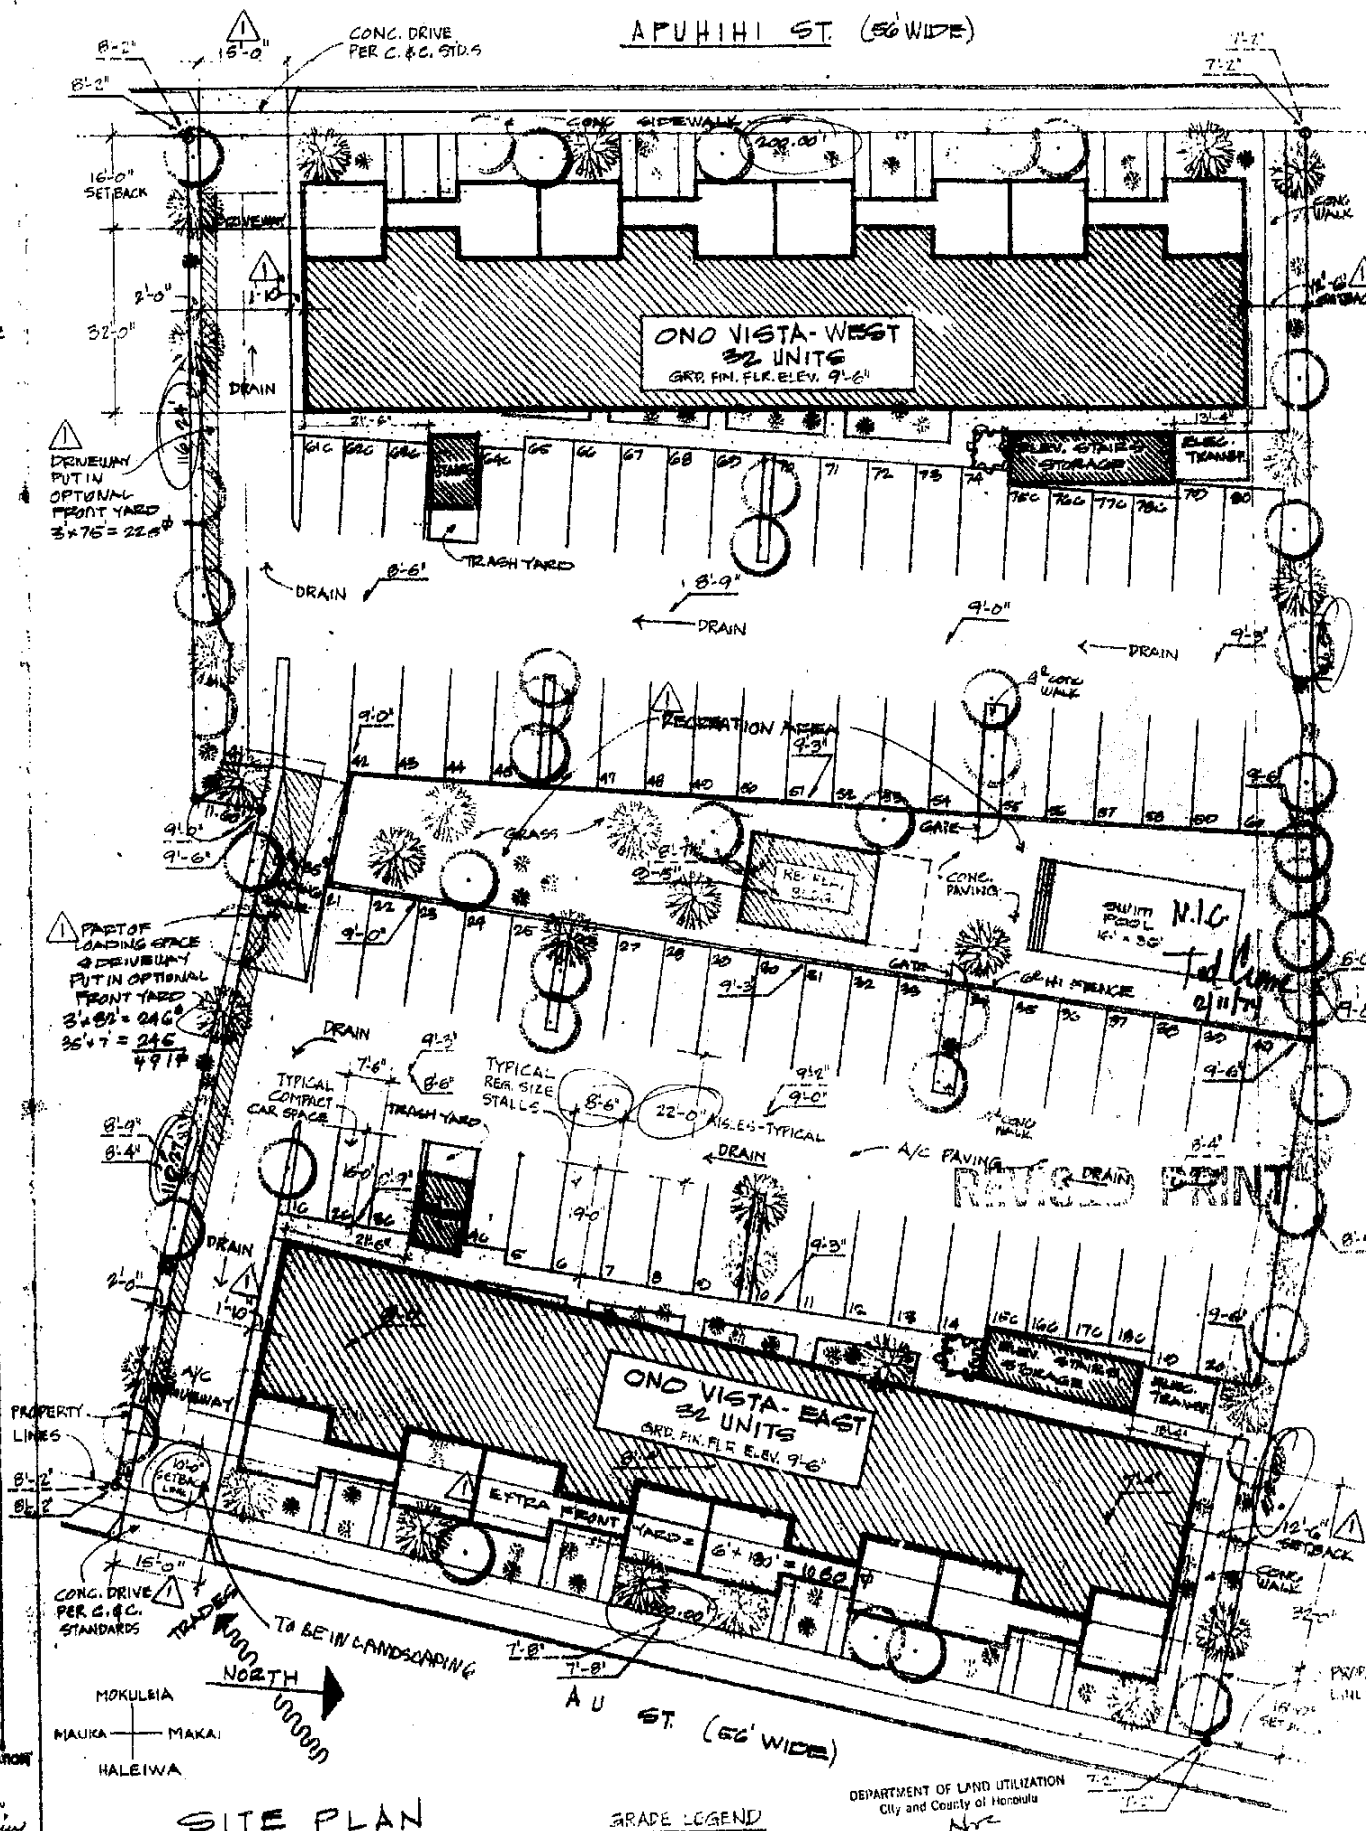

CONSTRUCTION OR INSTALLATION APPROVED BY

Approved by: *Bonifacio K. Lim*
 Approved by: *Maria M. Mardama*
 FEB 6 1974

20721
Maria M. Mardama
 FEB 6 1974





SITE PLAN
 1/16" = 1'-0"

GRADE LEGEND
 E.L.T. - EXIST. GRADES
 N.E.S. - NEW GRADES

DEPARTMENT OF LAND UTILIZATION
 City and County of Honolulu

Checked by: *NVC*
 Date: *5/1/74*

2222 MALAKUA AVE., SUITE 701
 HONOLULU, HAWAII 96815
 TELEPHONE 523-5777
 WEITABER - CRANE - IED
 ARCHITECT - AIA
 THE "ONO VISTA" 64 UNIT CONDOMINIUM
 ONO VISTA - EAST & ONO VISTA - WEST A QUART VENTURE
 SHEET TITLE: SITE PLAN, VICINITY MAP, PROJECT DATA, SHEET INDEX
 DATE: 1/16/74
 JOB NO: 7502-C
 SHEET: 1 OF SEVEN SHEETS

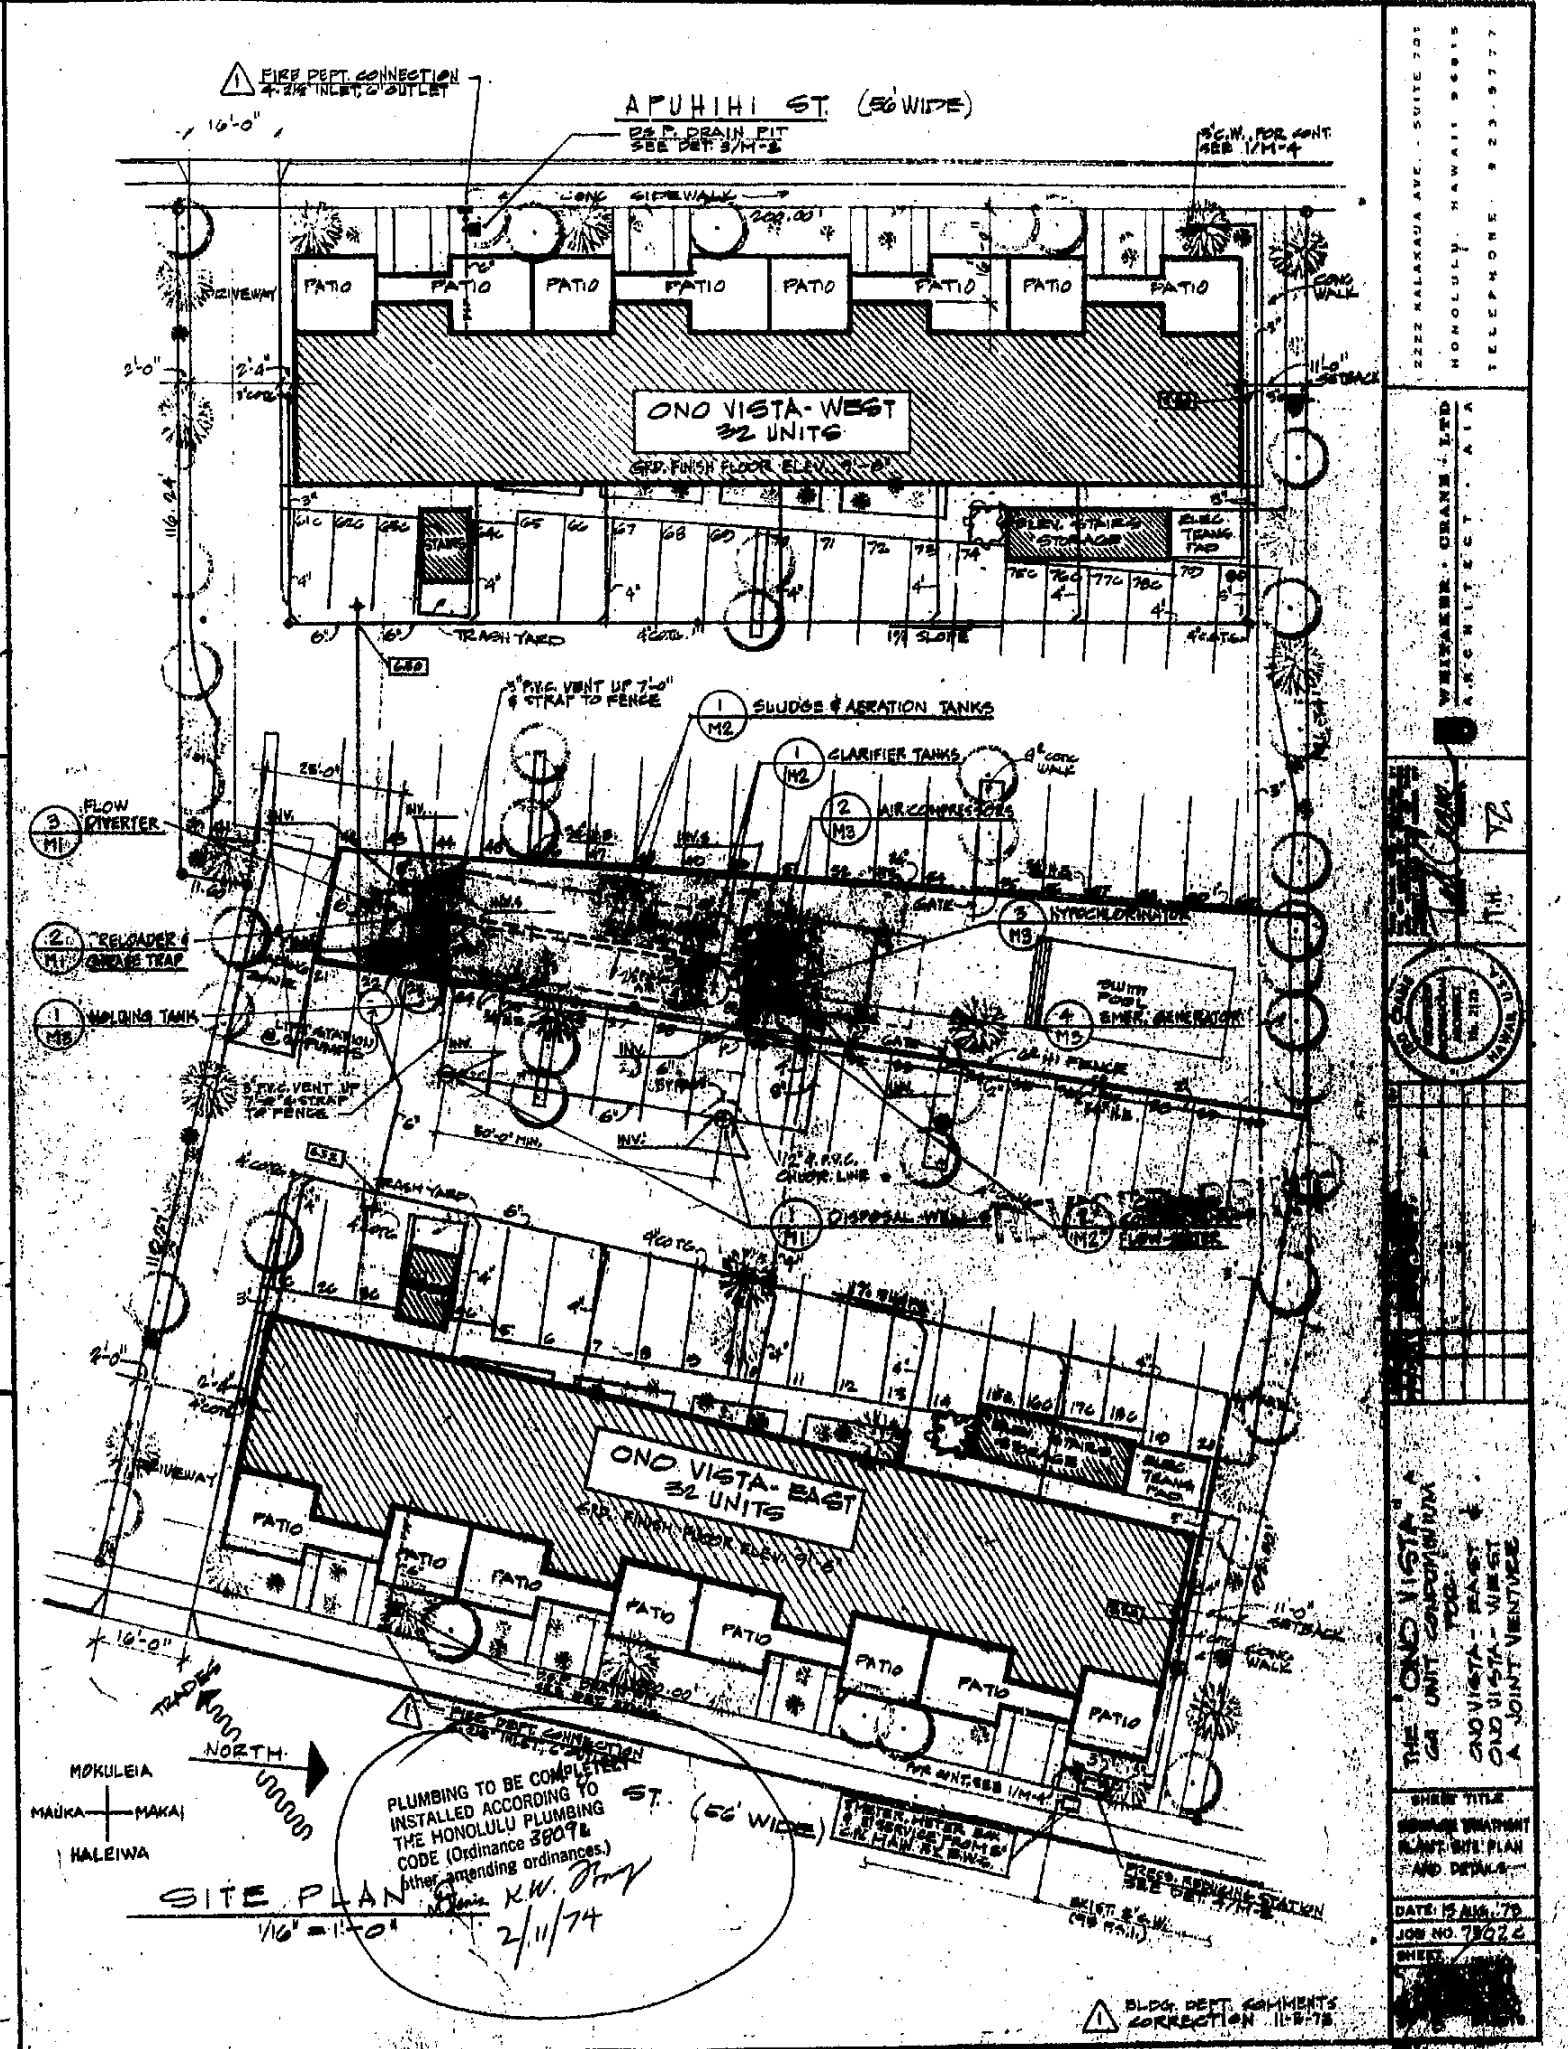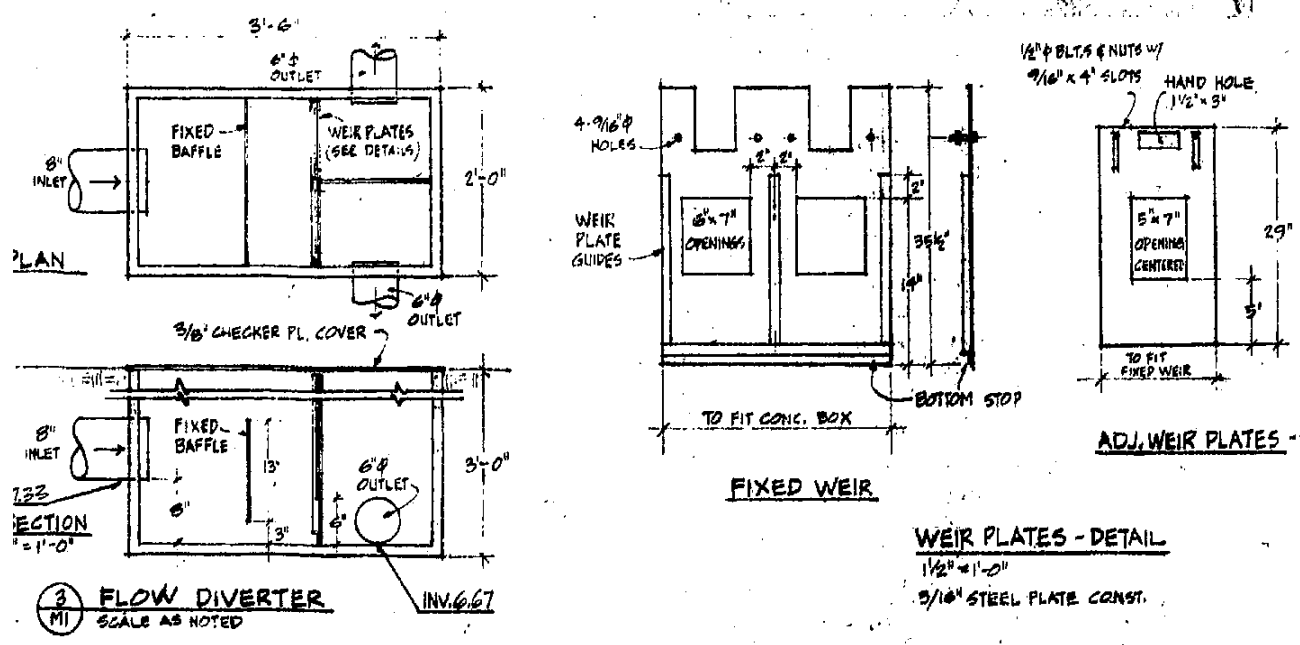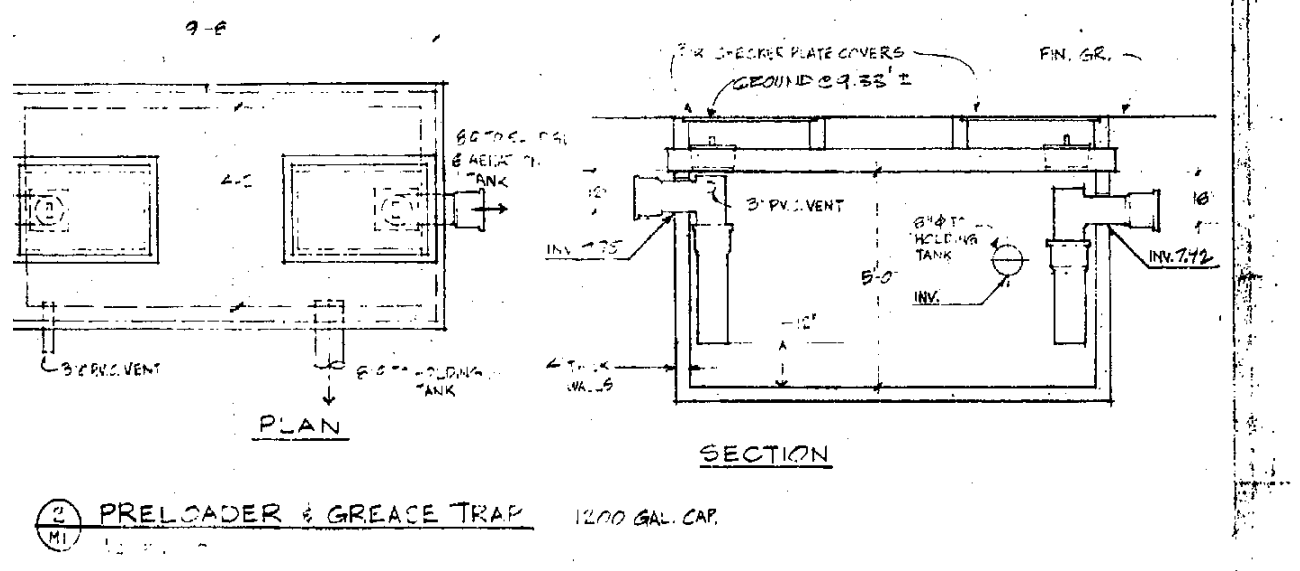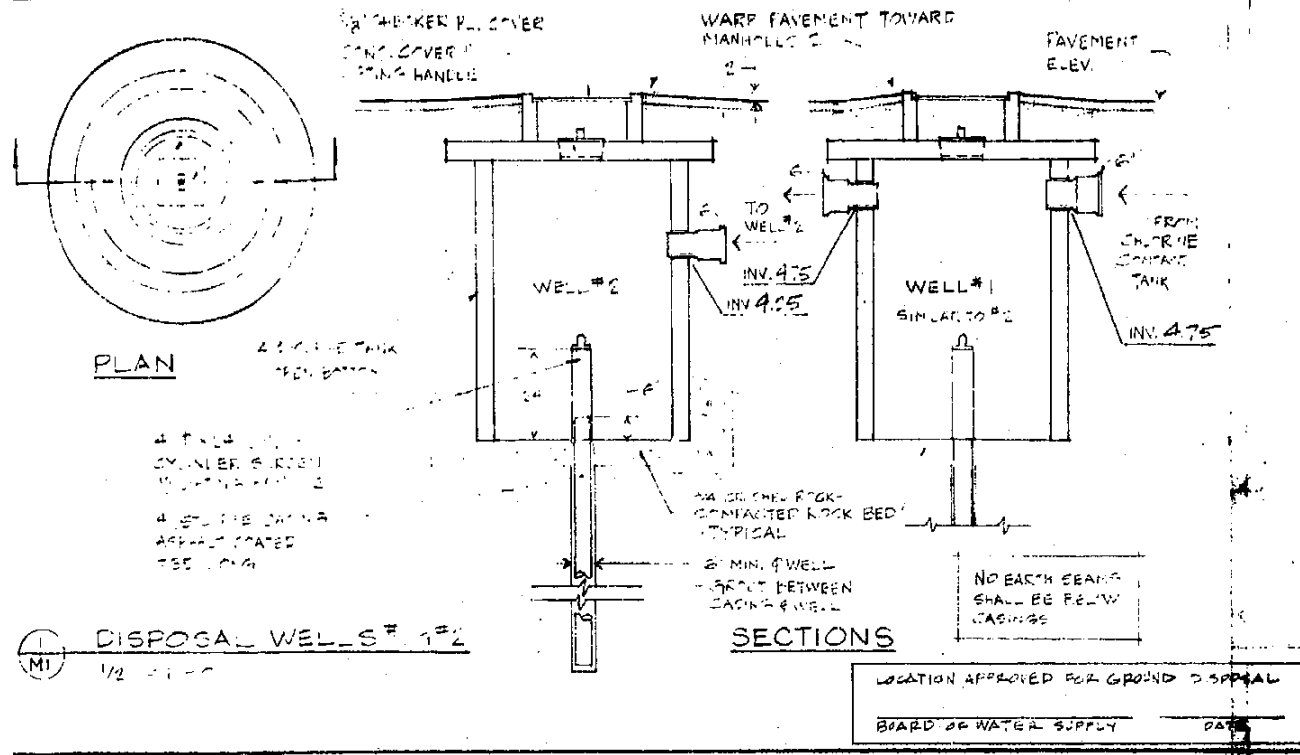


2222 KALANOA AVE., SUITE 701
HONOLULU, HAWAII 96815
TELEPHONE: 923-9777

WEISSBERG, CRANE & LTD.
ARCHITECTS & ENGINEERS

THE ONOVISTA
ONOVISTA WEST
ONOVISTA EAST
A JOINT VENTURE


SHEET TITLE
PLUMBING PLAN AND DETAILS
DATE: 12/15/73
JOB NO. 73022

BLDG. DEPT. COMMENTS
CORRECTION 11-8-78

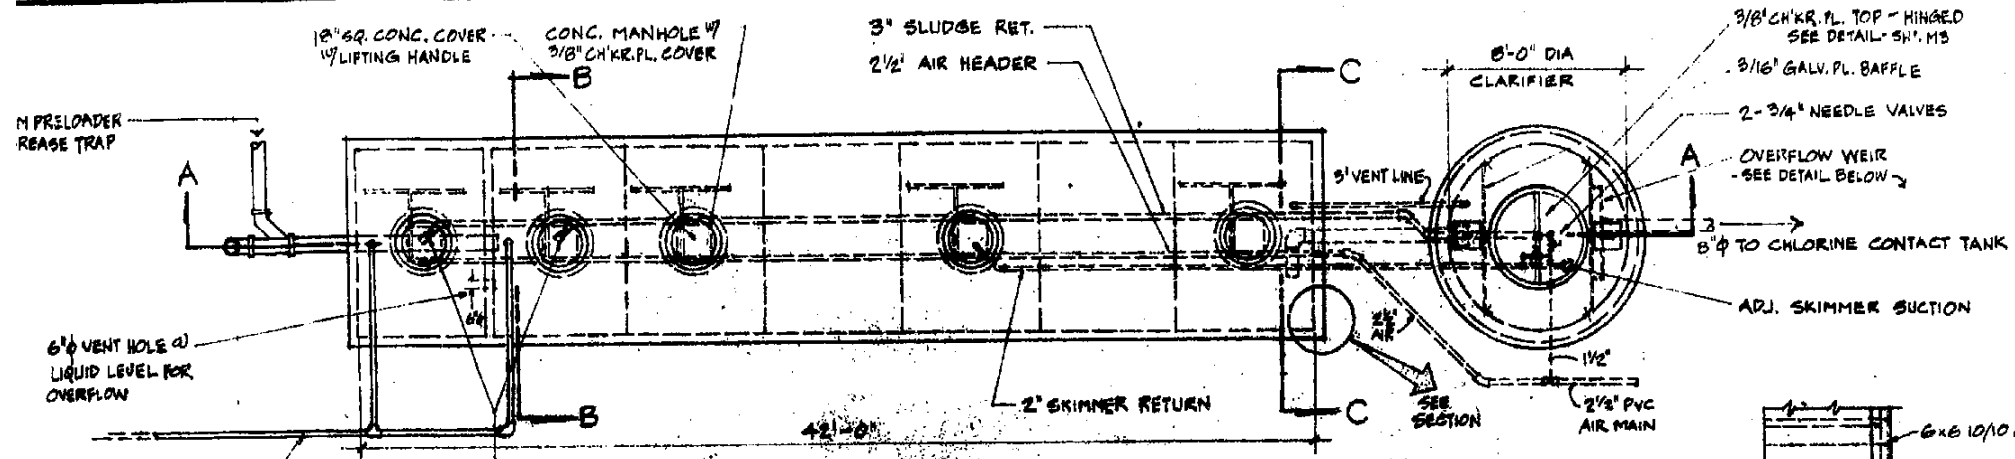


PLAN
1/4" = 1'-0"

NOTE:
ALL INTERNAL PIPING:
SCHEDULE 80 P.V.C.

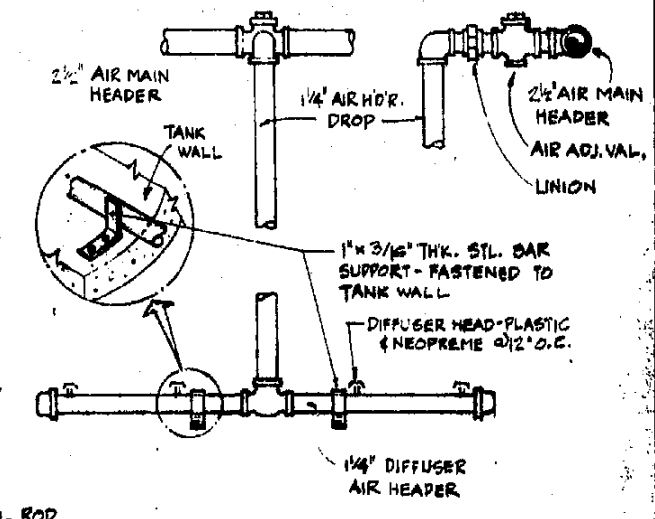


AIR DIFFUSER DETAIL
N.T.S.

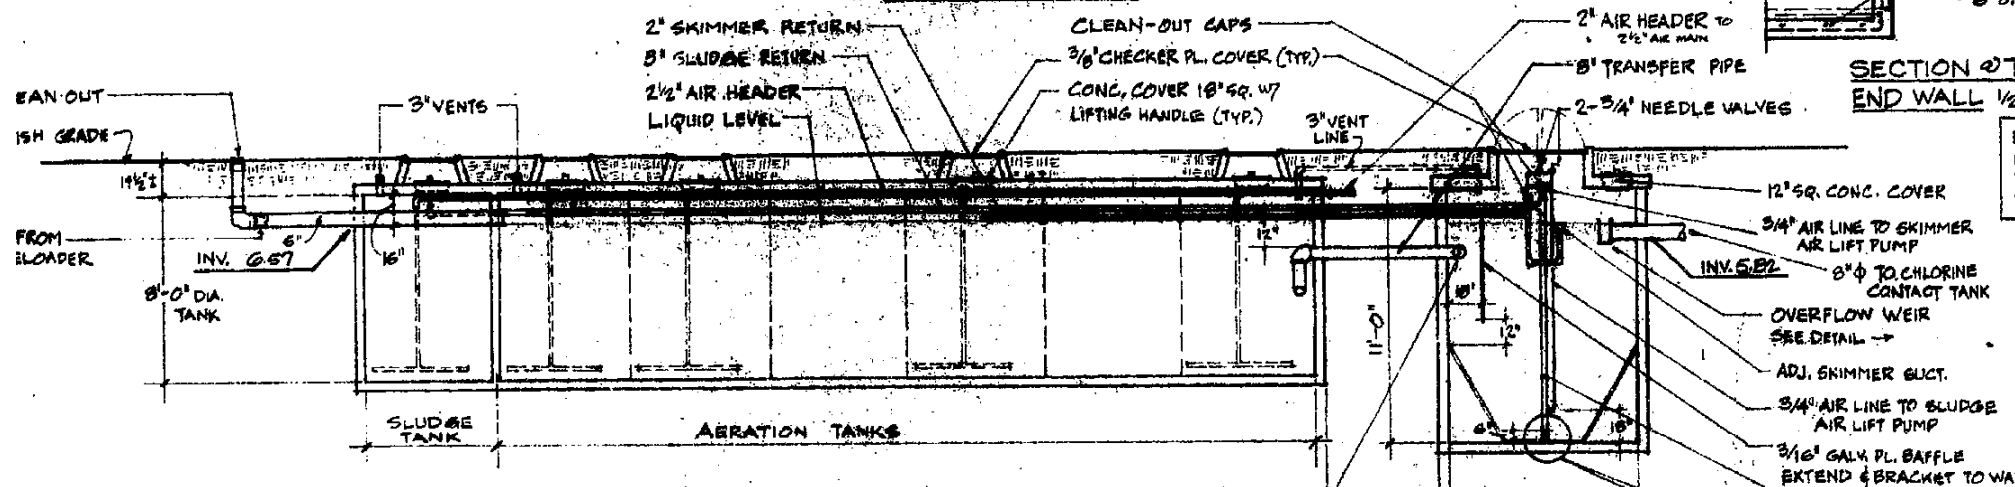


SECTION A-A
1/4" = 1'-0"

NOTE: THIS METHOD OF REINFORCING IS TYPICAL FOR ALL TANKS. TANKS ARE STRUCTURALLY ADEQUATE FOR DEPTH OF BURY SHOWN.

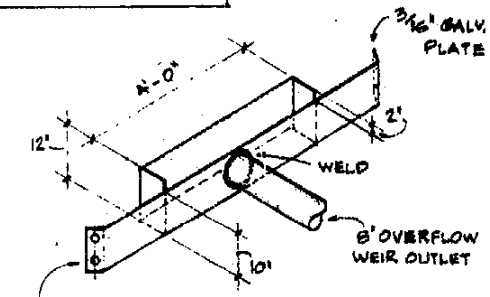


OVERFLOW WEIR DETAIL
N.T.S.

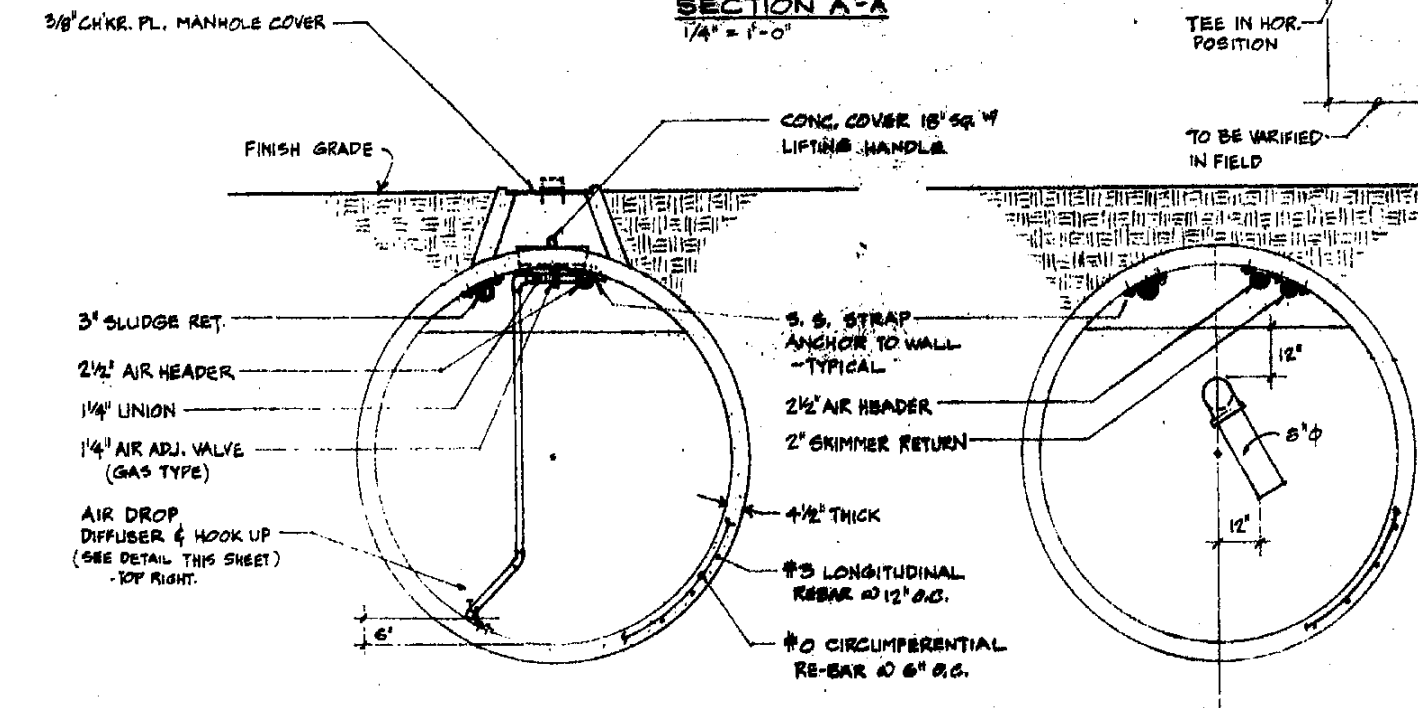


SECTION B-B
1/2" = 1'-0"

SECTION C-C
1/2" = 1'-0"

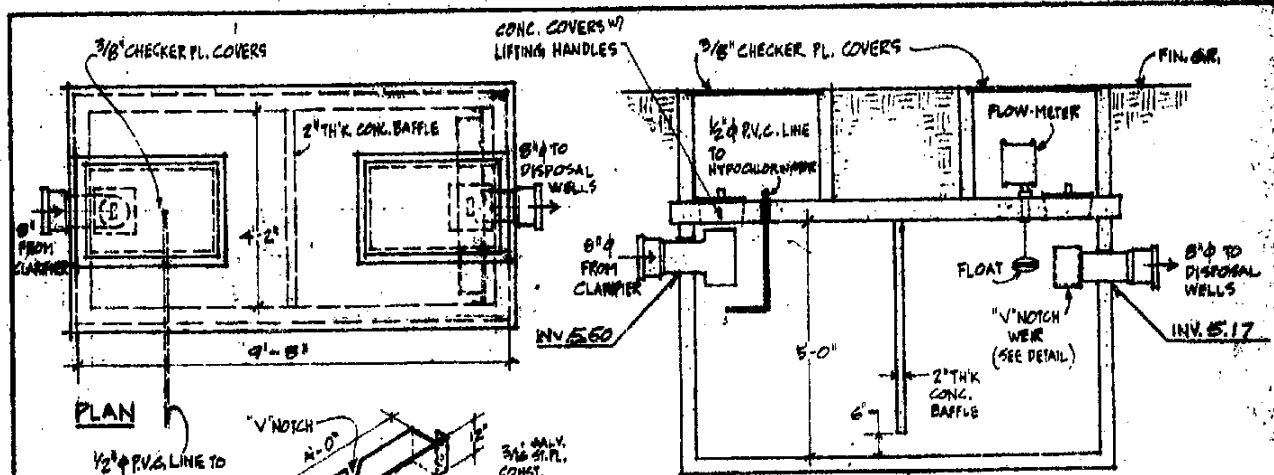

PLAN

SECTION



OVERFLOW WEIR DETAIL
N.T.S.

1 **SLUDGE, AERATION & CLARIFIER TANK**
SCALE VARIES, SEE ABOVE

2 **CHLORINATOR TANK w/ FLOW-METER**
1/2" = 1'-0"

APPROVED BY _____
FOR CHIEF OF DIV. OF SEWERS DATE _____

3222 KALANIANA'OLE AVE., SUITE 701
 HONOLULU, HAWAII 96818
 TELEPHONE: 923-5777
 WEITKAMP, CRANE, LTD.
 ENGINEERS, ARCHITECTS & PLANNERS
 710
 THE "OND VISTA" A
 64 UNIT CONDOMINIUM
 FOR
 OND VISTA EAST &
 OND VISTA WEST
 A-SUBMIT VENTILES
 SHEET TITLE
 SEWAGE TREATMENT
 PLANT DETAILS
 DATE: 5 JULY 79
 JOB NO. 1907.C
 M2
 OF 3 SHEETS

2222 KALAKAUA AVE., SUITE 701
 HONOLULU, HAWAII 96815
 TELEPHONE: 823-5777





WEISBERG - CRANE - LIPP
 ARCHITECTS - P.C.
 T.C.
 T.H.



NO.	DATE	REVISION

THE "ONDO VISTA" A
 4-UNIT CONDOMINIUM
 ONO VISTA - EAST &
 ONO VISTA - WEST
 A JOINT VENTURE

SHEET TITLE
 SEWAGE TREATMENT
 PLANT DETAILS
 DATE: 20 JULY 75
 JOB NO. 78020
 SHEET
MB
 OF 2 SHEETS

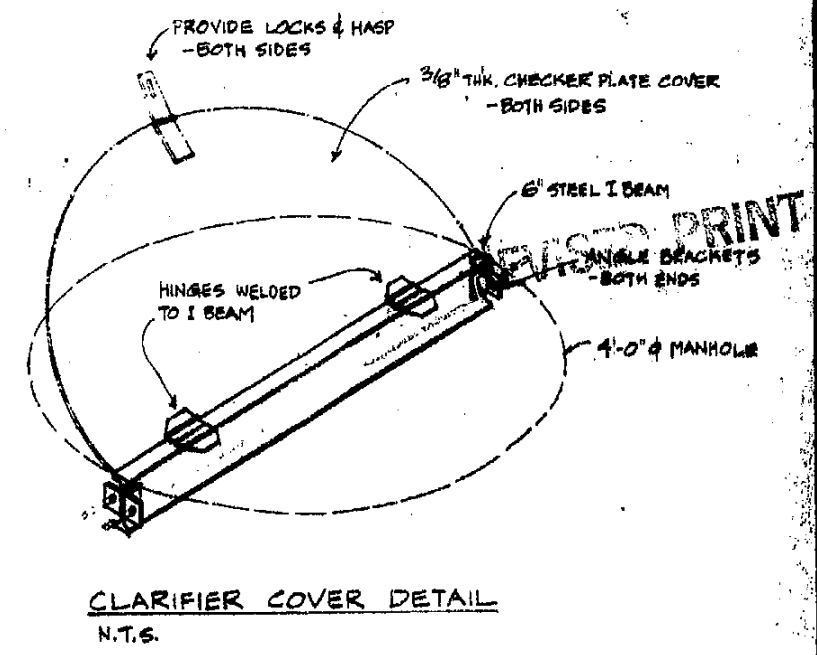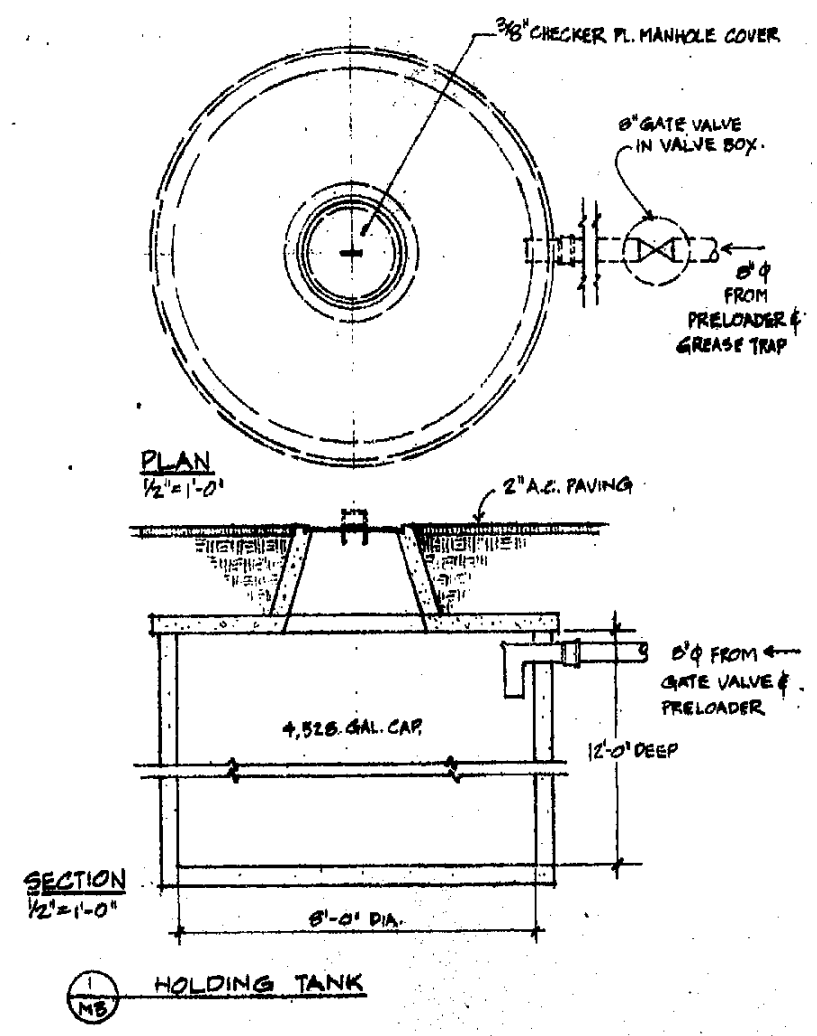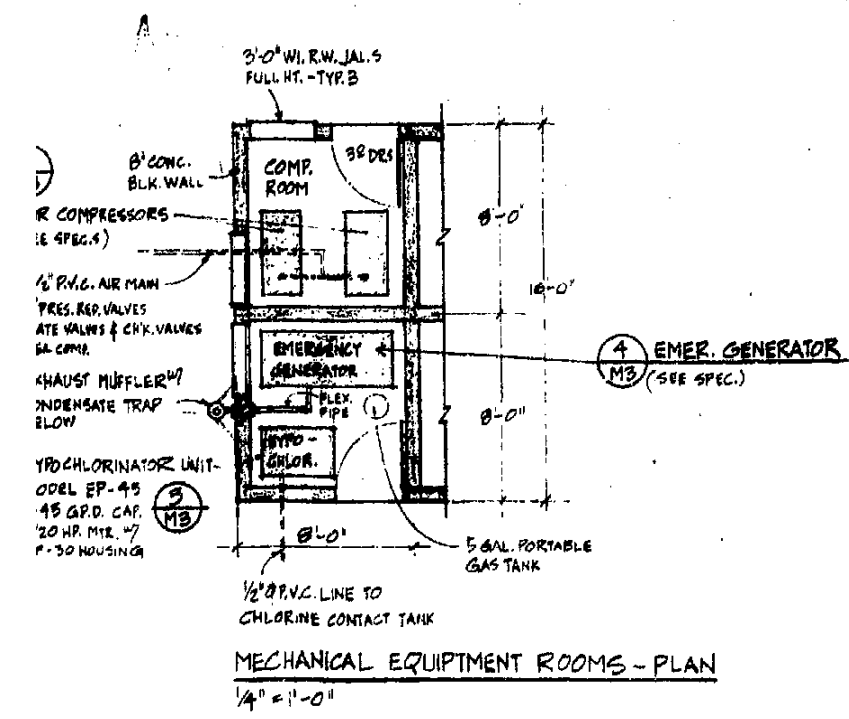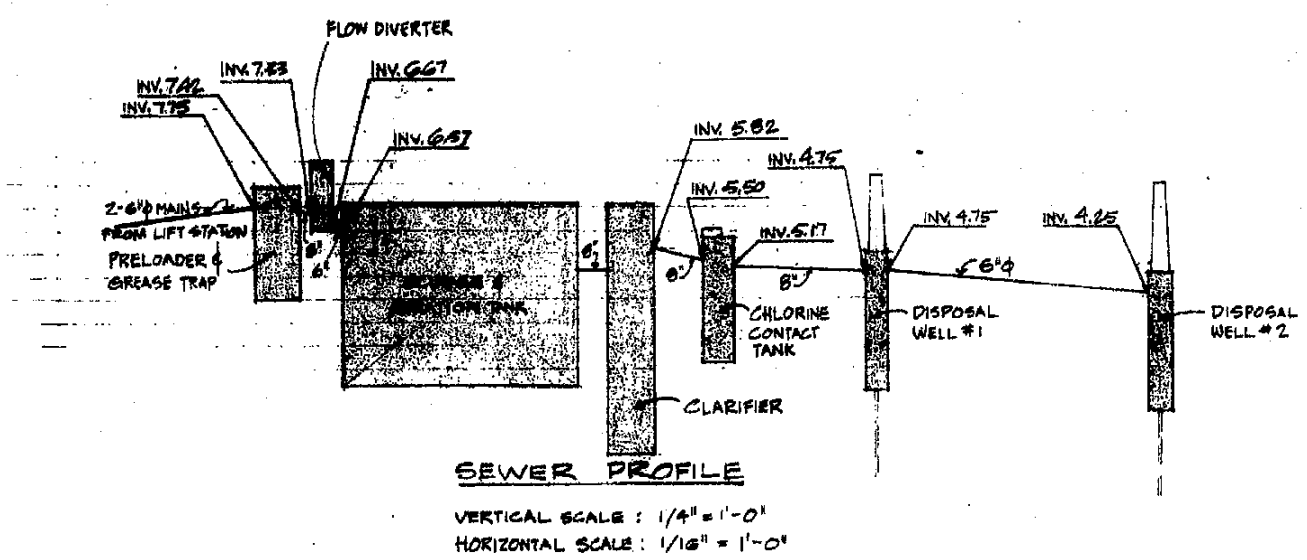

APPROVED BY _____
 FOR CHIEF OF DIV. OF SEWERS DATE _____

BASIS OF DESIGN ENGINEERING REPORT

NEW WASTEWATER TREATMENT PLANT
ONO VISTA CONDOMINIUMS
68-024 APUHIHI STREET, WAIALUA, HI 96791
TMK: (1) 6-8-001:058

Prepared For:

Ono Vista Condominiums
AOAO Board of Directors
c/o Associa Hawai'i
737 Bishop St., Ste 3100
Honolulu, Hawai'i 96813

Prepared By:

LAULEA

ENGINEERING, LLC

1314 S King St., Ste 705
Honolulu, Hawai'i 96814

JUNE 2023

TABLE OF CONTENTS

ACRONYMS, ABBREVIATIONS AND DEFINITIONS	2
1. PROJECT BACKGROUND	3
2. DESIGN CRITERIA	3
3. GENERAL WASTEWATER TREATMENT WORKS DESCRIPTION	3
3.1 Existing Wetwell	3
3.2 Preloader / Equalization Tank	4
3.3 Treatment System: Kubota Johkasou™ Multi Stage Fixed BioFilm System	4
3.4 Utility Enclosure and WWTW Perimeter Fencing/Wall	5
3.5 Sludge Holding Tank	5
3.6 Electromagnetic Flowmeter	5
4. PROCESS PARAMETERS	6
4.1 Process Mass Balance	7
5. ELECTRICAL AND EMERGENCY POWER	7
6. UV DISINFECTION	7
7. EXISTING WASTEWATER EFFLUENT DISPOSAL AND SAMPLING	9
8. SCUM, FOG DISPOSAL & SLUDGE MANAGEMENT PLAN	9
9. CONTROLS AND INSTRUMENTATION	9
10. OPERATION AND MAINTENANCE	9
11. ESTIMATED PROCUREMENT AND CONSTRUCTION SCHEDULE	10
12. ESTIMATED EQUIPMENT PROCUREMENT ROM COSTS	10
13. REFERENCES	10

ATTACHMENTS

Attachment A-Preliminary Design Plans

Attachment B- Kubota Technologies: Johkasou™ Multistage Biofilm System Preliminary Design/Equipment Summary

Attachment C- Flowmeter Specifications and Details

Attachment D- UV System Specifications and Details

Attachment E- Influent Laboratory Report

Attachment F- BWS Billing and Consumption Data

Acronyms, Abbreviations, and Definitions

BOD5	Biochemical Oxygen Demand, 5-day
COD	Chemical Oxygen Demand
COTG	Clean-Out to Grade
DLIR	State of Hawai'i Department of Labor and Industrial Relations
DOH WWB	State of Hawai'i Department of Health Wastewater Branch
DOH SDWB	State of Hawai'i Department of Health Safe Drinking Water Branch
EPA	United States Environmental Protection Agency
F/M	Food to microorganism ratio
FOG	Fats, Oils, and/or Grease
ft ²	Square foot or square feet
GI	Grease Interceptor
gpd	Gallon per day
HAR 11-62	Hawai'i Administrative Rules Title 11 Chapter 62
HIOSH	Hawai'i Occupational Safety and Health
L	Liter
lb	Pounds
mg	Milligrams
mpi	Minutes per inch
MSL	Mean Sea Level
OSHA	Occupational Safety and Health Administration
Owner	Subject property owner, which may be Owner(s), Trustee(s), Executor(s), etc.
pH	Potential of hydrogen; quantitative measure of the acidity or alkalinity of a solution
TMK	Tax Map Key
WWTW	Wastewater Treatment Works

1. PROJECT BACKGROUND

The project involves property with the following information:

Tax Map Keys (“TMK”): (1) 6-8-001:058
 Project Address: 68-90 Au Street, Waiialua, HI 96791
 Total Land Area: 1.2 acres
 Property Class: Condo Master

Ono Vista Condominiums is situated in Waiialua on the northern coast of the island of Oahu. The real estate is bordered by residential properties on both north and south ends with Au Street to the east and Apuhihi Street to the east. Running north to south, adjacent to the streets, two buildings were built in 1975. There are forth-eight units that are two-bedrooms and sixteen units that are one-bedrooms for a total of 112 total bedrooms with direct sources of wastewater. There is a recreation building, which includes two restrooms, a sink and shower area, is centrally located on the property. Adjacent to the recreation building is a pool with hours of operation 7am to 10pm. There is no staff assigned to the pool. Approximately 20 patrons use the pool a day.

The current WWTW is beyond the typical service life of 40 years.

The injection wells are limited in capacity and operators have resorted to contracting a pumping company to haul wastewater offsite multiple times a week. The existing wastewater system receives influent from 6-inch sewer laterals from each building. A lift station pumps the raw wastewater to a grease trap/pre-loader then flows into a sludge and aeration tank. The clarifiers follows then subsequently the chlorinator before discharging into three injection wells in the east parking lot.

This project will replace the temporary WWTW with a new, larger and robust, permanent WWTW. The new WWTW will discharge treated effluent into the existing three injection wells after it has been modified by overdrilling to remove most of the plugging and injection use over the years. One well will have the capacity for total daily flow, second well will be 100% back-up leaving the final well for redundancy.

2. DESIGN CRITERIA

The daily average design flow is calculated in the table below:

Tenant	Units	GPD/bedroom	Total GPD
Condominium Bedroom Units*	112	200	22,400
Grand Total			22,400

*See as-builts for basis of design

Based on the table above an average design flow of 22,400 gpd was calculated. The owners of Ono Vista Condominiums have decided to purchase a wastewater treatment system to have a peak flow capacity of **35,000 gpd for a 1.5 factor of safety**. Influent BOD5 and TSS

concentrations are assumed at 300 mg/l, while legal effluent limitations for disposal are set at 60 mg/l [HAR 11-62-26(b)(1)(D) & HAR 11-62-26(b)(2)(D)].

3. GENERAL WASTEWATER TREATMENT SYSTEM DESCRIPTION

The proposed wastewater treatment system will consist of the following:

- Existing Wet Well/Lift Station
- Preloader/Equalization Basin
- Primary Treatment Tank/System
 - Integrated Clarifier Tank
 - Integrated Sludge Holding Tank
 - Electromagnetic Flowmeter
- UV Disinfection System
- Multiple Injection Well Disposal System (One (1) Primary and one (1) 100% Backup Well and a third Well for Redundancy)

3.1 Existing Wet Well/Lift Station

The sewer lateral from the condominium conveys the domestic wastewater to an existing 6' diameter wet well which is equipped with dual submersible lift pumps that operate at 3 phase 208 volts power from a branch circuit from the existing wastewater treatment plant electrical power. The pumps will convey the wastewater via force main to the new equalization basin.

3.2 Preloader/Equalization tank

The new preloader/equalization tank will be a 8,000 gallon two-compartment FRP tank with dual submersible pumps. The first compartment of the tank will act as a preloader where sediment/solids will settle and the second compartment will act as an equalization basin for flow equalization. The wastewater will then be pumped directly to the Kubota Technologies Johkasou System.

3.3 Treatment System: Kubota Johkasou Package Treatment System

By immersing membrane cartridges in an activated sludge basin, MBRs combine membrane technology with the biological process. High-standard treatment is completed in a single basin, replacing the traditional clarifier and filters required for tertiary treatment. Microorganisms are captured by the membranes' pore apertures, which range from 0.01 to 0.1 microns, lowering their concentration in the effluent. MBRs typically operate with longer sludge ages and higher mixed liquor suspended solids (MLSS) concentrations. The design parameters for the MBR, the manufacturer's technical quotation, and an EPA bulletin that goes into more depth about the procedure are all found in Appendix XX.

Kubota's membrane sheet is made from chlorinated polyethylene, has an average pore size of 0.2 micron (maximum 0.4 micron), is much thicker than other membranes to provide long-lasting durability, and features high porosity to enable high flow. This pore size has been designed as the optimum balance between water quality and quantity. Kubota's membrane sheet has Title 22 approval for water reuse in California.

The Kubota treatment system does meet the requirements of the DOH-WWB HAR 11-62, Subchapter 2 WWTW. Effluent from the Kubota will be treated to a maximum of 30 mg/L in BOD5 concentration and 30 mg/L in Suspended Solids.

3.4 Utility Enclosure and WWTW Perimeter Fencing/Wall

The proposed location for the new emergency generator, primary/standby blowers and WWTW control panels. A utility enclosure may be necessary should all components of the new generator, blowers, and control panel not fit within the back room of the existing pool house. The existing pool house is a non-occupied structure. Per the HAR, Title 11, Chapter 46, Community Noise Control Document, a 50 dBA noise level is to be met at the neighboring property lines. The noise generating equipment (i.e., blowers and pumps) will therefore all be housed in the utility enclosure. The blowers will be installed inside the room with individual sound enclosures reduce the noise level.

The existing wooden picket fence painted brown approximately 6 feet high with a locking access door will be retained and reinstalled around the perimeter of the WWTW tanks to limit public access.

3.5 Sludge Holding Tank

The existing wet well and preloader will continue to separate inorganics as well as solids from the process flow. It is recommended that the wet well and sludge holding tank, mentioned in the below paragraph, are pumped on regular recurring schedules.

The Kubota WWTW will include a sludge holding tank at the end of the multi-stage process to store the sludge holding capacity to an almost two-week retention time. Fine bubble aeration will be used to aerate the sludge tank. Close monitoring of the clarifier capacity will be necessary for the first few months. After monitoring steady state conditions, the operator will be able to provide an accurate estimated frequency/schedule to when the clarifier and wet well need to be pumped.

3.6 Electromagnetic Flowmeter

The new WWTW will reutilize the existing flowmeter used for the Temporary WWTW. The existing flowmeter is a MagFlux® 7200 Sensor 3" ANSI/150 psi w/Display. See Attachment C for the Flowmeter Specification and Details.


4. PROCESS PARAMETERS

The new wastewater treatment works design BOD5 and TSS loading is based on reasonable loading for residential sewage. The wastewater will be of residential strength and is expected to contain relatively low levels of fat, oils and grease due to the nature of the wastewater sources (residential).

WWTW Design Daily Flow	=	22,400 gallons/day
Design Influent BOD5 Concentration	=	300 mg/L
Design Influent TSS Concentration	=	300 mg/L
Wetwell/Trash Tank diameter	=	6 feet (<i>Existing</i>)
Tank 1 (1 st EQ Tank)	=	24.1 feet
Tank 2 (2 nd EQ Tank + Sludge Holding Tank)	=	24.1 feet
Tank 3 (Anoxic)	=	20.7 feet
Tank 4 (MBR Tank + Disinfection & Effluent Tank)	=	24.6 feet
Treatment System Length	=	93.5 feet
Tank 1 Dimensions	=	24.1'L x 8.2'W x 10.2'H
Tank 1 Operating Volume	=	6,725 gallons
Tank 2 Dimensions	=	24.1'L x 8.2'W x 10.2'H
Tank 2 Operating Volume	=	6,725 gallons
Tank 3 Dimensions	=	20.7'L x 8.2'W x 10.2'H
Tank 3 Operating Volume	=	5,950 gallons
Tank 4 Dimensions	=	24.6'L x 8.2'W x 10.2'H
Tank 4 Operating Volume	=	8,100 gallons
Daily Sludge Generation	=	43 lbs/day
Sludge Holding Capacity	=	1,550 gallons
Sludge Retention Time	=	5 days
Effluent BOD5 Concentration	=	<30 mg/L
Effluent TSS Concentration	=	<30 mg/L

4.1. Process Mass Balance

Design Flow = 22,400 gpd

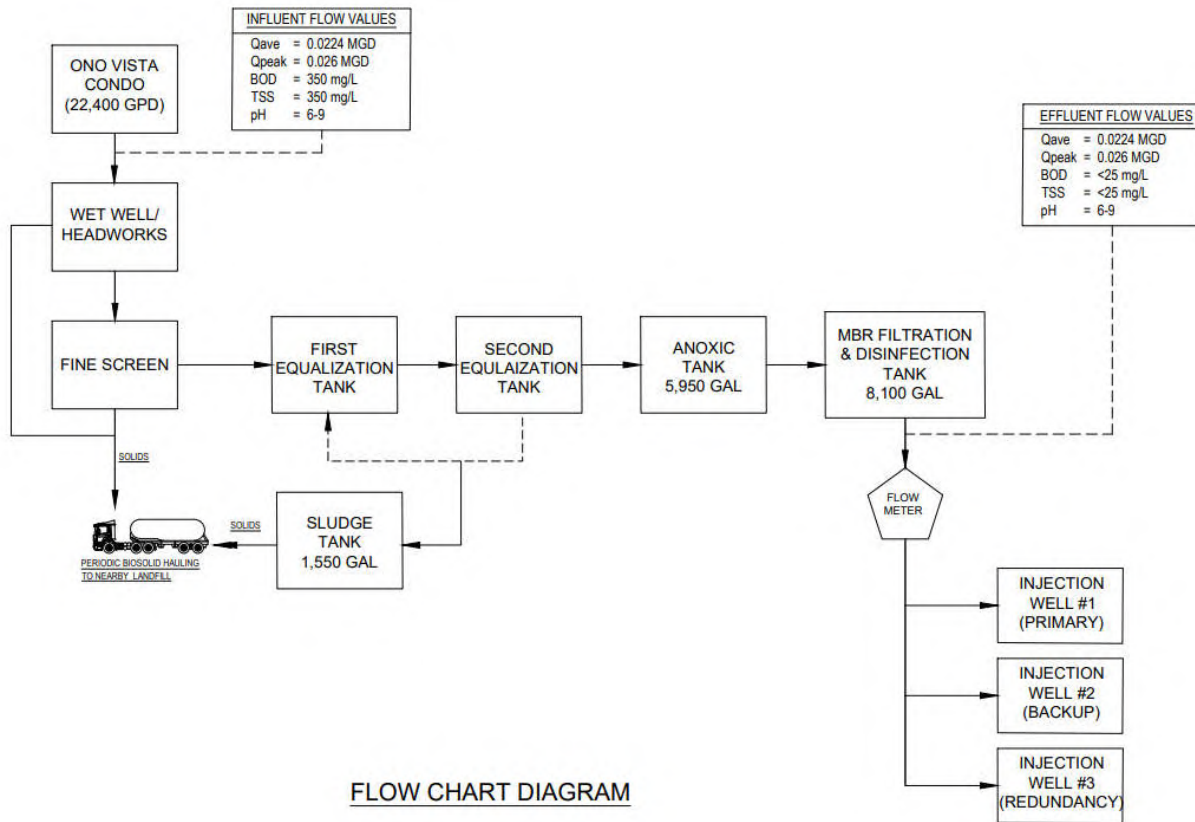

FLOW CHART DIAGRAM

Figure 4.1- Process Flow Diagram (Hydraulic Loading and Organic Capacities Shown)

The wet well/trash tank is assumed to perform negligible treatment. Total after Johkasou:

- % BOD5 Reduction from WWTW = 90%
- % TSS Reduction from WWTW = 90%

5. ELECTRICAL AND EMERGENCY POWER

Electrical service will be provided by Hawaiian Electric Company (HECO) through a branch circuit from the Ono Vista building circuit. The electrical components of the new WWTW will be connected to the existing on-site 208 volts 3-phase electrical lines.

Emergency power will be provided by a diesel generator or equivalent equipment. The new generator will draw its fuel from a separate fuel tank. The new generator will provide backup power to the WWTW blowers, and existing Wet Well/Lift Station.

6. UV DISINFECTION

Disinfection processes selectively kill pathogens or render them incapable of reproduction or harm to humans. Disinfection at WWTWs is employed for the purposes of protection of public health, reduction of organic matter, inorganics, nutrients, odor, aesthetics, and maintaining waste-assimilative capacity of receiving water bodies. The protection of public health through the control of disease-causing microorganisms is the primary reason for wastewater disinfection (WEF, 1996). As the last barrier of protection from pathogenic organisms, disinfection at WWTWs is an important process. To address this, we will utilize a *UV disinfection* system that is recommended to integrate within the last tank.

Spare materials to include UV lamps, quartz sleeves, O-rings, cleaning solutions and operator's kit will be provided for the owner. See Attachment D for UV System Specification and Details.

7. EXISTING WASTEWATER EFFLUENT DISPOSAL AND SAMPLING

There are three (3) existing Injection Wells (IW), which receive wastewater effluent, treated by the wastewater treatment plant, for disposal.

Following the new UV disinfection system, the effluent gravity flows into the injection wells. Under UIC permit number UO-1305, each injection well is a 4-inch diameter shallow injection well (approximately 29 to 50 feet deep) that operates under gravity head. In the event of pump failure, an overflow pipe connects the contact chamber to IW-2. An overflow pipe connects IW-2 to IW-3. The average design flow rate for the system is 22,400 gpd and historical flow rates varying between 10,000 to 15,000 gpd.

7.1 INJECTION WELL MODIFICATION

The condo association needs to re-drill their existing three injection wells because of low performance. Modify the existing injection wells to increase their performance includes re-drilling at a larger diameter than the existing 4-inch.

8. SCUM, FOG AND SLUDGE MANAGEMENT PLAN

Sludge, scum, FOG, and rubbish from the Wet Well/Lift Station and Kubota WWTW will be vacuumed and trucked to nearby disposal facilities on a bi-weekly schedule.

Ono Vista AOA will contract local pumper companies to extract and haul away sludge from the sludge holding tank to the nearest municipal wastewater treatment plant retention availability yet to be determined.

9. CONTROLS AND INSTRUMENTATION

The Kubota supplier shall furnish a control system. The system shall include local control stations, motor starters, control switches, relays, and pilot lights. Control Panels shall be free standing, NEMA 4 enclosures. The panels shall be UL approved. Mounting pad and stand shall be the responsibility of the Installing Contractor. Motor starters shall be 208V/3Ph/60Hz power shall be provided.

10. OPERATIONS AND MAINTENANCE (O&M)

O&M and electronic O&M manuals shall be furnished during start-up. The manuals shall include installation, operation and maintenance instructions for all equipment provided. For WWTW startup, field personnel from Kubota will perform a functional check of each item furnished and start-up of the process. During this time, the field representative will provide operation training, which shall include familiarization with the MBR process, and review of the O&M manuals. The Johkasou supplier to assist with the start-up process.

11. ESTIMATED PROCUREMENT AND CONSTRUCTION SCHEDULE

- Equipment Procurement (*Estimated 8 months*)
 - Kubota System and Utility Enclosure
- Mobilization of General Contractor (1 month)
- WWTW Construction (*Estimated 8 months*)
 - Three (3) Phases:
 - Installation of temporary WWT system, Demolition of Existing WWTW
 - Over-excavate, fill, concrete pad for WWTW, utility building, UV system and generator, install steel tank, electrical conduits/wiring, fencing, trenching, UV install, etc...
 - Seeding of newly installed WWTW, commissioning of new system
- DOH Approval to Operate (2 months)
- Removal of temporary WWTW and installation of Emergency Generator (2-3 months)

12. ESTIMATED EQUIPMENT PROCUREMENT ROM COSTS

- Kubota Johkasou Package Treatment System (approx. \$635,000)
- Utility Enclosure (*pending*)
- Kubota Equipment Startup (*pending*)
- Kubota Freight (approx. \$60,000)
- Emergency Generator (approx. \$36,000)
- UV Disinfection System (*pending*)
- Electromagnetic Flowmeter (*pending*)

Note: excludes construction costs and additional design/permitting fees

13. REFERENCES

"Hawai'i Administrative Rules", Department of Health, Chapter 62 of Title 11, Wastewater Systems, State of Hawai'i, dated March 21, 2016 (hereafter called "HAR 11-62").



"Onsite Wastewater Treatment Systems Manual", Office of Water, Office of Research and Development, U.S. Environmental Protection Agency, dated February 2002 (hereafter called "EPA OWTSM").

ATTACHMENTS

Attachment A- Preliminary Design Plans

ONO VISTA WWTP REPLACEMENT

PROJECT LOCATION:
 WAIALUA, OAHU
 TMK: (1) 6-8-011:058

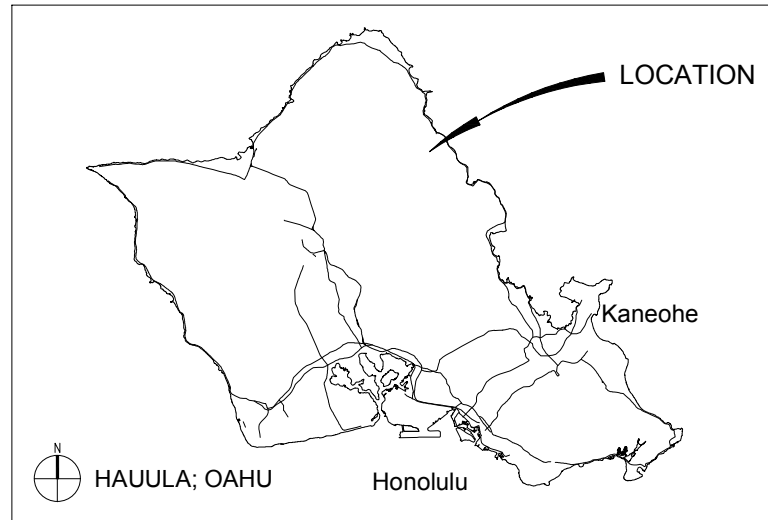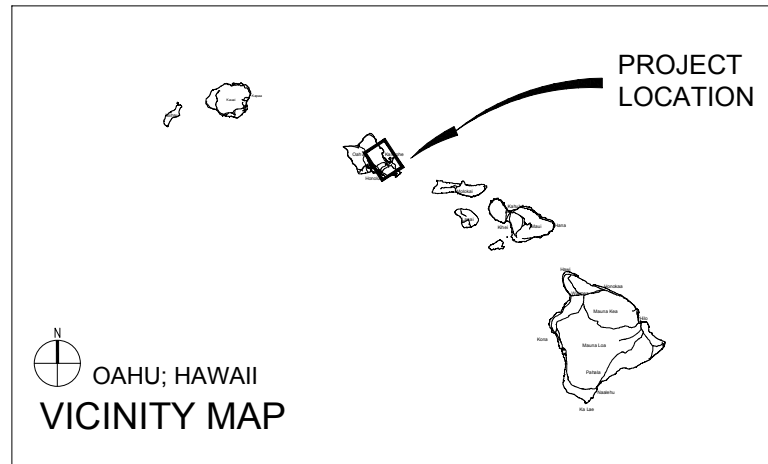

LOCATION MAP

Drawing Index

T-001	TITLE SHEET
T-002	GENERAL NOTES
C-100	GENERAL SITE PLAN
C-101	WWTP SITE LAYOUT PLAN
C-102	INJECTION WELL SITE LAYOUT PLAN
C-202	EROSION AND SEDIMENT CONTROL PLAN
C-411	WWTP ELEVATION VIEW

PREPARED FOR:
 ONO VISTA CONDINIUM
 68-242 APUHIHI STREET
 WAIALUA, OAHU, HI 96791

PREPARED BY:
 LAULEA ENGINEERING, LLC.
 1314 S. KING STREET, STE 705
 HONOLULU, HI 96814



Revision Number/ Description

Project Name

ONO VISTA WWTP
 REPLACEMENT
 68-242 APUHIHI STREET
 WAIALUA, OAHU, HI 96791
 TMK: (1) 6-8-011:058

Drawing Title

TITLE SHEET

Project Number 22023_22035	Date MARCH 16, 2023
-------------------------------	------------------------

Drawn AC	Checked WW	Designed RD
-------------	---------------	----------------

Drawing Number

T-001

Sheet No. ___ of ___

D

C

Revised October 2014

B

A

CONSTRUCTION NOTES:

- 1. ALL APPLICABLE CONSTRUCTION WORK SHALL BE DONE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, SEPTEMBER 1984, AS AMENDED, OF THE DEPARTMENT OF PUBLIC WORKS, CITY & COUNTY OF HONOLULU AND THE COUNTIES OF KAUAI, NAUI, AND HAWAII.
- 2. VERIFY AND CHECK ALL DIMENSIONS AND DETAILS SHOWN ON THE DRAWINGS PRIOR TO THE START OF CONSTRUCTION. ALL CONFLICTS SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE CONTRACTING OFFICER.
- 3. THE UNDERGROUND PIPES, CABLES OR DUCTING LINES KNOWN TO EXIST BY THE ENGINEER FROM HIS SEARCH OF RECORDS ARE INDICATED ON THE PLANS. THE CONTRACTOR SHALL VERIFY THE LOCATIONS AND DEPTHS OF THE FACILITIES AND EXERCISE PROPER CARE IN EXCAVATING IN THE AREA, WHEREVER CONNECTIONS OF NEW UTILITIES TO EXISTING UTILITIES ARE SHOWN ON THE PLANS. THE CONTRACTOR SHALL EXPOSE THE EXISTING LINES AT THE PROPOSED CONNECTIONS TO VERIFY THEIR LOCATIONS AND DEPTHS PRIOR TO EXCAVATION FOR THE NEW LINES.
- 4. NO CONTRACTOR SHALL PERFORM ANY CONSTRUCTION OPERATION AS TO CAUSE FALLING ROCKS, SOIL OR DEBRIS IN ANY FORM TO FALL, SLIDE OR FLOW INTO EXISTING CITY OR STATE DRAINAGE SYSTEMS, OR ADJOINING PROPERTIES, STREETS OR NATURAL WATERCOURSES. SHOULD SUCH VIOLATIONS OCCUR, THE CONTRACTOR MAY BE CITED AND THE CONTRACTOR SHALL IMMEDIATELY MAKE ALL REMEDIAL ACTIONS NECESSARY.
- 5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFORMANCE WITH THE APPLICABLE PROVISIONS OF THE WATER QUALITY AND WATER POLLUTION CONTROL STANDARDS CONTAINED IN HAWAII ADMINISTRATIVE RULES, TITLE 11, CHAPTER 55, "WATER POLLUTION CONTROL", AS WELL AS CHAPTER 14 OF THE REVERSED ORDINANCES OF HONOLULU, AS AMENDED, BEST MANAGEMENT PRACTICES SHALL BE EMPLOYED AT ALL TIMES DURING CONSTRUCTION.
- 6. CONFINED SPACE
FOR ENTRY BY STATE PERSONNEL, INCLUDING INSPECTORS AND REPRESENTATIVES, INTO A PERMIT REQUIRED CONFINED SPACE AS DEFINED IN 29 CFR PART 1910.146(B), THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROVIDING:
 - I. ALL SAFETY EQUIPMENT REQUIRED BY THE CONFINED SPACE REGULATIONS APPLICABLE TO ALL PARTIES OTHER THAN THE CONSTRUCTION INDUSTRY, TO INCLUDE, BUT NOT LIMITED TO, THE FOLLOWING:
 - a. FULL BODY HARNESSSES FOR UP TO TWO PERSONNEL
 - b. LIFELINE AND ASSOCIATED CLIPS
 - c. INGRESS/EGRESS AND FULL PROTECTION EQUIPMENT
 - d. TWO-WAY RADIOS (WALKIE-TALKIES) IF OUT OF LINE-OF-SIGHT,
 - e. EMERGENCY (ESCAPE) RESPIRATOR (10 MINUTE DURATION).
 - f. CELLULAR TELEPHONE TO CALL FOR EMERGENCY ASSISTANCE.
 - g. CONTINUOUS GAS DETECTOR (CALIBRATED) TO MEASURE OXYGEN, HYDROGEN SULFIDE, CARBON MONOXIDE AND FLAMMABLES (CAPABLE OF MONITORING AT A DISTANCE AT LEAST 20 FEET AWAY).
 - h. PERSONAL MULTI-GAS DETECTOR TO BE CARRIED BY INSPECTOR.
 - II. CONTINUOUS FORCED AIR VENTILATION ADEQUATE TO PROVIDE SAFE ENTRY CONDITIONS.
 - III. ONE ATTENDANT/RESCUE PERSONNEL TOPSIDE (TWO, IF CONDITIONS WARRANT IT).
 - IV. ALL SAFETY EQUIPMENT SHALL COMPLY WITH THE STANDARDS OF THE OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION AND ALL APPLICABLE FEDERAL, STATE, AND CITY LAWS AND REGULATIONS RELATING TO SAFETY.
- 8. ALL EXISTING UTILITIES TO REMAIN IN USE, WHETHER OR NOT SHOWN ON THE PLANS BY THE CONTRACTOR DURING CONSTRUCTION. ALL DAMAGES TO EXISTING UTILITIES SHALL BE REPAIRED AND PAID FOR BY THE CONTRACTOR.
- 9. WHEN TRENCH EXCAVATION IS CLOSE TO OR UNDER EXISTING STRUCTURES OR FACILITIES, THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROPERLY SHEETING, SHORING AND BRACING THE EXCAVATION AND STABILIZING THE EXISTING GROUND TO RENDER IT SAFE AND SECURE FROM POSSIBLE SLIDES, CAVE-INS AND SETTLEMENT AND FOR PROPERLY SUPPORTING EXISTING STRUCTURES AND FACILITIES WITH BEAMS, STRUTS OR UNDER-PINNING TO FULLY PROTECT THEM FROM DAMAGE.
- 10. THE CONTRACTOR SHALL RESTORE TO THEIR ORIGINAL CONDITION OR BETTER, ALL IMPROVEMENTS DAMAGED AS A RESULT OF THE CONSTRUCTION, INCLUDING PAVEMENTS, EMBANKMENTS, CURBS, SIGNS, LANDSCAPING, STRUCTURES, UTILITIES, WALLS, FENCES, ETC. UNLESS PROVIDED FOR SPECIFICALLY IN THE PROPOSAL. DEMOLITION AND RESTORATION OF EXISTING ITEMS SHALL BE INCIDENTAL AND INCLUDED WITHIN THE AMOUNT PAID FOR UNCLASSIFIED TRENCH EXCAVATION.
- 11. ALL CONCRETE AND A.C. PAVEMENT TO BE TRENCHED OR RECONSTRUCTED SHALL BE SAW-CUT TO THE REQUIRED WIDTH PRIOR TO THE CONSTRUCTION.
- 12. PURSUANT TO CHAPTER 6E, HRS, IN THE EVENT ANY ARTIFACTS OR HUMAN REMAINS ARE UNCOVERED DURING CONSTRUCTION OPERATIONS, THE CONTRACTOR SHALL IMMEDIATELY SUSPEND WORK AND NOTIFY THE HONOLULU POLICE DEPARTMENT AND THE STATE DEPARTMENT OF LAND AND NATURAL RESOURCES-HISTORIC PRESERVATION DIVISION (692-8015). IN ADDITION, FOR NON-CITY PROJECTS, THE CONTRACTOR SHALL INFORM THE CITY DEPARTMENT OF PLANNING PERMITTING, CIVIL ENGINEERING BRANCH.
- 13. THE CONTRACTOR AGREES THAT HE SHALL ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR THE JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THIS PROJECT, INCLUDING THE SAFETY OF ALL PERSONS AND PROPERTY; AND THAT THIS REQUIREMENT SHALL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS; AND THAT THE CONTRACTOR SHALL DEFEND, INDEMNIFY AND HOLD THE OWNER AND ENGINEER HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPT FOR LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF THE OWNER OR ENGINEER.
- 14. THE CONTRACTOR, AT HIS OWN EXPENSE, SHALL KEEP THE PROJECT AREA AND SURROUNDING AREA FREE FROM RUBBISH, DUST, NOISE, EROSION, ETC. THE WORK SHALL BE DONE IN CONFORMANCE WITH THE AIR AND WATER POLLUTION CONTROL STANDARDS AND REGULATIONS OF THE STATE DEPARTMENT OF HEALTH.
- 15. THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS FROM APPROPRIATE GOVERNMENT AGENCIES.

SEWER NOTES: (PRIVATE)

- 1. ALL SEWER CONSTRUCTION SHALL BE PERFORMED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, SEPT. 1985, THE DEPARTMENT OF PUBLIC WORKS STANDARD DETAILS, SEPT. 1984, CURRENT CITY PRACTICES AND REVISE ORDINANCES OF HONOLULU, 1990 AS AMENDED, AND THE DESIGN STANDARDS OF THE DEPARTMENT OF WASTEWATER MANAGEMENT VOL. 1, JULY 1980. CRUSHED ROCK CRADLE IS PERMITTED WHERE SOIL IS STABLE. IN AREAS OF UNSTABLE SOIL, THE DESIGNER OF RECORD AND THE CONTRACTING OFFICER WILL DETERMINE THE PIPE SUPPORT REQUIRED.
- 2. THE UNDERGROUND PIPES, CABLES OR DUCTLINES KNOWN TO EXIST BY THE ENGINEER FROM HIS RESEARCH OF RECORDS ARE INDICATED ON THE PLANS. THE CONTRACTOR SHALL VERIFY THE LOCATION AND DEPTH OF THE FACILITIES, INCLUDING AND AFFECTING SEWER LINES, IN THE PRESENCE OF THE WASTEWATER INSPECTOR AND EXERCISE PROPER CARE IN EXCAVATING THE AREA. THE CONTRACTOR SHALL BE RESPONSIBLE AND SHALL PAY FOR ALL DAMAGED UTILITIES.
- 3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING CONTINUOUS SEWER SERVICE TO ALL AFFECTED AREAS DURING CONSTRUCTION.
- 4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CLEAN UP OF ANY SEWAGE SPILLS CAUSED DURING CONSTRUCTION. THE CONTRACTOR SHALL NOTIFY THE CONTRACTING OFFICER AND STATE DEPARTMENT OF HEALTH AND UTILIZE APPROPRIATE SAMPLING AND ANALYZING PROCEDURES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PUBLIC NOTIFICATIONS AND PRESS RELEASES.
- 5. THE CONTRACTOR SHALL INSTALL "RAINSTOPPER" MANHOLE INSERTS IN ALL NEW SEWER MANHOLES WITH TYPE "SA" FRAME AND COVER.
- 6. GEOTEXTILE FABRIC SHALL ENVELOP THE PIPE CRADLE AND PIPE FOR ALL SEWER LINES.

PUBLIC HEALTH, SAFETY AND CONVENIENCE NOTES

- 1. THE CONTRACTOR SHALL OBSERVE AND COMPLY WITH ALL FEDERAL, STATE, AND LOCAL LAWS REQUIRED FOR THE PROTECTION OF THE PUBLIC HEALTH AND SAFETY AND ENVIRONMENTAL QUALITY.
- 2. THE CONTRACTOR, AT HIS OWN EXPENSE SHALL KEEP THE PROJECT AND ITS SURROUNDING AREAS FREEFROM DUST NUISANCE. THE WORK SHALL BE IN CONFORMANCE WITH THE AIR POLLUTION CONTROL STANDARDS AND REGULATIONS OF THE STATE DEPARTMENT OF HEALTH. THE CITY MAY REQUIRE SUPPLEMENTARY MEASURES AS NECESSARY.
- 3. NO CONTRACTOR SHALL PERFORM ANY CONSTRUCTION ACTIVITY SO AS TO CAUSE FALLING ROCK, SOIL OR DEBRIS IN ANY FORM TO FALL, SLIDE OR FLOW ONTO ADJOINING PROPERTIES, STREETS OR NATURAL WATERCOURSES. SHOULD SUCH VIOLATIONS OCCUR, THE CONTRACTOR SHALL IMMEDIATELY MAKE ALL REMEDIAL ACTIONS NECESSARY.
- 4. THE CONTRACTOR SHALL PROVIDE, INSTALL AND MAINTAIN ALL NECESSARY SIGNS, LIGHTS, FLARES, BARRICADES, MARKERS, CONES AND OTHER PROTECTIVE FACILITIES AND SHALL TAKE ALL NECESSARY PRECAUTIONS FOR THE PROTECTION, CONVENIENCE AND SAFETY OF THE PUBLIC. THE CONTRACTOR SHALL APPLY FOR A CONSTRUCTION PERMIT WITH A NOISE POLLUTION CONTROL PLAN IF NECESSARY.

EXCAVATION NOTES

- 1. PRIOR TO EXCAVATION, THE CONTRACTOR SHALL CONTACT HAWAII ONE CALL FOR VERIFICATION OF UNDERGROUND LINES. THE CONTRACTOR SHALL CALL THE HAWAII ONE CALL CENTER AT 866-423-7287 MINIMUM OF TEN (10) WORKING DAYS IN ADVANCE.

EROSION CONTROL AND BMP NOTES:

- 1. MEASURES TO CONTROL EROSION AND OTHER POLLUTANTS SHALL BE IN PLACE BEFORE ANY DEMOLITION OR EARTH MOVING WORK IS INITIATED. THESE MEASURES SHALL BE PROPERLY CONSTRUCTED AND MAINTAINED THROUGHOUT THE CONSTRUCTION PERIOD.
- 2. INSTALL PERIMETER PROTECTION (SILT FENCE) AS SHOWN ON THE EROSION CONTROL PLAN.
- 3. CONSTRUCT TEMPORARY STABILIZED CONSTRUCTION ENTRANCE/EXIT AT LOCATIONS SHOWN ON THE EROSION CONTROL PLAN. ALL VEHICLES EXITING THE SITE ARE TO SUFFICIENTLY CLEANED OFF SO THAT DIRT OR DEBRIS IS NOT TRACKED OFF THE CONSTRUCTION SITE.
- 4. LOCATE STOCKPILES, INCLUDING WASTE AND SOIL, AWAY FROM CONCENTRATED DRAINAGE FLOWS, DRAINAGE SWALES AND INLETS. INSTALL PERIMETER PROTECTION (SILT FENCE), BERMS OR TRENCHES AROUND ERODIBLE MATERIAL STOCKPILES.
- 5. ALL EROSION CONTROL MEASURES SHALL BE CHECKED AND REPAIRED AS NECESSARY, FOR EXAMPLE, WEEKLY IN DRY PERIODS AND WITHIN 24-HOURS AFTER ANY RAINFALL OF 0.5 INCHES OR GREATER WITHIN A 24-HOUR PERIOD. DURING PROLONGED RAINFALL, DAILY CHECKING IS NECESSARY. THE CONTRACTOR SHALL MAINTAIN RECORDS OF CHECKS AND REPAIRS.
- 6. IF HEAVY RAINS ARE PREDICTED DURING A WORKDAY, ALL CONTROL MEASURES SHALL BE INSPECTED IMMEDIATELY AND REINFORCED AS NECESSARY.
- 7. CONTRACTOR SHALL REMOVE SEDIMENT FILTERS DURING ABOVE-NORMAL RAINFALL EVENTS AND REPLACE FILTER AFTER THE EVENT HAS PASSED.
- 8. CLEARING AND GRADING SHALL BE HELD TO THE MINIMUM NECESSARY. GRADING SHALL BE SEQUENCED TO MINIMIZE THE EXPOSURE TIME OF THE CLEARED SURFACE AREA.
- 9. DUST CONTROL WITH WATER SPRAY (BY TRUCK OR TEMPORARY SPRINKLERS) SHALL BE APPLIED AS NEEDED. DO NOT OVERWATER.
- 10. A SPECIFIC INDIVIDUAL SHALL BE DESIGNATED TO BE RESPONSIBLE FOR EROSION AND SEDIMENT CONTROLS ON THE PROJECT SITE.
- 11. GOOD HOUSE KEEPING BEST MANAGEMENT PRACTICES:
 - 11.1. MATERIAL MANAGEMENT PRACTICES SHALL BE USED TO REDUCE THE RISK OF SPILLS OR OTHER ACCIDENTAL EXPOSURE OF MATERIALS AND SUBSTANCES TO STORM WATER RUNOFF. AN EFFORT SHALL BE MADE TO STORE ONLY ENOUGH PRODUCT AS IS REQUIRED TO DO THE JOB.
 - 11.2. ALL MATERIALS STORED ONSITE SHALL BE STORED IN A NEAT, ORDERLY MANNER IN THEIR APPROPRIATE CONTAINERS AND IF POSSIBLE, UNDER COVER OR IN AN ENCLOSURE.
 - 11.3. SUBSTANCES SHALL NOT BE MIXED WITH ONE ANOTHER UNLESS RECOMMENDED BY THE MANUFACTURER.
 - 11.4. WHENEVER POSSIBLE, THE ENTIRE CONTAINER CONTENTS WILL BE USED UP PRIOR TO DISPOSAL OF THE CONTAINER.
 - 11.5. ALL HAZARDOUS MATERIALS, FUEL, OIL AND CHEMICAL SPILLS SHALL BE STOPPED AND CLEANED UP WITH PROPER ABSORBENT MATERIALS. ABSORBENT MATERIAL SPILL KITS SHALL BE MAINTAINED ON-SITE.
 - 11.6. THE CONTRACTOR SHALL CONDUCT A DAILY INSPECTION TO ENSURE PROPER USE AND DISPOSAL OF MATERIALS ONSITE.
 - 11.7. CONCRETE TRUCK CHUTE WASH WATER SHALL BE DISCHARGED TO A DESIGNATED AREA WHERE COMMINGLING WITH STORM WATER WILL BE PREVENTED BY LOCATING OUTSIDE OF DRAINAGEWAYS, CUT-OFF DITCH OR PERIMETER BERM. WATER SHALL NOT BE DISCHARGED INTO DRAINAGE SYSTEMS OR WATERS OF THE UNITED STATES. THE CONTRACTOR SHALL CLEAN THE DISPOSAL SITE AS REQUIRED.
- 12. SANITARY AND SEPTIC WASTES SHALL BE COLLECTED FROM ON-SITE FACILITIES ON A REGULAR BASIS BY A LICENSED HAULER. SANITARY AND SEPTIC FACILITIES SHALL NOT BE LOCATED IN OR NEAR WATERCOURSES.
- 13. VEHICLE AND EQUIPMENT MAINTENANCE AND FUELING SHALL BE DONE OFF-SITE (WHERE AT ALL POSSIBLE)
- 14. THE CONTRACTOR AND SUBCONTRACTORS SHALL BE TRAINED ON THE BEST MANAGEMENT PRACTICES.
- 15. PERIMETER PROTECTION (FILTER SOCK) SHALL BE CLEARED OF SILT IMMEDIATELY FOLLOWING THE END OF ANY RAINFALL THAT CAUSES SILT BUILDUP OR WHEN DEPTH REACHES 1/3 OF PERIMETER PROTECTION HEIGHT.
- 16. STABILIZATION SHALL BE ACCOMPLISHED BY PERMANENTLY PROTECTING THE DISTURBED SOIL SURFACE FROM RAINFALL IMPACTS AND RUNOFF WITH GRASSING. FOR STABILIZATION WITH GRASSING, TEMPORARY IRRIGATION SHALL BE INSTALLED TO FACILITATE GROWTH. DO NOT OVERWATER.
- 17. FERTILIZER AND PESTICIDE APPLICATION SHALL NOT OCCUR IF HEAVY RAINS ARE ANTICIPATED DURING THE WORKDAY, OR DURING HEAVY RAINS.
- 18. EROSION CONTROL MEASURES MAY BE REMOVED IN AREAS THAT ARE STABILIZED AND COMPLETED.
- 19. EROSION CONTROL AND BMPS ARE THE MINIMUM REQUIREMENTS FOR THE PROJECT. CONTRACTOR MAY INSTALL AND IMPLEMENT NEW/BETTER PRODUCTS TO CONTROL AND PREVENT EROSION AND POLLUTANTS FROM THE SITE.
- 20. CONTRACTOR SHALL NOT STOCKPILE MATERIALS IN CITY ROW.

Ø	DIAMETER	HTCo.	HAWAIIAN TELEPHONE COMPANY
A	AIR	ICV	IRRIGATION CONTROL VALVE
A.C.A.	ASPHALT CONCRETE	I.D.	INNER DIAMETER
A/C	AIR CONDITIONING	INV.	INVERT
APPROX.	APPROXIMATE	IRR	IRRIGATION
AFT.	APARTMENT	L	LENGTH
ARV	AIR RELEASE VALVE	LAT	LATERAL
AVG.	AVERAGE	LB	POUND
AVE.	AVENUE	LF	LINEAR FOOT
B	BYPASS	LP.	LIGHT/LAMP POLE
BC	BOTTOM CURB	MAX.	MAXIMUM
BFP	BACK FLOW PREVENTER	MGD	MILLION GALLONS PER DAY
BLDG.	BUILDING	MH	MANHOLE
B.O.D.	BIOCHEMICAL OXYGEN DEMAND	MIN.	MINIMUM/MINUTE
BOT	BOTTOM	MON.	MONUMENT
BW	BOTTOM WALL	N	NORH
BWS	BOARD OF WATER SUPPLY CENTERLINE	O/H	OVERHEAD ELECTRIC LINE ON CENTER
C.L.	CHAIN-LINK	O.C.	ON CENTER
CMU	CONCRETE MASONRY UNIT	P/PAVT.	PAVEMENT
C.O.	CLEAN OUT	P	PROPERTY LINE
COL.	COLUMN	PSI	POUND PER SQUARE INCH
COMM.	COMMUNICATION	PVC	POLYVINYL CHLORIDE
C/CONC.	CONCRETE	Qo	PIPE CAPACITY
CONT.	CONTINUATION	Qr	DESIGN PEAK FLOW
C.Y.	CUBIC YARD	RCP	REINFORCED CONCRETE PIPE
D	DIAMETER OR DRAIN	S	SEWER
DET.	DETAIL	SDWB	SAFE DRINKING WATER BRANCH
D.I.	DRAIN INLET	SF	SQUARE FEET
D-BOX	DISTRIBUTION BOX	SHT.	SHEET
DPW	DEPARTMENT OF PUBLIC WORKS	S.L.	SEWERLINE/STREETLIGHT
DWG.	DRAWING	SMH	SEWER MANHOLE
E	EAST	ST.M.	STREET
E/ELEC.	ELECTRIC	STA.	STATION
ELEV/EL	ELEVATION	STD.	STANDARD
EMH	ELECTRIC MANHOLE	S.T.P.	SEWAGE TREATMENT PLANT
EP	ELECTRIC POLE	S/W	SIDEWALK
EXIST.	EXISTING	STRUCT.	STRUCTURAL
FG	FINISH GRADE	SYM.	SYMMETRICAL
FM	FORCE MAIN	TC	TOP CURB
FRP	FIBERGLASS REINFORCE PLASTIC	TDH	TOTAL DYNAMIC HEAD
FT	FEET	T/TEL.	TELEPHONE
G	GAS	T/MP.	TEMPORARY
GAL.	GALLONS	TMK	TAX MAP KEY
GND.	GROUND	TMH	TELEPHONE MANHOLE
G.P.	GUY POLE/GATE POST	TP	TOP PIPE
GPD	GALLONS PER DAY	TS	TOP STEM
GPM	GALLONS PER MINUTE	T.S.S.	TOTSL SUSPENDED SOLIDS
GV	GATE VALVE	TV	TOP VALVE
G.W.	GUY WIRE	TW	TOP WALL
HAR	HAWAII ADMINISTRATIVE RULES	U.P.	TYPICAL
H/H.T.	HEIGHT	U.P./S.L.	UTILITY POLE
H.B.	HOSE BUB	VFD	UTILITY POLE W/ STREET LIGHT
HECO	HAWAIIAN ELECTRIC COMPANY	W	VARIABLE FREQUENCY DRIVE
HDPE	HIGH-DENSITY POLYETHYLENE	WL	WATER/WIDTH
HP	HORSEPOWER	WM	WATERLINE
HPHA	HAWAII PUBLIC HOUSING AUTHORITY	WM	WATER METER
		WV	WATER VALVE BOX

D

C

Revised October 2014

B

A



Revision Number/ Description

ONO VISTA WWTP REPLACEMENT
 68-242 APUHIHI STREET
 WAIALUA, OAHU, HI 96791
 TMK: (1) 6-8-011-058

Project Name: ONO VISTA WWTP REPLACEMENT

Drawing Title: GENERAL NOTES

Project Number: 22023_22035 Date: MARCH 16, 2023

Drawn: AC Checked: ww Designed: RD

Drawing Number: T-002

Sheet No. ____ of ____


NOT FOR CONSTRUCTION: PERMIT SET

Attachment B- Kubota Johkasou Treatment Package Preliminary Design/Equipment Summary

For Earth, For Life



Budgetary Proposal for the
Oahu Development Project, HI
Johkasou Package Treatment System

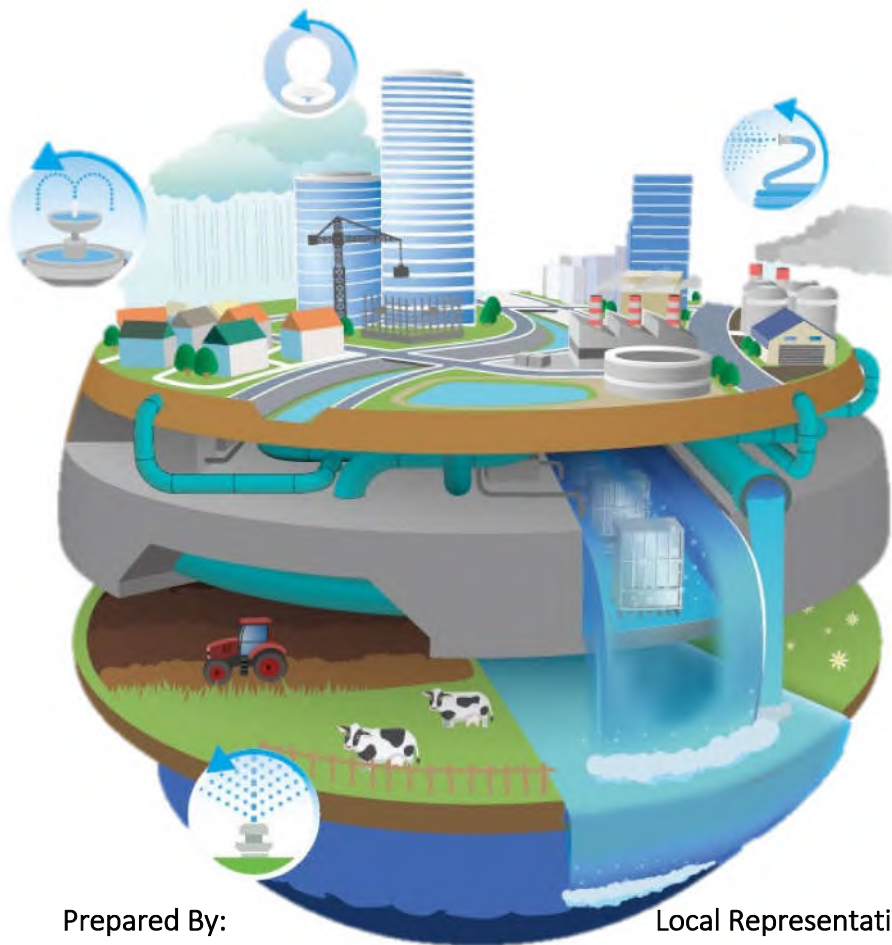

Prepared By:

KUBOTA Membrane USA
11807 North Creek Parkway S., Suite B-109
Bothell, WA 98011
425-898-2858

Local Representation By:

Hawaii Engineering Services
Matt Moore
808-258-7182
matt@hiengineering.com

September 28, 2022



Attn: Toru Kumagai, P.E., Director of Engineering
Laulea Engineering, LLC
1019 Waimanu Street #208
Honolulu, HI 96814

We are pleased to present the attached material for your consideration regarding the proposed Kubota Johkasou package treatment system. The proposed system will use a combination of fiber reinforced plastic (FRP) tanks and membrane bioreactor (MBR) to provide high-quality effluent with reliably low effluent nutrient concentrations.

A compelling feature of the Kubota MBR system is the simplicity of daily operations and periodic maintenance. Both the membrane unit and the entire MBR system are designed for the operator's convenience. Cleaning is performed in place, with no routine membrane unit removal or tank draining required. Cleaning events are performed just two to four times per year, and each event can be completed in a matter of hours. The Kubota MBR system offers straightforward troubleshooting and easy replacement in the unlikely event that problems arise.

Kubota is the premier manufacturer of membranes for wastewater treatment with over 400 installations in North America and 5,970 installations worldwide. Kubota Membrane USA offers first class service. Our technicians have operational experience and are well trained in wastewater analysis and membrane inspection. This sets us apart from other membrane manufacturers who do not design, build, or operate treatment plants, and it sets us apart from system integrators who do not manufacture parts or operate plants. We are responsive to operator concerns and knowledgeable about the Kubota MBR System from top to bottom.

With the Kubota name comes a long history of excellence in MBR wastewater treatment, and we are responsive to operator concerns and knowledgeable about the Kubota MBR System from top to bottom. We are happy to put you in touch with operators and engineers who can share their experience with our product across the country. If you have any questions regarding the attached information, please feel free to contact us or our local representative, **Matt Moore** of **Hawaii Engineering Services** at matt@hiengineering.com.

Regards,

Brian Codianne
Regional Manager
KUBOTA Membrane USA Corporation
Cell: 425-898-3888
Email: brian.codianne@kubota.com

James Liu
Application Engineer
KUBOTA Membrane USA Corporation
425-977-5284
james.liu@kubota.com

1 Contents

1	Contents.....	0
1	Introduction	1
2	Design Overview	1
2.1	Influent Design Flow	1
2.2	MBR Specifications.....	1
2.3	Operation and Maintenance.....	2
2.4	Process Flow Diagram and Proposed Layout	3
3	Scope of Supply.....	5
3.1	Major Equipment and Instrumentation.....	5
3.2	Direct Services Information	6
3.3	Exclusions to KMU’s Scope of Supply.....	7
4	Warranty.....	7
5	Budgetary Price.....	7
6	24/7 Technical Support.....	8
7	Additional Services (Optional)	8
8	Design Summary	9
9	O & M Estimates	10

Tables

Table 1:	Design Flow Conditions.....	1
Table 2:	Influent and Effluent Characteristics	1
Table 3:	Membrane Equipment Specifications.....	2
Table 4:	Tank Dimensions, Volumes and Hydraulic Retention Times	4
Table 5:	Major Equipment and Instrumentation in KMU's Scope of Supply.....	5
Table 6:	Training and Workshops included in Kubota's Scope of Supply.....	6
Table 7:	Budgetary Price for Proposed Kubota Johkasou Treatment System Equipment	7
Table 8:	Kubota's Available Services.....	8

Figures

Figure 1:	Kubota FF Series Membrane Unit structure (left), cartridge structure and close-up of fixed membrane spacing (right)	2
Figure 2:	Process Flow Diagram. Optional methanol and PAC injections depending on the influent characteristics	3
Figure 3:	Example Cross-section view of Johkasou package treatment system	4

1 Introduction

Kubota Membrane USA would like to thank you for the opportunity to present the enclosed budgetary proposal to supply a Johkasou package treatment system. Included below is an overview of the proposed Kubota system. A scope of supply and budgetary price are also included.

2 Design Overview

2.1 Influent Design Flow

The proposed Johkasou package treatment system was designed based on the following influent flow rate and wastewater characteristics data (*Tables 1 and 2*).

Table 1: Design Flow Conditions

Condition	Design Flow	Unit
Average Day Flow (ADF)	25,000	GPD
Peak Day Flow (PDF)	35,000	GPD

Table 2: Influent and Effluent Characteristics

Constituent	Influent Concentration	Effluent Limit
BOD	300 mg/L	< 25 mg/L
TSS	300 mg/L	< 25 mg/L
TKN ¹	45 mg/L	TN < 10 mg/L
TP ¹	8 mg/L	-
Assumed Minimum Temperature ²	18 °C	-

1. Assumed influent TKN and TP loadings as typical domestic wastewater. 2. Assumed minimum water temperature.

2.2 MBR Specifications

For this project, we have prepared a preliminary design based around the FF Series Submerged Membrane Unit (SMU), which offer high quality effluent with simple maintenance and operation.

Kubota's membrane sheet is made from chlorinated polyethylene, has an average pore size of 0.2 micron (maximum 0.4 micron), is much thicker than other membranes to provide long-lasting durability, and features high porosity to enable high flow. This pore size has been designed as the optimum balance between water quality and quantity. Kubota's membrane sheet has Title 22 approval for water reuse in California. A basic overview of the FF series of Submerged Membrane Unit and the Kubota 510-type membrane cartridge is included in the figure below.

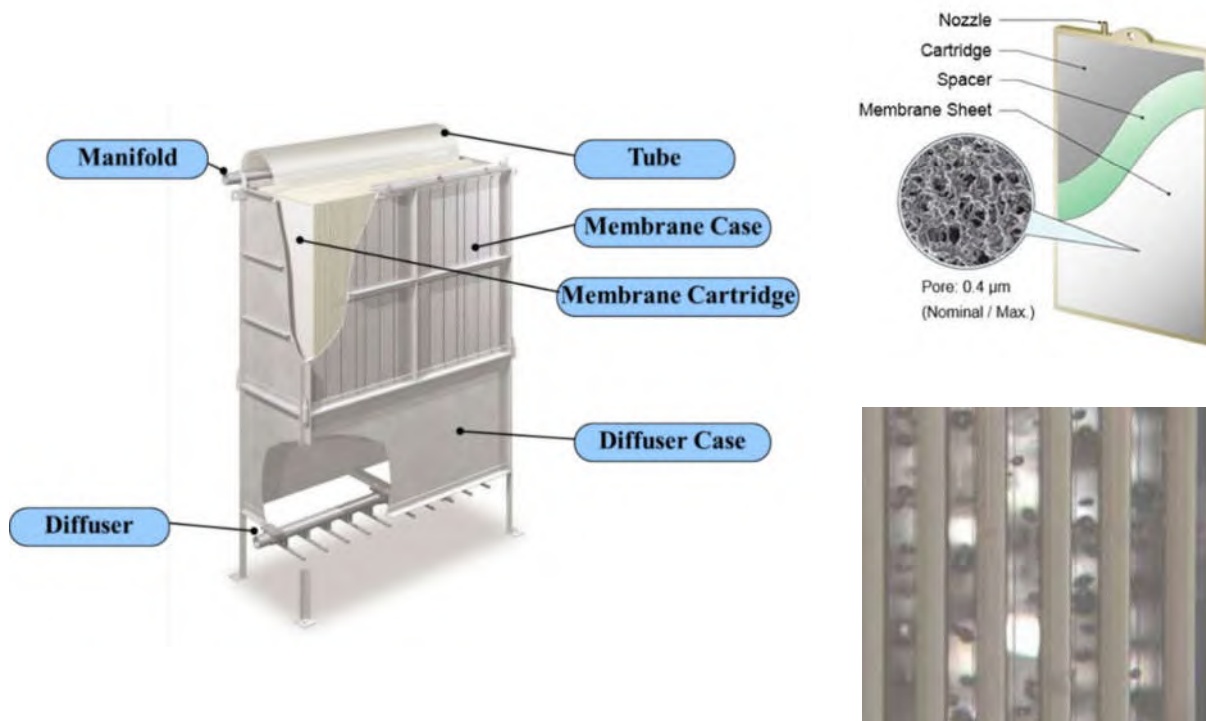


Figure 1: Kubota FF Series Membrane Unit structure (left), cartridge structure and close-up of fixed membrane spacing (right)

Details of the proposed membrane units are presented below.

Table 3: Membrane Equipment Specifications

Component	Specifications
Membrane Model	FF50
Membrane Type	Flat Plate
Membrane Surface Area per Unit	FF 50: 430.6 ft ²
Design MLSS at MBR	11,000 mg/L
Total Number of Submerged Membrane Units	6

2.3 Operation and Maintenance

The Kubota MBR system offers a simple design, simple operation, and simple maintenance. The system can operate at a wide range of MLSS concentrations. The primary method of membrane cleaning for the Kubota MBR system is the air scour provided by the diffusers at the base of the membrane units. The chemical cleaning is performed by feeding the cleaning solution through the permeate piping into the membrane units and allowing that solution to soak in the membrane units for 2 to 4 hours. If the residual chemical cannot be discharged from the system, it can be sent back to the raw water inlet or to the bioreactor in order to neutralize the chemical.

Organic fouling can be cleaned with a 0.5% sodium hypochlorite (NaClO) solution. This is typically done two to four times per year. Each FF50 SMU requires approximately 2 gallons of 12.5% NaClO stock solution per

cleaning event for organic fouling; inorganic fouling such as iron or aluminum can be cleaned by a 0.5% to 1% oxalic or citric acid solution which is typically needed once a year or less. Each FF50 SMU requires approximately 1 gallon of 50% citric acid solution per cleaning event for inorganic fouling.

The Kubota MBR system was developed in 1990 to be low-maintenance and easy to operate. Since then, Kubota MBR package plants have been installed in many remote communities to treat small flows. Many of these plants run without constant operator attention and are visited only once every two weeks. This illustrates the ease of operation and reliability of the Kubota MBR system.

2.4 Process Flow Diagram and Proposed Layout

We are proposing an MLE process for required organics and nitrogen removal. The proposed Johkasou treatment train for this project includes four cylindrical tanks: 1. First equalization (EQ) tank, 2. Second EQ tank (with a set of pumps to feed the flow forward) and a sludge holding tank (SHT), 3. An anoxic (AX) tank for denitrification (with a set of pumps to feed the flow forward) and 4. MBR tank (where the SMUs are), disinfection tank and effluent tank. Figures below illustrate the typical Process Flow Diagram and an example cross-section drawing of a Johkasou package treatment system.

Influent first enters the Johkasou package treatment system to EQ tank. The flow is then pumped to AX

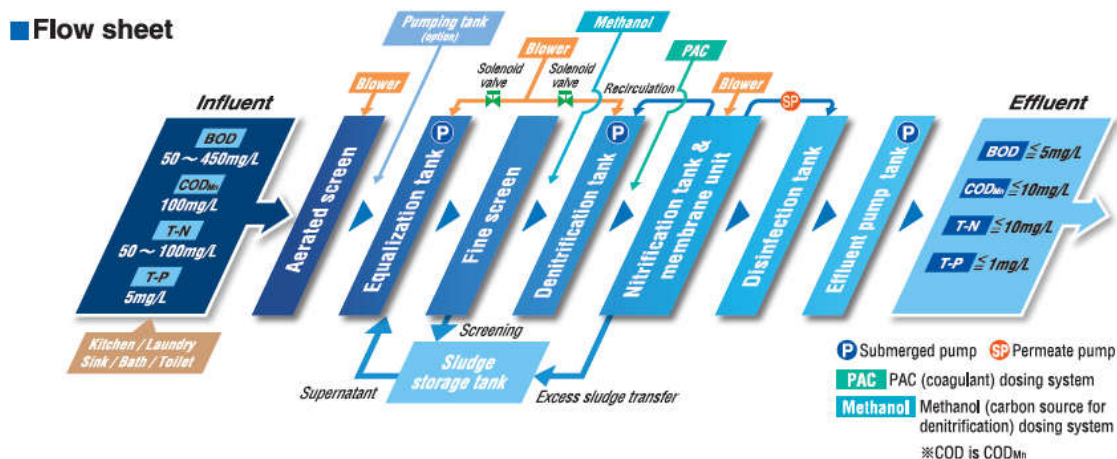


Figure 2: Process Flow Diagram. Optional methanol and PAC injections depending on the influent characteristics

tank (for denitrification) where the flow is screened through a microscreen to provide protection for the membrane. The flow then passes to the combined membrane filtration aeration/nitrification tank, where the effluent continues to the discharging tank while recycle sludge returns to AX tank for denitrification. The treated effluent pumps are submersible pumps located in the discharging tank.

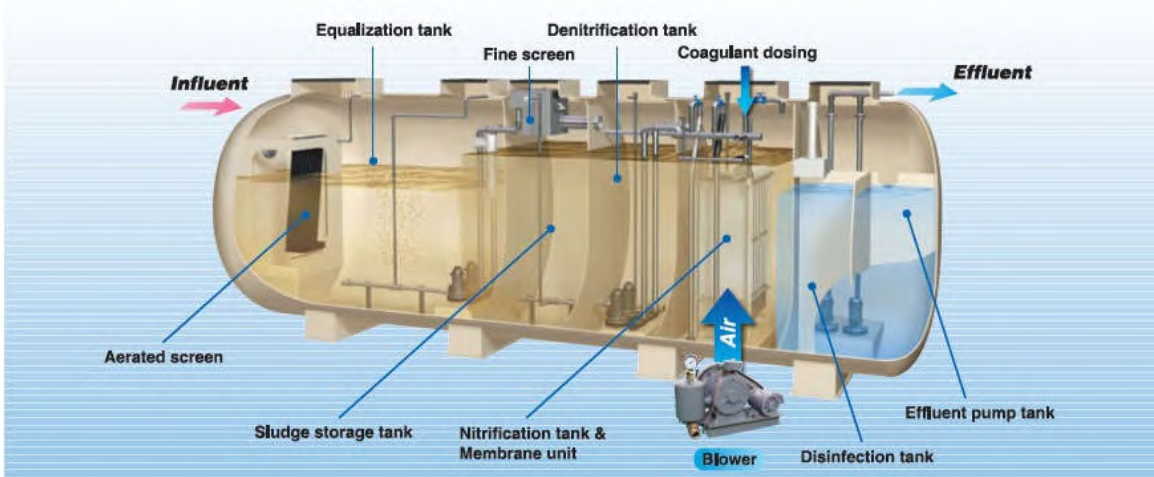


Figure 3: Example Cross-section view of Johkasou package treatment system

The EQ tank described above can store the flow up to 11 hours, and the SHT is designed to store fine screen rejections and WAS up to five (5) days. Preliminary tank sizes, dimensions and nominal HRT are listed below.

Table 4: Tank Dimensions, Volumes and Hydraulic Retention Times

Tank Dimensions		
Tank 1 (1 st EQ Tank)	24.1'L x 8.2'W x 10.2'H	
Tank 2 (2 nd EQ Tank + SHT)	24.1'L x 8.2'W x 10.2'H	
Tank 3 (AX Tank)	20.7'L x 8.2'W x 10.2'H	
Tank 4 (MBR Tank + Disinfection & Effluent Tank)	24.6'L x 8.2'W x 10.2'H	
Tank Volume and HRT		
Tank	Total Volume (Gallon)	Nominal HRT (Hour)
Equalization (EQ) Tank	11,900	11.4
Sludge Holding Tank (SHT)	1,550	-
AX (Denitrification) Tank	5,950	5.7
MBR (Aeration & Nitrification) Tank	7,350	7.1
Disinfection & Effluent Discharge Tank	750	0.7

3 Scope of Supply

KMU's scope of supply is limited to the equipment and services outlined in this proposal. The equipment will be supplied by Kubota Membrane USA and are included in the proposal price are listed in *Section 5*.

3.1 Major Equipment and Instrumentation

Table 5: Major Equipment and Instrumentation in KMU's Scope of Supply

Name	Type	Capacity / Size	HP	Quantity
Kubota Johkasou Tanks				
Johkasou Tank Set	Kubota Johkasou FRP Tank Skid	Tank 1 & 2: 24.1'L x 8.2'W x 10.2'H Tank 3: 20.7'L x 8.2'W x 10.2'H Tank 4: 24.6'L x 8.2'W x 10.2'H	-	1 set
Fine Screening (FSC) Equipment				
Fine Screen	1-mm Bar Screen	30 gpm	0.03	1
Submerged Membrane Unit (SMU)				
Kubota SMU	Flat Plate	FF50	-	6
Pumps				
EQ Pump	Submersible	37 gpm	0.5	2
Feed Forward (FF) Pump	Submersible	106 gpm	2	2
Permeate Pump	Centrifugal	66 gpm	1	2
Effluent Pump	Centrifugal	21 gpm	0.5	2
Blowers				
Mixing Blower	Three-Lobe	23 scfm	1	1
Aeration Blower	Three-Lobe	210 scfm	7.4	2
Instrumentation				
Permeate Pressure Gauge	Diaphragm	±15 psi	-	2
Integrated Flow Meter	Electromagnetic	2"	-	2
Level Switch	Float	-	-	10
SMU Clean-In-Place (CIP) and Chemical Dosing Equipment				
CIP Pump	Centrifugal	15 gpm	0.5	1
Control Panel Equipment				
Control System	PLC Panel, HMI	-	-	1 set

3.2 Direct Services Information

The following services are included in Kubota’s scope of supply.

Design Support

- Submittals including shop drawings.
- One (1) day on-site inspection meeting.
- Preparation and submittal of a system O&M manual for Kubota supplied systems and equipment.
- Equipment delivery coordination with the contractor.
- One (1) day on-site delivery inspection of the Johkasou system.

Commissioning

- Five (5) days on-site for installation inspection, start-up, and commissioning including dry and wet equipment checks, clean water testing, and support during seeding and start-up.
- Additional days are available as needed.

Training

- Two (2) days of on-site, hands-on operator training using a mix of classroom and field time. See *Table 7* below for an example of training topics to be covered.

Table 6: Training and Workshops included in Kubota's Scope of Supply

Training/Workshop	Brief Summary
MBR control system and HMI	<ol style="list-style-type: none"> 1. Navigation of all HMI screens and menus. 2. Review of automatic operations and controls. 3. Changing process set points. 4. Overriding controls from the HMI. 5. Manual operation of the system in the event of a power failure.
CIP training	<ol style="list-style-type: none"> 1. Navigation of CIP (Clean-In-Place), in-situ maintenance chemical cleaning. 2. Control from HMI and operation of manual valve. 3. Adjust set points of chemical flow.
Troubleshooting	<ol style="list-style-type: none"> 1. Case study of troubleshooting 2. Recovery from trouble 3. “Fish bone” approach
Daily testing	<ol style="list-style-type: none"> 1. Filterability test 2. Viscosity measurement

3.2.1.1 Workshop/Additional Training Available (No Charge)

- In addition to our standard training at commissioning, Kubota Membrane USA will host an annual regional operator workshop in which operators meet to exchange ideas and learn about the latest developments in MBR technology.
- Customized individual training, such as membrane disassembling training, is also available upon request.

3.3 Exclusions to KMU’s Scope of Supply

The following items are not currently included in the KMU scope of supply:

- Sales tax.
- Bid bond, performance bond and payment bond.
- Site preparation including preparation of a suitable foundation for the package treatment system.
- Equipment unloading and installation at the site.
- Electrical site work and piping outside of the skid (i.e., connecting to main power, backup power, influent and effluent connections, etc.).
- Variable Frequency Drives (VFD) for the pumps.
 - ✓ Given the designed equalization capacity of the proposed Johkasou treatment system, VFDs are not necessary for the pumps.
- Coarse screening, grit removal, oil and grease removal (if needed).
- Building construction.
- Treated water holding tank.
- Sludge treatment (dewatering, etc.).
- Alum/ferric chloride, carbon addition, and alkalinity addition systems (if needed).
- Chemical storage tank.
- Heat tracing (A separate power supply will also be required).
- Covers on the package plant tanks or overhead walkways and stairs (available at an additional cost)
- Seismic bracing for the SMU, if needed.
 - ✓ Kubota can provide related services at extra cost if needed.

4 Warranty

Kubota’s standard 2-year membrane warranty, and 1-year mechanical equipment warranty is included in the main budgetary price proposed (Table 7) and goes into effect at the commencement date of commissioning. The warranty included is a guarantee that the products supplied by Kubota are free from defect in material or workmanship.

5 Budgetary Price

The Budgetary Price for the equipment and instrumentation described herein is shown below in Table 7. The pricing herein is for budgetary purposes only and does not constitute an offer of sale. **Freight, taxes and duties are not included.**

Table 7: Budgetary Price for Proposed Kubota Johkasou Treatment System Equipment

Budgetary Price	
Johkasou Treatment System Equipment, Instrumentation, Services and Warranty	\$635,000, excluding sales tax, freight

The pricing herein is for budgetary purposes only and does not constitute an offer of sale. Tax, freight, and duties are not included. Tax will be added to this total at the time of sale based on the applicable tax rate.

6 24/7 Technical Support

24/7 phone support is available in addition to support during regular business hours. 24-hour technical support calls are shared within the Kubota staff so that you can rest assured knowing that knowledgeable engineers and technicians are just a phone call away.

7 Additional Services (Optional)

The following service plans are optional and may be added to Kubota’s scope of supply if desired for an additional cost.

Kubota Membrane Protection Plan

Under this plan, Kubota Membrane USA warrants against any membrane failure for 10 years when the system is operated in accordance with the O&M manual. This plan includes annual onsite membrane inspection with a membrane examination and inspection report, periodic replacement of parts and damaged membranes (if any), and phone support during the 10-year period. With this plan, Kubota will replace each cartridge at least once during the 10-year span, regardless of necessity.

Kubota Custom Membrane Support Plan

Kubota can customize your support/service package to meet your needs. The following table shows a variety of our available services:

Table 8: Kubota’s Available Services

Service	Note
Periodical technical support	Monthly, quarterly, annually
24/7 phone support	Always available
MBR control system monitoring	Weekly, monthly, quarterly
Periodical site visit	Quarterly, semi-annually, annually
Membrane inspection	Annual, semi-annual, 3x per year
Membrane protection (10-year contract)	Select annual or semi-annual inspections
Program (MBR control system, etc.) update	Based on hydraulic changes, such as increases in flow or changes in operation

Basis of Design

Parameter	Flow	Temperature	Typical Event Duration	Design Durations
Average Annual Flow (AAF)	19,250 GPD *	23 °C *	9 consecutive months	9.0 months *
Max Month Flow (MMF)	25,000 GPD *	18 °C *	3 consecutive months	3.0 months *
Peak Week Flow (PWF) **	30,000 GPD *	18 °C *	3 non-consecutive weeks	3.0 weeks *
Peak Day Flow (PDF) **	35,000 GPD *	18 °C *	8 non-consecutive days	8.0 days *
Peak Hourly Flow (PHF) **	35,000 GPD *	18 °C *	4 hrs with 24 hrs between PHF	4.0 hours *

Parameter	Influent	Effluent Limits
BOD	300 mg/L *	< 25 mg/L *
TSS	300 mg/L *	< 25 mg/L *
TKN	45 mg/L *	< 3 mg/L *
NH ₃	32 mg/L *	< 1 mg/L *
TP	8 mg/L *	< 8 mg/L *
TN	45 mg/L *	< 10 mg/L *
Alkalinity	300 mg/L *	< 75 mg/L *
Maximum Wastewater Temperature	25 °C *	
Elevation	500 ft *	

* Value assumed by Kubota, to be verified by consulting engineer.

** Peak values assumed to occur during MMF, to be verified by consulting engineer.

MBR/PA Zone (Membrane) Design

Parameter	Value	Notes
No. of Membrane Basins	1	
No. of Membrane Rows per Basin	1	
No. of Membrane Units per Basin	6	6 units total
Membrane Unit Type	FS-50	Cartridge: 510
No. of Cartridges per Unit	50	300 membrane Cartridges total
Surface Area per Cartridge	8.60 ft ² /cartridge	2,580 sq ft total
Flux @ 19,250 GPD (AAF)	7.46 gal/(ft ² x day)	
Flux @ 25,000 GPD (MMF)	9.69 gal/(ft ² x day)	
Flux @ 30,000 GPD (PWF)	11.63 gal/(ft ² x day)	
Flux @ 35,000 GPD (PDF)	13.57 gal/(ft ² x day)	
Flux @ 35,000 GPD (PHF)	13.57 gal/(ft ² x day)	
Membrane Basin Volume	11,316 gal/basin	8.2ft x 24.6ft x 7.5ft SWD
Membrane Air Scour Rate for Sizing	18.9 scfm/unit	@ 4.1 PSIG discharge
Total System AOR	85 lb O ₂ /day	
AOR Satisfied by Air Scour	40 lb O ₂ /day	
MBR Basin MLSS	11,000 mg/L	

Anoxic Zone Design

Parameter	Value	Notes
Basin Volume	5,950 gal	6,029 gal total
Basin Dimensions	15.5ft x 8ft x 6.5ft SWD	
Anoxic MLSS	9,289 mg/L	
Recycle Rate	5.5 Q	From MBR to Anoxic Basin

MBR/PA Zone Design

Parameter	Value	Notes
Fine Bubble Diffuser AOR	45 lb O ₂ /day	

MBR Waste Activated Sludge Production Parameters

Parameter	Value	Notes
WAS Sludge Production	43 lbs sludge / day	
Chemical Sludge Production	0 lbs sludge / day	Based on Chem-P process
Total Sludge Production	43 lbs sludge / day	
Sludge Concentration	1.1%	solids
Sludge Flow	469 gal sludge / day	
WAS Volatile Fraction	0.75	Assumed

System Design Parameters

Parameter	Value	Notes
Plant HRT	12.5 hrs	
Design Plant SRT	26 days	
F:M ratio	0.05	

Feed Forward Pump Design

Parameter	Value	Notes
Feed Forward Pumps	2	1 Duty, 1 Shelf Spare
Type	SUBMERSIBLE	
Unit Capacity	112 GPM	
TDH	20.0 ft	

Permeate Pump Design

Parameter	Value	Notes
Permeate Pumps	2	1 Duty, 1 Stdby
Type	CENTRIFUGAL	Suction Design
Unit Permeate Pump Capacity	66 GPM	
TDH	35.0 ft	

Blower Design

Parameter	Value	Notes
MBR Blowers	2	1 duty, 1 Stdby
Type	POSITIVE DISPLACEMENT	
Unit MBR Blower Capacity	210 SCFM	
MBR Blower Discharge Pressure	4.06 PSIG discharge	

Chemical Cleaning Design

Parameter	Value	Notes
Cleaning chemical (organic fouling)	Sodium Hypochlorite	2 times/yr
Typical Cleaning Schedule	1-2	cleanings/basin/yr
Volume per Membrane	.79 gal/cartridge	
Volume of Cleaning Solution	237.78 gal/basin	
Cleaning Solution Concentration	0.0025	
Volume of 12.5% Stock solution	5 gal/basin/cleaning	
Cleaning chemical (inorganic fouling)	Oxalic Acid	2 times/yr
Typical Cleaning Schedule	1-2	cleanings/basin/yr
Volume per Membrane	.79 gal/cartridge	
Volume of Cleaning Solution	237.78 gal/basin	
Cleaning Solution Concentration	0.01	
Volume of 100.0% Stock solution	2 gal/basin/cleaning	

O & M costs based on Average Annual Flow (AAF) are listed below, and have been broken down into four categories.

- Category 1: Annual Chemical Use Summary

Table 1: Chemical Usage		
Parameter	Value	Notes
Number of Cartridges	300 Cartridges	
Volume of Chemical Needed per Cartridge	0.79 gal/Cartridge	
Sodium Hypochlorite (Membrane CIP)		
Volume of Dilute Sodium Hypochlorite	238 gal	
Concentration of Dilute Solution	0.25%	
Concentration of Stock Solution	12.5%	
Volume of Stock Solution of Sodium Hypochlorite	5 gal	vol. per single plant clean
Sodium Hypochlorite Buyout Cost	\$0.10/lb	Assumed
Cleanings per Year	2 times/yr	
Total Annual Sodium Hypochlorite Chemical Cost	\$10	Specific Gravity: 1.2
Oxalic Acid (Membrane CIP)		
Volume of Dilute Oxalic Acid	238 gal	
Concentration of Dilute Solution	1%	
Concentration of Stock Solution	100%	
Volume of Stock Solution of Oxalic Acid	2 gal	vol. per single plant clean
Oxalic Acid Buyout Cost	\$0.71/lb	Assumed
Cleanings per Year	2 times/yr	
Total Annual Oxalic Acid Chemical Cost	\$46	Specific Gravity: 1.65
Total Annual Chemical Cleaning Costs	\$56	


- Category 2: Annual Labor Costs for Membrane Cleaning

Table 2: Membrane CIP Labor		
Parameter	Value	Notes
Operator Hourly Wage	25	per hour
Total Cleaning Man-hours	12	hr/yr
Total Annual Labor Cost for Cleaning	\$300 /yr	Estimated

- Category 3: Annual Plant Operation and Maintenance Costs

Table 3: Plant Maintenance & Sampling Costs		
Parameter	Value (hr/yr)	Notes
Blowers	10	(Oil & filter change)
Influent Screens	4	
Permeate Pumps	4	(Inspection/lube)
RAS Pumps	4	(Inspection/lube)
Instrumentation	12	(calibrate and/or clean)
Sampling	25	
Mixers	0	(replace seals)
Total Annual Labor Manhours	59 hr/yr	hr/yr (membrane clean not included)
Operator Hourly Wage	25	per hr
Total Annual Labor Cost for O&M	\$1,475 /yr	Estimated

• Category 4: Membrane Replacement Cost

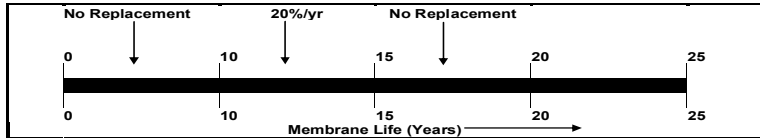

• Years: 1 through 10
No replacement.

• Years: 11 through 15
20% replacement per year

Estimated annual replacement cost = $0.2 \times 300 \text{ Cartridges} \times \$148^*/\text{Cartridge} = \$8,880/\text{yr}^{**}$

* Replacement cost. Must add CPI.


** Without redundant basin

• Years: 16 through 20
No replacement.

Estimated daily energy use (kwHrs/day):

425

Attachment C- Flowmeter Specifications and Details

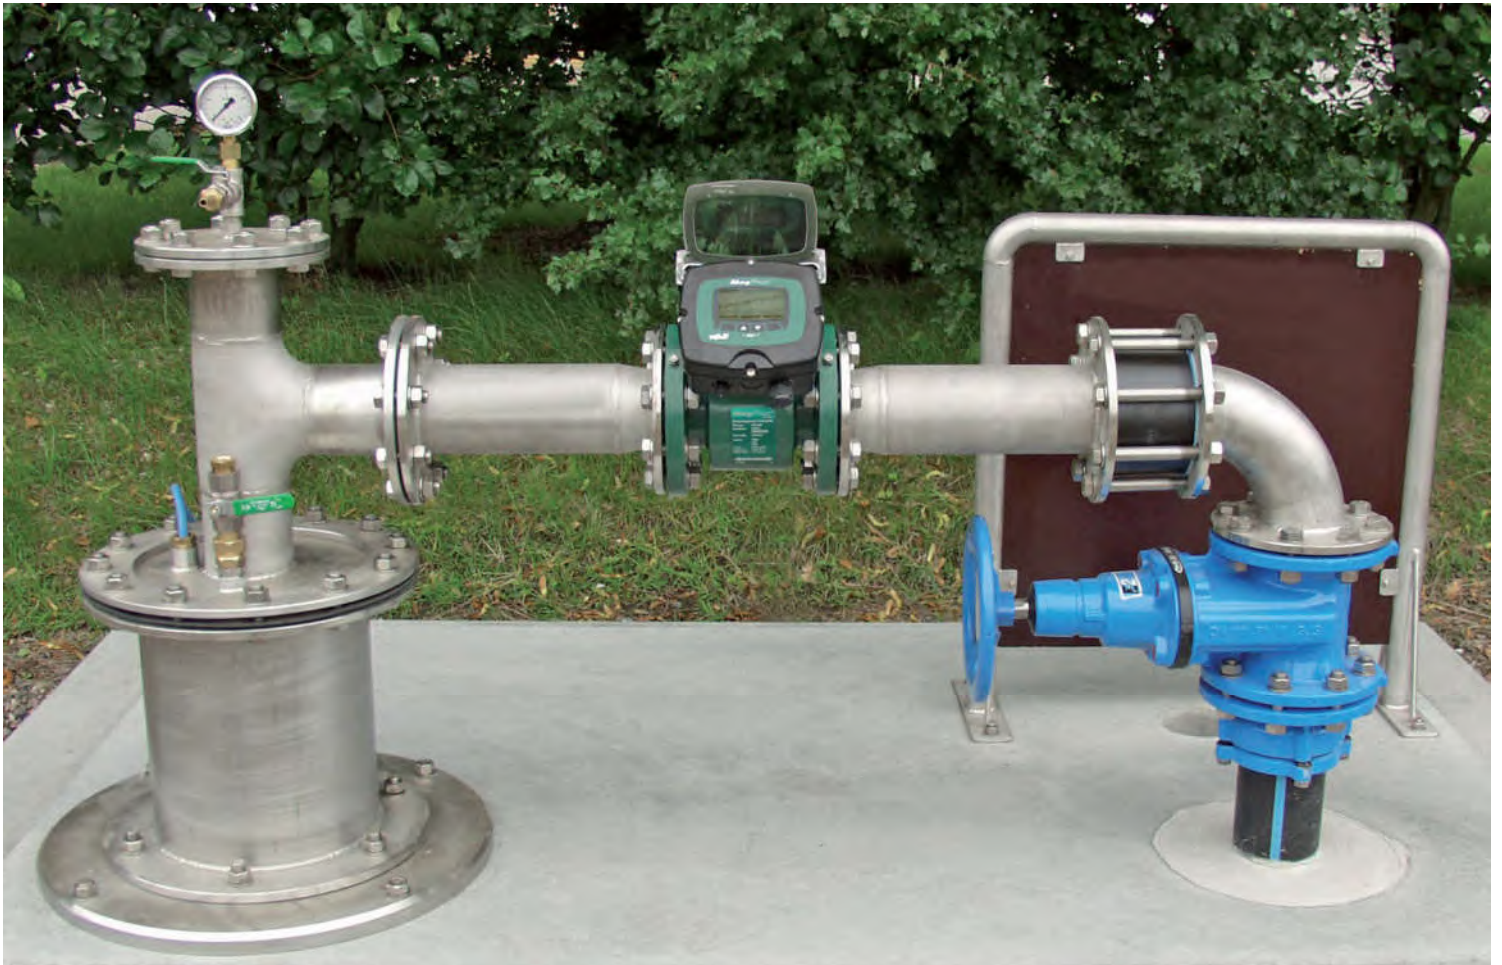

MagFlux[®]


ELECTROMAGNETIC FLOWMETERS



BROCHURE
EN 3.05 MAGFLUX BROCHURE 1401

mjk
a xylem brand

LARGE SELECTION OF SIZES AND MATERIALS

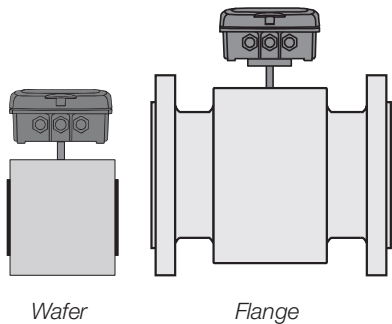

MagFlux® is available in sizes from DN 3 to DN 1400 (1/8" to 56") with standard lay lengths and standard EN, ANSI, AS and JIS pipe connections.




Model	7100	7200	7300	7400	7600
Mounting	Flange	Flange	Wafer	Wafer	Flange
Liner	PTFE	Hard rubber	PTFE	Hard rubber	Soft rubber
DN3 / 1/8"			•		
DN6 / 1/4"			•		
DN8 / 5/16"			•		
DN10 / 3/8"			•		
DN15 / 1/2"	•	•	•	•	•
DN20 / 3/4"	•	•	•	•	•
DN25 / 1"	•	•	•	•	•
DN32 / 1 1/4"	•	•	•	•	•
DN40 / 1 1/2"	•	•	•	•	•
DN50 / 2"	•	•	•	•	•
DN65 / 2 1/2"	•	•	•	•	•
DN80 / 3"	•	•	•	•	•
DN100 / 4"	•	•	•	•	•
DN125 / 5"	•	•	•	•	•
DN150 / 6"	•	•	•	•	•
DN200 / 8"	•	•	•	•	•
DN250 / 10"	•	•			•
DN300 / 12"	•	•			•
DN350 / 14"	•	•			•
DN400 / 16"	•	•			•
DN450 / 18"	•	•			•
DN500 / 20"	•	•			•
DN600 / 24"	•	•			•
DN700 / 28"	•	•			•
DN800 / 32"	•	•			•
DN900 / 36"		•			•
DN1000 / 40"		•			•
DN1200 / 48"		•			•
DN1400 / 56"		•			•

A BREAKTHROUGH IN SENSOR SET-UP SIMPLICITY

MJK's unique registration code for each sensor feeds all the necessary data into the meters electronics. In a matter of seconds the registration is completed, and the sensor characteristics and meter electronics are fully matched and ready to perform flow measurements.

It is safer than other systems that require memory chips that get lost or damaged, or complicated procedures requiring external equipment that have potential for mistakes.

MagFlux® sensor direction is also configured in the electronics, so there is no way to install a sensor backwards.

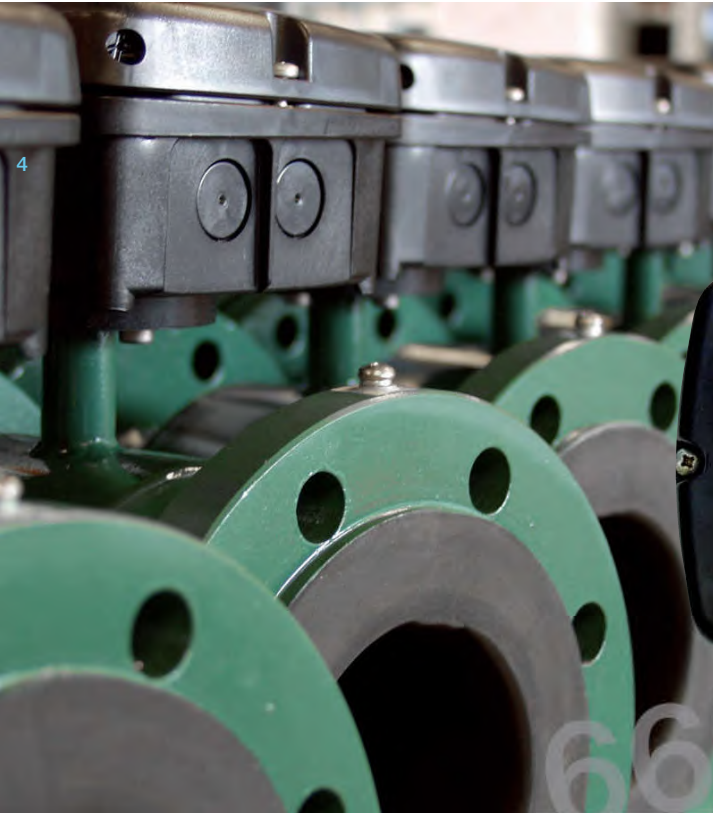

66NQ10
REGISTRATION CODE

COMPREHENSIVE FLOW AND BATCH CONTROL FUNCTIONS



The MagFlux® Converter has one 4 - 20 mA output, two relays for control and alarms, one digital input for batch or alarm reset, keypad start and stop of batch counters and reset of counters, totalizers and alarms. Pop-up windows alert the user about operational and alarm functions which are automatically logged and easily reset.

Batching, batch counters, forward, reverse and net totalizers and non-resettable totalizers are all on-board and easy to configure.

With its cell-phone like navigation, finding and managing these features is simple, but you can also password protect your settings.





BEST-IN-CLASS DATA LOGGING AND NETWORKING

MagFlux® is the first to bring you an on-board electronic chart recorder that graphs flow rates and shows the date, time and flow rate for each data point. Behind the scene is a data logger that you set up with the data logging interval. To capture data for your permanent records simply use the USB connection or Bluetooth® (optional) in the MagFlux® Display and the MJK Field Link firmware. This delivers not only the graphed data, but also a CSV data file (up to 160,000 data points) that you can open with MS Excel on your PC.

For SCADA users MJK provides RS-485 communication with Modbus protocol along with registers, so that several MJK MagFlux® flow meters can be operated seamlessly from a control room.

MagFlux® never gets out of date. The USB port also allows for uploading of new software, features and several different languages from a PC.

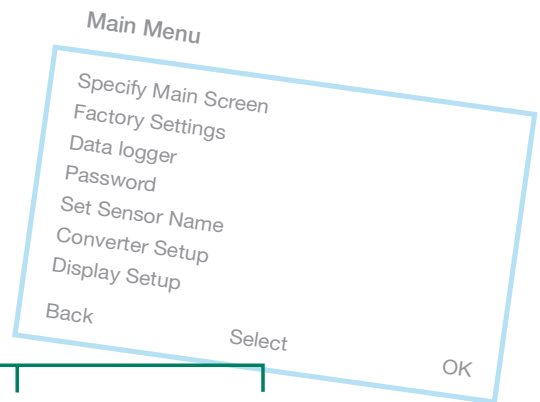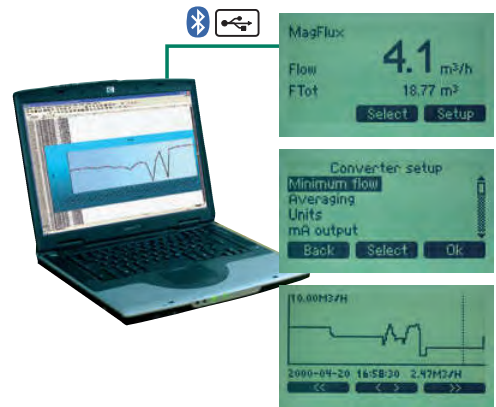

PROFI[®]
BUS **Modbus**



SUSIX[®]
TURBIDITY AND
SUSPENDED SOLIDS

OXIX[®]
DISSOLVED OXYGEN

MAGFLUX[®]
FLOW

MAGFLUX[®]
FOUR INPUTS ON
ONE DISPLAY W/
MAGFLUX CONVER-
TER AND SENSOR

LOCATE AND CONFIGURE MAGFLUX YOUR WAY




MagFlux® Converter and Display can stay locally with the flow sensor or can be installed remotely.

A single Display can be used for set-up, viewing and data logging for one, two, three, or four Converters and Sensors in their own network to save space and cost.

The Display can be up to 1000 m (3000 ft) from a Converter, allowing the Converter to be where the electrical and control connections are, while the Display can be where the operators are.

The Converter can be separated from the sensor, too! This allows for even more flexibility to locate the Converter, where electrical connections are needed and out of danger from submersion, burial or other hazards.

Wall mounting or panel mounting is possible for all MagFlux® electronic units.

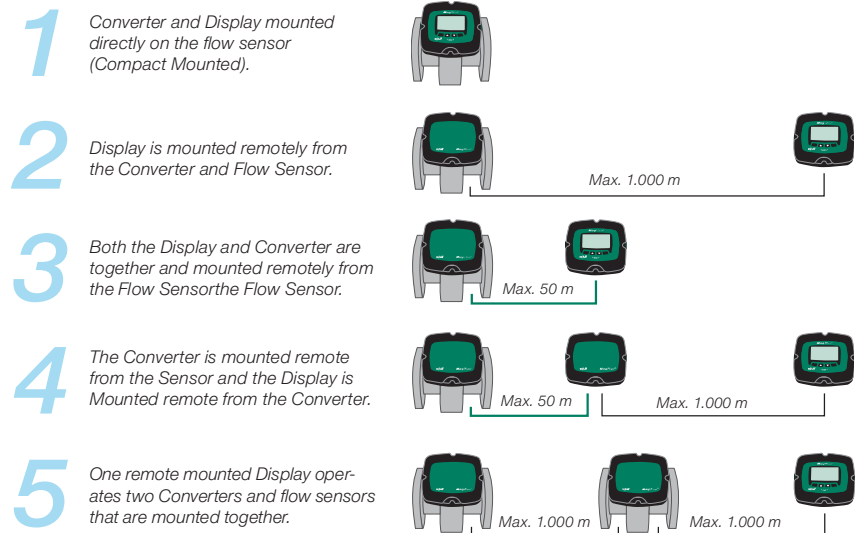

MagFlux® Sensor	
Mounting	Flange or wafer
Materials	Housing: Painted carbon or stainless steel Liner: Hard rubber, soft rubber or PTFE Electrode: Stainless steel 1.4571 (AISI 316). On order Hastelloy, titanium or platinum
Built-in grounding electrode	≥ DN 50
Accuracy	Better than ± 0,25%
Temperature	Liquid: -20 to +150° C / -5 to +302° F, depending of type. Surroundings: -20 to +60° C / -5 to +140° F (converter mounted on sensor) -20 to +80° C / 14 to +176° F (converter remote mounted)
Enclosure	IP 67 (with gel potting IP 68) / NEMA 4X (with gel potting NEMA 6P)

MagFlux® Converter	
Accuracy	± 0,1% of measurement (system accuracy better than ± 0,25 %)
Input	From MagFlux® sensor
Analog output	One active 4 - 20 mA, galvanic isolated (max. 800 Ω)
Digital output	One voltage-free, electromechanical relay (max. 50 V DC / 1 A) One optically isolated (max. 50 V AC / V DC / 120 mA)
Digital input	One digital input. Max. 30 V DC
Communication	Modbus® RTU-mode, 9600 baud, 2-wire RS 485, slave-mode
Datalogger	Display 160,000 logs with date, time, value and daily totals
Interface	RS 485 for connection to Display Unit or PLC.
Power supply	24 V AC, 50 / 60 Hz ± 10 % or 10 - 30 V DC or 230 / 115 V AC, 50 / 60 Hz ± 10 %
Power consumption	Max. 10 W
Cabinet materials	Polycarbonate, glass reinforced
Enclosure rating	IP 67 / NEMA 4X




MJK Automation ApS
Byageren 7
DK-2850 Nærum
Denmark
Tel +45 45 56 06 56
Fax +45 45 56 06 46
www.mjk.com



Attachment D- UV System Specifications and Details

REV	DESCRIPTION	DATE	APPROVED
-----	-------------	------	----------

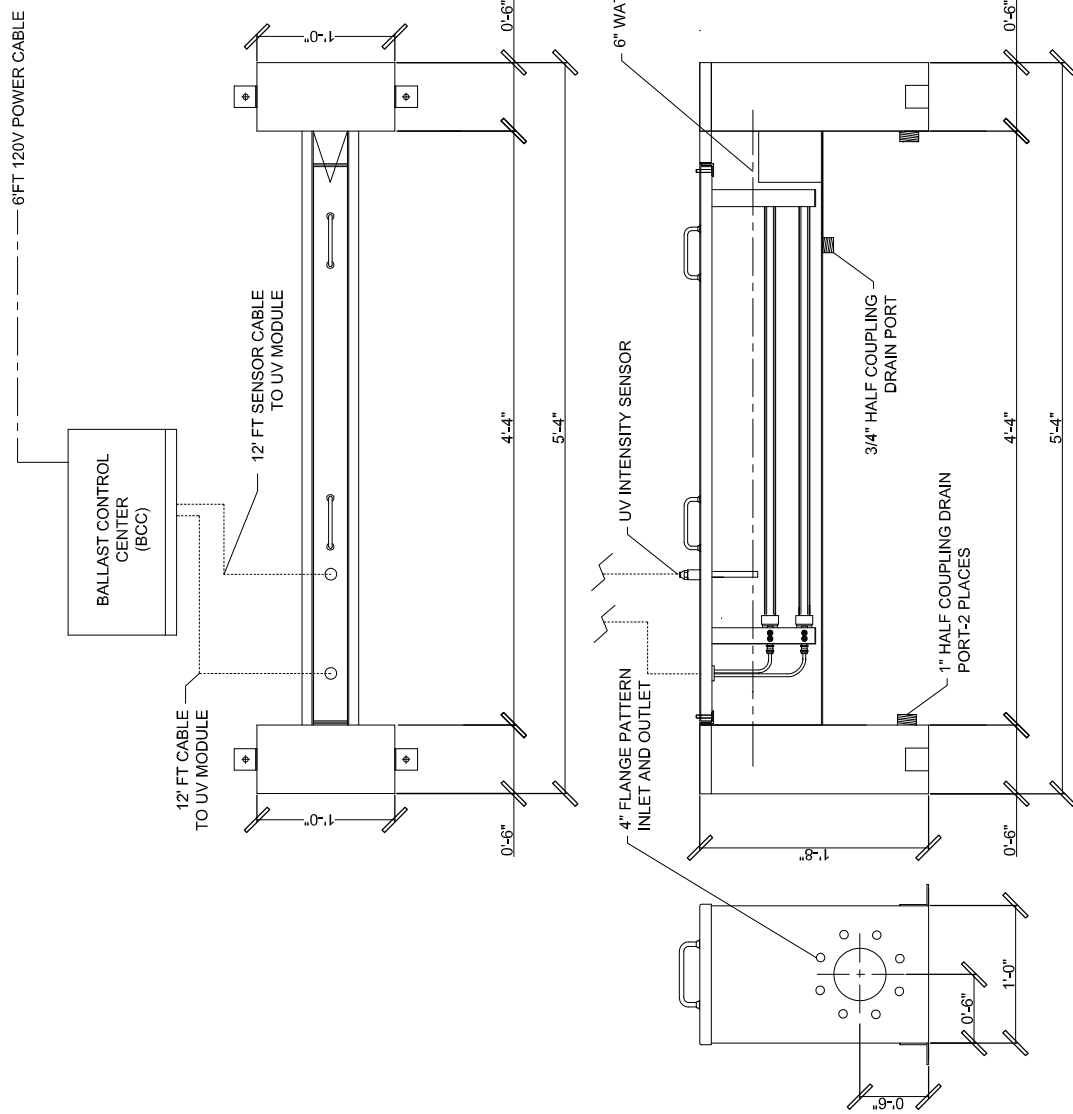

GLASCO UV LLC 311 Industrial Blvd., North Plainfield, NJ 07060 TEL: 908-545-5358 FAX: 908-545-5388	
TITLE GLOW-300-1-2 EQUIPMENT LAYOUT	
DESIGNED BY [Blank] CHECKED BY [Blank]	DATE 9/28/13
SCALE NONE	SHEET 1 OF 1

GLOW 300 & 5000 SERIES

Wastewater Disinfection - Horizontal Channel



GLASCO UV



OVERVIEW

Ultraviolet “UV” open channel disinfection is an accepted method for reducing microorganisms in wastewater.

The **GLOW** package treatment plant systems utilize horizontal open channels to disinfect flows up to **500,000 GPD** (larger systems are available).

Wastewater enters the channel and once inside, it is exposed to UV light. The UV lamp used for germicidal disinfection produces the majority of its light in the 254-nm wavelength. At this wavelength, UV light destroys bacteria, protozoa, viruses, molds, algae and other microbes. This includes fecal coliform and such waterborne diseases as: E-coli, hepatitis, cholera, as well as many others.

Systems integrate energy efficient low-pressure high-output UV lamps. These lamps last over 12,000 hours and produce over 90% of their light in the 254 nm range.

FEATURES

- Stainless steel channel with transition boxes
- Built in level control weir with drain
- Low-pressure high-output UV lamps
- Flexible flange connection sizes
- Remote Thermoplastic electrical enclosures with protective window kits
- Lamp status LEDs
- Non-resettable digital run time
- UV monitoring
- On/Off and H/O/A switches

OPTIONS

- Stainless steel liner for concrete
- Automatic quartz cleaning
- Stainless support brackets for concrete
- Programmable Logic Controls (PLC)
- Flow monitoring flume box



Up to 500,000 GPD

WASTEWATER SYSTEM DESIGN

The following is a list of information required to size a horizontal open channel system:

- Peak instant flow rate
- No flow situations (decant and if decant is 100%)
- Discharge permit in ???/100 ml sample
- UV transmission %
- Total Suspended Solids (TSS)
- Biological Oxygen Demand (BOD)
- Total Dissolved Solids (TDS)
- Iron and Manganese levels
- Installation location (indoor or outdoor - remote)
- Understanding of plant treatment process
- Staffing level for system maintenance


OPERATIONAL OVERVIEW

The **GLOW 300 & 5000** Series comes with a packaged stainless steel channel and transition boxes.

Disinfection modules are installed horizontally in the channel. Modules connect to a remote thermoplastic Ballast Control Center (BCC) via 10 ft waterproof cables.

A UV sensor reads the output of a single lamp and displays the output in % or mWs.cm². Lamp operational status in the form of LEDs, system run time and UV monitor are displayed under a protective window kit.

Lamps need to be replaced every 12,000 hours. Due to the harsh nature of wastewater, the quartz sleeves (the protective glass-like tubes that protect the lamps) need to be cleaned. Fouled quartz prevents the UV light from penetrating and will reduce system efficiency. Modules need to be hand cleaned on a periodic basis with a product that removes calcium, rust or lime.

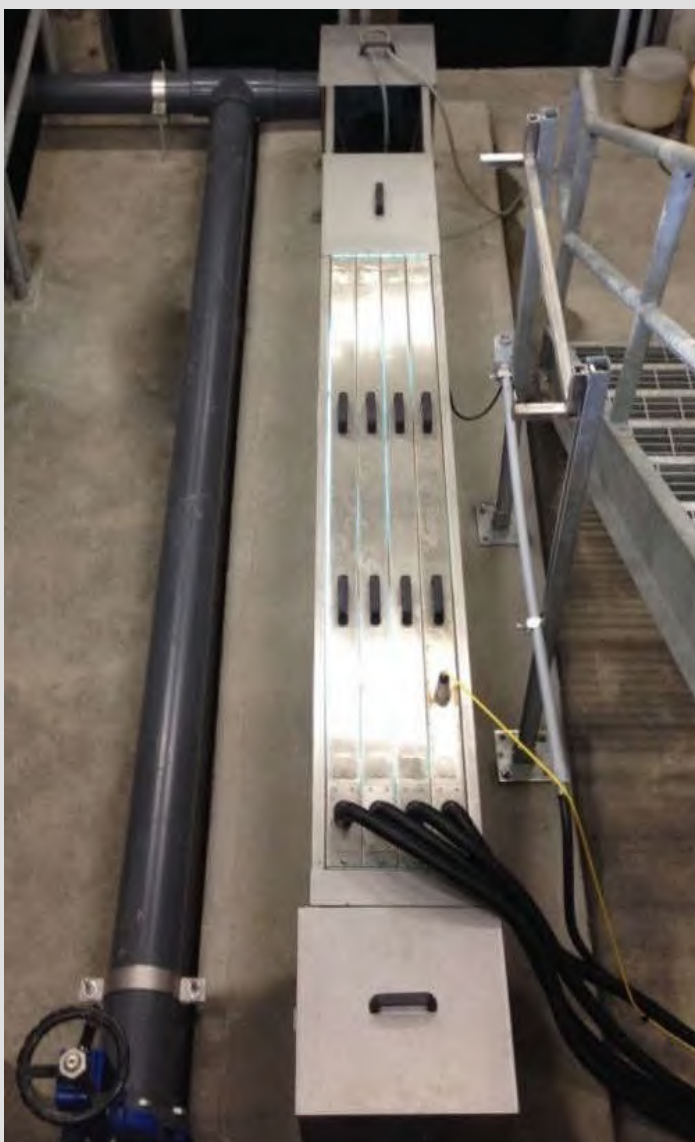

Modules connect to BCC via IP65 waterproof connectors



Lamps are protected by quartz sleeves. Hand tightened oring seal



CONFIGURATIONS

Piping to and from the channels can cause issues due to spatial constraints and existing piping. The use of concrete pits also can cause some installation issues.

We offer flexibility when designing by allowing custom flange sizes and locations.

Channels can be provided as:

- Single standalone stainless with inlet boxes
- Dual banks in series standalone with boxes
- "U" turn with dual banks and turn box
- Stainless steel embedded liner (concrete)

Ballast Control Center (BCC) will be remotely located within 8 to 10 feet. Discuss with factory prior to designing. BCC can be supplied in various voltages.




GLOW-300-1-2



"U" Turn Channel

Free standing channel with transition connections

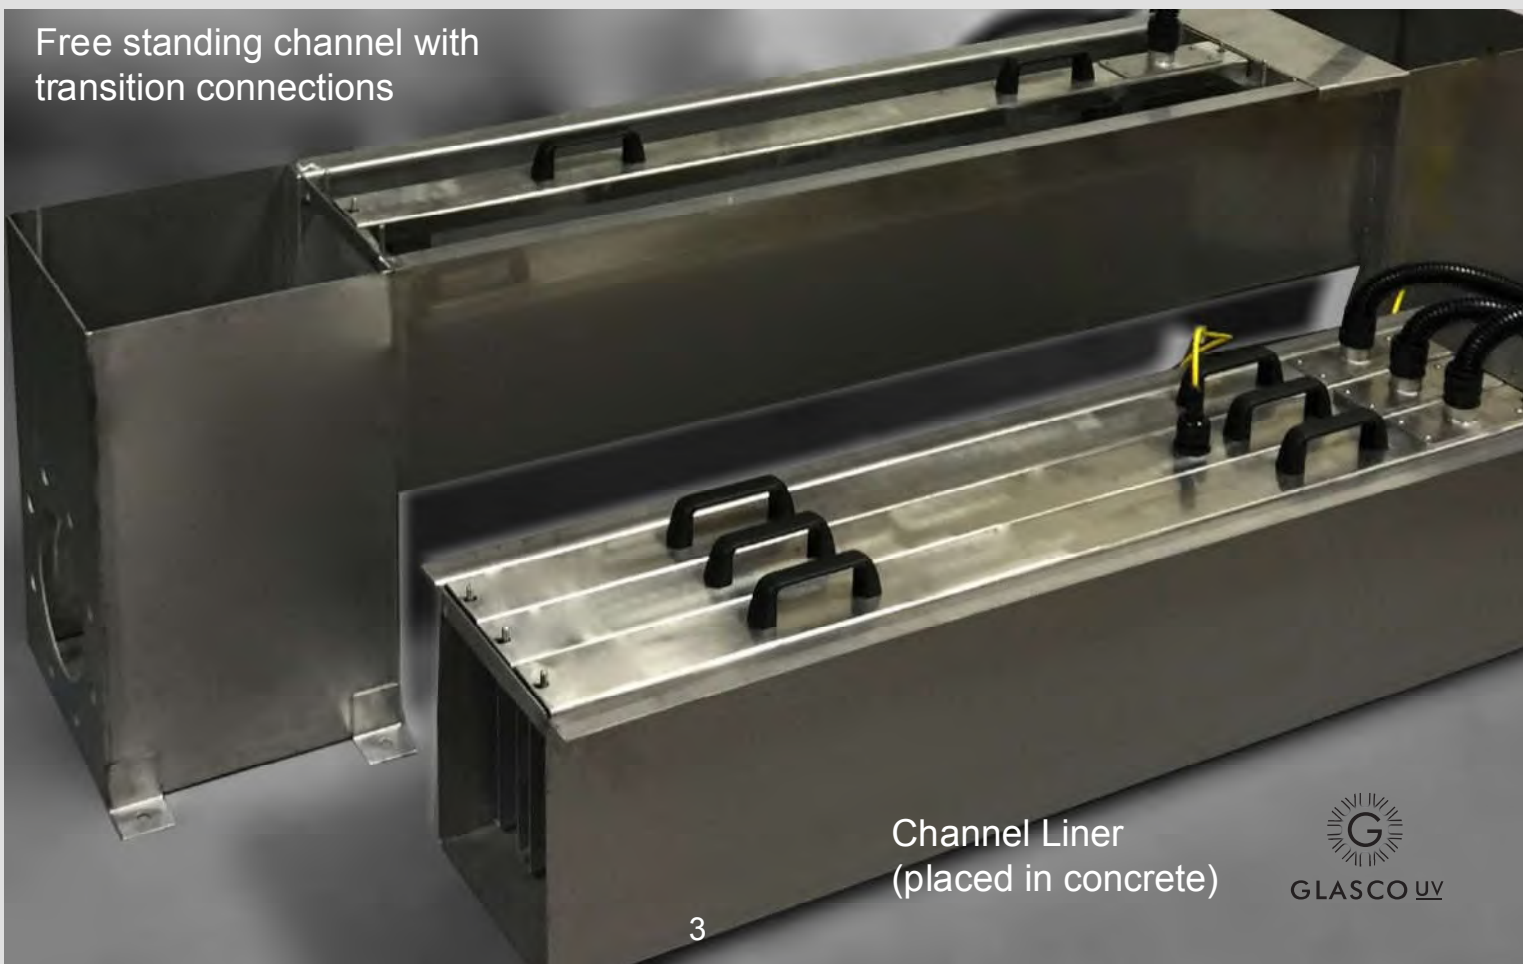

Channel Liner
(placed in concrete)



BALLAST CONTROL CENTERS

GLOW horizontal systems come with remote NEMA 4x modified thermoplastic fan cooled enclosures with window kit for outdoor usage. The Ballast Control Center (BCC), houses the electronic ballasts and controls needed to operate the UV lamps.

The ballasts provide the required voltage to ignite the mercury vapor UV lamps. Ballasts regulate the amount of electricity flowing through the lamp so the right amount of UVC light is emitted.

In addition to powering the lamps, the BCC displays lamp status, a non-resettable run time meter and UV output under a Lexan window kit. BCC comes standard with an On/Off switch and a Hand/Off/Auto (HOA) switch for remote control.

A UV sensor reads the lamp's output. The display shows the status from 0 to 100% or can provide the actual UV output. System provides a 4-20 mA output upon an alarm.



Unit Name	Flow Rate GPD	Flow Rate M3/day	Watts	Channel Dimensions	BCC Dimensions
GLOW-300-1-2	40,000	151	170	70" x 9" x 14"	20" x 16" x 9"
GLOW-300-2-2	80,000	303	340	76" x 12" x 20"	20" x 16" x 9"
GLOW-300-3-2	120,000	454	510	76" x 12" x 20"	24" x 24" x 9"
GLOW-5000-2-2	250,000	946	680	136" x 20" x 20"	20" x 16" x 9"
GLOW-5000-3-2	400,000	1514	1020	136" x 20" x 20"	20" x 16" x 9"
GLOW-5000-4-2	500,000	1893	1360	144" x 24" x 20"	24" x 24" x 9"

* Dimensions are approximate and may be changed without notice. Sizing is based on bioassay data at end of lamp life 65% UVT, and a dosage of 30 mJ for projects requiring 126-200/100 ml. Bioassay as by HydroQual. Sizing is based on 90% end of lamp life and 90% quartz sleeve fouling. Many projects have specific requirements regarding dosages and redundancy. Contact factory for sizing.

Systems operate on 120 volt (220 available). These system will be provided with a plug that is 5 feet. UV lamps will last over 1 year of continuous operation. Some plants see up to 16,000 hours. Max distance from module to BCC is 10 feet (accommodations can be made for longer distances).

HORIZONTAL UV REDUNDANCY



HORIZONTAL TYPES

- Packaged stainless with inlet and outlet boxes.
- Stainless steel liner inserted into concrete.
- Pre poured concrete



Horizontal UV Disinfection systems are popular for treating smaller flows. While they can treat unlimited flows, we generally see these in applications of 5 MGD and lower.

Due to different local requirements for redundancy, engineers are tasked with providing a system that meets regulations.

The horizontal orientation allows for a pre packaged stainless steel channel with inlet and outlet boxes, a stainless steel insert to be embedded into concrete or directly into concrete using brackets.

For redundancy, the following are available:

- Parallel (side by side)
- In-series
- "U" configuration

SIDE BY SIDE / PARALLEL

Each unit can be 50% or 100% redundant. They are piped to and from and have internal level control system. This can be done with standalone channels, channel inserts or concrete channels.



“U” TURN

Each bank can be 50% or 100% redundant. They are piped to and from and have internal level control system in the 2nd bank. This can be done with standalone channels, channel inserts or concrete channels.



IN SERIES

Each bank can be 50% or 100% redundant. They are piped to and from and have internal level control system in the 2nd bank. This can be done with standalone channels, channel inserts or concrete channels.



Attachment E- Influent Laboratory Report

O & M ENTERPRISES

92-7091 ELELE ST.
KAPOLEI, HI. 96707
FAX: (808) 672-6247
CELL: (808) 721-4866
OFFICE: (808)-672-6247

July 12, 2022

Ms. Sina Pruder
Chief Wastewater Branch
P.O Box 3378
Honolulu, Hawaii 96801

Ms. Pruder

Subject: Ono Vista Apartments Permit # 225 Report for January 1, 2022 to June 30, 2022.

The plant has one significant issue during the period. The Injection Wells are failing requiring extra pumping from plant.

If you have any questions, please call Wade Thode at 808-721-4866.

Sincerely



Wade Thode



HAWAII FOOD & WATER TESTING LLC

2688 Kilihau St. #B
Honolulu, HI 96819

Phone: (808) 836-5558
E-mail: lab@hfw.com

LABORATORY ANALYSIS REPORT

O&M Enterprises
92-7091 Elele St.
Kapolei, HI 96707

Case No. 117
Received 06-09-2022
Analyzed 06-09-2022
Completed 06-14-2022

Sample Type: Wastewater

Sampled on 06-08-2022

Sampled by: Wade Thode

Lab No.	Sample ID	Sample Time	BOD-5 mg/L	TSS mg/L
362	Ono Vista (OV)	15:40	10.5	15.4

Method Reference:

Minimum Detection Level:

Biochemical Oxygen Demand: EPA 405.1; MDL 1.0 mg/L

Total Suspended Solids: EPA 160.2; MDL 1.0 mg/L

Approved by:

Wendy Minor, June 17, 2022

Disclaimer: We warrant the above analysis was performed in good faith, using methods which are considered Standard Methods, or using methods previously agreed upon by the client. No other warranty is expressed or implied by this laboratory report. All sample results pertain only to the sample(s) analyzed. This test report shall not be reproduced except in full, without written approval of the laboratory.



HAWAII FOOD & WATER TESTING LLC

2688 Kilihau St. #B
Honolulu, HI 96819

Phone: (808) 836-5558
E-mail: lab@hfwat.com

LABORATORY ANALYSIS REPORT

O&M Enterprises
92-7091 Elele St.
Kapolei, HI 96707

Case No. 116
Received 05-11-2022
Analyzed 05-11-2022
Completed 05-16-2022

Sample Type: Wastewater

Sampled on 05-10-2022

Sampled by: Wade Thode

Lab No.	Sample ID	Sample Time	BOD-5 mg/L	TSS mg/L
347	Ono Vista (OV)	14:30	20.0	20.7

Method Reference:

Minimum Detection Level:

Biochemical Oxygen Demand: EPA 405.1; MDL 1.0 mg/L

Total Suspended Solids: EPA 160.2; MDL 1.0 mg/L

Approved by:

Wendy Minor, May 18, 2022

Disclaimer: We warrant the above analysis was performed in good faith, using methods which are considered Standard Methods, or using methods previously agreed upon by the client. No other warranty is expressed or implied by this laboratory report. All sample results pertain only to the sample(s) analyzed. This test report shall not be reproduced except in full, without written approval of the laboratory.



HAWAII FOOD & WATER TESTING LLC

2688 Kilihau St. #B
Honolulu, HI 96819

Phone: (808) 836-5558
E-mail: lab@hfw.com

LABORATORY ANALYSIS REPORT

O&M Enterprises
92-7091 Elele St.
Kapolei, HI 96707

Case No. 114
Received 04-06-2022
Analyzed 04-07-2022
Completed 04-12-2022

Sample Type: Wastewater

Sampled on 04-05-2022

Sampled by: Wade Thode

Lab No.	Sample ID	Sample Time	BOD-5 mg/L	TSS mg/L
339	Ono Vista (OV)	14:00	15.0	19.2

Method Reference:

Minimum Detection Level:

Biochemical Oxygen Demand: EPA 405.1; MDL 1.0 mg/L

Total Suspended Solids: EPA 160.2; MDL 1.0 mg/L

Approved by:

Wendy Minor, April 12, 2022

Disclaimer: We warrant the above analysis was performed in good faith, using methods which are considered Standard Methods, or using methods previously agreed upon by the client. No other warranty is expressed or implied by this laboratory report. All sample results pertain only to the sample(s) analyzed. This test report shall not be reproduced except in full, without written approval of the laboratory.



HAWAII FOOD & WATER TESTING LLC

2688 Kilihau St. #B
Honolulu, HI 96819

Phone: (808) 836-5558
E-mail: lab@hfw.com

LABORATORY ANALYSIS REPORT

O&M Enterprises
92-7091 Elele St.
Kapolei, HI 96707

Case No. 113
Received 03-02-2022
Analyzed 03-02-2022
Completed 03-07-2022

Sample Type: Wastewater

Sampled on 03-01-2022

Sampled by: Wade Thode

Lab No.	Sample ID	Sample Time	BOD-5 mg/L	TSS mg/L
333	Ono Vista (OV)	14:40	45.0	12.6

Method Reference:

Minimum Detection Level:

Biochemical Oxygen Demand: EPA 405.1; MDL 1.0 mg/L

Total Suspended Solids: EPA 160.2; MDL 1.0 mg/L

Approved by:

Wendy Minor, March 11, 2022

Disclaimer: We warrant the above analysis was performed in good faith, using methods which are considered Standard Methods, or using methods previously agreed upon by the client. No other warranty is expressed or implied by this laboratory report. All sample results pertain only to the sample(s) analyzed. This test report shall not be reproduced except in full, without written approval of the laboratory.



HAWAII FOOD & WATER TESTING LLC

2688 Kilihau St. #B
Honolulu, HI 96819

Phone: (808) 836-5558
E-mail: lab@hfw.com

LABORATORY ANALYSIS REPORT

O&M Enterprises
92-7091 Elele St.
Kapolei, HI 96707

Case No. 112
Received 02-03-2022
Analyzed 02-03-2022
Completed 02-08-2022

Sample Type: Wastewater

Sampled on 02-02-2022

Sampled by: Wade Thode

Lab No.	Sample ID	Sample Time	BOD-5 mg/L	TSS mg/L
329	Ono Vista (OV)	14:40	41.0	13.8

Method Reference:

Minimum Detection Level:

Biochemical Oxygen Demand: EPA 405.1; MDL 1.0 mg/L

Total Suspended Solids: EPA 160.2; MDL 1.0 mg/L

Approved by:

Wendy Minor, February 09, 2022

Disclaimer: We warrant the above analysis was performed in good faith, using methods which are considered Standard Methods, or using methods previously agreed upon by the client. No other warranty is expressed or implied by this laboratory report. All sample results pertain only to the sample(s) analyzed. This test report shall not be reproduced except in full, without written approval of the laboratory.



HAWAII FOOD & WATER TESTING LLC

2688 Kilihau St. #B
Honolulu, HI 96819

Phone: (808) 836-5558
E-mail: lab@hfw.com

LABORATORY ANALYSIS REPORT

O&M Enterprises
92-7091 Elele St.
Kapolei, HI 96707

Case No. 110
Received 01-06-2022
Analyzed 01-07-2022
Completed 01-12-2022

Sample Type: Wastewater

Sampled on 01-05-2022

Sampled by: Wade Thode

Lab No.	Sample ID	Sample Time	BOD-5 mg/L	TSS mg/L
320	Ono Vista (OV)	14:40	22.0	20.0

Method Reference:

Minimum Detection Level:

Biochemical Oxygen Demand: EPA 405.1; MDL 1.0 mg/L

Total Suspended Solids: EPA 160.2; MDL 1.0 mg/L

Approved by:

Wendy Minor, January 13, 2022

Disclaimer: We warrant the above analysis was performed in good faith, using methods which are considered Standard Methods, or using methods previously agreed upon by the client. No other warranty is expressed or implied by this laboratory report. All sample results pertain only to the sample(s) analyzed. This test report shall not be reproduced except in full, without written approval of the laboratory.

Attachment F- BWS Billing and Consumption Data

\$678.48-	
Outstanding Balance	
\$0.00	
CURRENT CHARGES	
Electric Service G General Service	
Customer Charge	\$63.00
Non-Fuel Energy Charge	\$145.94
RBA Rate Adjustment	\$29.01
Renewable Infrastructure Pgm	\$0.26
IRP Cost Recovery	\$0.56-
PBF Surcharge	\$6.20
Energy Cost Recovery	\$451.78
Purchased Power Adjustment	\$24.74
Green Infrastructure Fee	\$1.28
<hr/>	
Total for Current Charges	\$721.65

From: Ginger Gertsch
Sent: Friday, November 18, 2022 4:42 PM
To: Randall Duldulao <randall@lauleallc.com>; Chentelle Brooks <Chentelle@assiahawaii.com>; evfogarty@gmail.com; saradawright@gmail.com; torentino_v@aya.yale.edu; adam.griswold@gmail.com; jakostck11@gmail.com
Cc: Wesley Wong <wesley@lauleallc.com>
Subject: RE: Preliminary Engineering Report (PER) Questionnaire- 1. with snippet OCT 28TH BILL
Importance: High

Meter No. 2007100326 Curr Rdg: 1684,000 Prev Rdg: 1515,000 Cons: 169,000 thousand gals
Meter No. 2007100304 Curr Rdg: 1507,000 Prev Rdg: 1354,000 Cons: 153,000 thousand gals
Multi-Family Water Charges 09/28/2022 to 10/28/2022
 Tier 1 - 128 Kgals @ \$3.77 482.56
 Tier 2 - 128 Kgal @ \$4.43 567.04
 Tier 3 - 66 Kgal @ \$5.03 331.98
 Customer Charge at Meter Size Two 2 inch 86.90

Water Usage Profile			
DATE	THOUS. GAL.	DAYS	WATER CHARGES
10/28/2022	322	31	\$1,468.48
09/27/2022	291	30	\$1,312.55
06/28/2022	360	31	\$1,659.62
07/28/2022	272	30	\$1,199.70
06/28/2022	294	31	\$1,309.26
06/28/2022	377	29	\$1,722.60
04/29/2022	499	31	\$2,330.16
03/29/2022	474	29	\$2,205.66
02/28/2022	355	28	\$1,613.04
01/31/2022	453	32	\$2,101.08
12/30/2021	379	31	\$1,732.56
11/29/2021	499	31	\$2,330.16
10/29/2021	410	31	\$1,886.94

Kind return bottom portion with your payment.

APPENDIX D

UIC Injection Well Status Report

**UIC INJECTION WELL STATUS REPORT
UIC PERMIT NO. UO-1305**

MONITORING PERIOD:

SEPTEMBER 2021 THROUGH AUGUST 2022

FACILITY:

**ONO VISTA CONDOMINIUMS
68-024 APUHIHI STREET
WAIALUA, HAWAII 96791
TMK: (1) 6-8-011: 058**

DATE:

SEPTEMBER 7, 2022

Prepared for:

Zach Esparza, President
AOAO Ono Vista
69-090 Au Street, E305
Waialua, HI 96791
esparazach@gmail.com
(314) 775-3878

Prepared by:

McNulty Civil Engineering
67-335 Kaiea Place
Waialua, Hawaii 96791

Mr. Gaudencio Lopez, P.E., Chief
Safe Drinking Water Branch
2385 Waimano Home Road
Uluakupu Building 4
Pearl City, HI 96782

September 7, 2022
Job No. 22-1041

**Re: UIC Injection Well Status Report
UIC Permit No. UO-1305
Ono Vista Apartments
68-024 Apuhihi St.
Waialua, HI 96791**

1.0 INTRODUCTION

McNulty Civil Engineering (MCE) is pleased to present this letter report describing the status of the three permitted Underground Injection Control (UIC) wells accepting treated effluent from the Ono Vista Condominium located in Waialua, Hawaii. This status report is for the monitoring period of September 2021 to August 2022 and has been prepared in accordance with State of Hawaii Department of Health UIC Injection Well Status Report Guidelines, October 1999.

2.0 BACKGROUND

Three injection wells are currently used for the disposal of the treated effluent from the Ono Vista Condominium wastewater treatment plant. They are located on the Haleiwa side of the swimming pool and the treatment plant, in the parking lot. The treatment plant is an activated sludge plant with a pre-loader, an activated sludge tank, a clarifier, and a chlorine contact chamber. The treatment plant was installed in the 1970's. The plant services two apartment buildings with 32 units in each building. The plant is permitted for a maximum injection quantity of 22,400 gallons per day (gpd). The UIC Permit to Operate will expire on July 29, 2024, and should be renewed six months prior to expiration.


Site Location

The facility is located on the makai side of Waialua Beach Road. One apartment building fronts Apuhihi Street and the other building fronts Au Street. The complex is in the middle of the block. Private residences and other apartments are in the surrounding area. The Pacific Ocean is located approximately 600 feet north of the site.

VICINITY & LOCATION MAP



VICINITY MAP
NOT TO SCALE

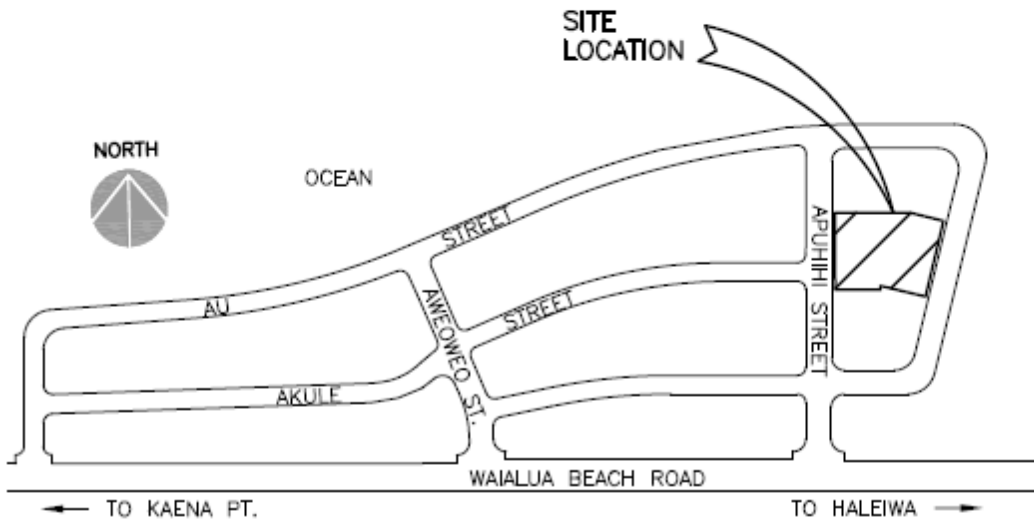

LOCATION MAP
NOT TO SCALE

PROJECT: ONO VISTA CONDOMINIUMS
UIC PERMIT NO.: UO-1305
TMK: (1) 6-8-011: 058

MCNULTY CIVIL ENGINEERING
67-335 KAIEA PLACE
WAIALUA, HI 96791

Topography

The topography of the site is flat, residential, and suburban. The site is approximately 7.8 feet above mean sea level. The site has a pool in the middle area (between the parking lots and buildings) and is landscaped.

Geology

The site soils are of the Jaucas Series, which are excessively drained, calcareous soils that occur as narrow strips on coastal plains, adjacent to the ocean (soil designation JaC), (Foot, 1972). Permeability is rapid and run off is slow.

Hydrology

There are many irrigation wells in the area, left over from the Waialua Sugar Company. The nearest drinking water wells are located approximately two miles away toward Wahiawa. Dole Food operates them both.

The water table is approximately eight feet below grade and it is under a tidal influence.

3.0 OBSERVATIONS

Treatment System

The system begins with a lift station pumping to a pre-loader tank. The pre-loader gravity flows to the aeration chamber (approximately 32,000 gallons). The effluent from the chamber flows into a clarifier where the sludge is returned to the aeration tank. The effluent flows over a weir, in the clarifier, into the chlorine contact tank. Chlorination is accomplished by effluent passing over chlorine tablets in a basket. The effluent is pumped on demand by a mercury level switch to the well cellars of Well 1 (W-1), Well 2 (W-2), and Well 3 (W-3) via piping with gate valves. These wells then operate under gravity head. In case of pump failure an overflow pipe connects the contact chamber to W-2, which in turn overflows to the well cellar of W-3.

When we arrived on site there was no flow going into Well 1. When testing Well 2 the effluent flow was less than the usual 50 gallons per minute (gpm). We could not estimate the flow but noted that the turbulence from the effluent pipe was not as much as previous years. The overflow pipe to Well 3 was submerged. All the effluent had suspended matter and we could not see the bottom of the well cellars.

Weather

On August 24, 2022, the weather was light trade winds with 30% cloud cover.

Injection Wells

Each injection well is surrounded by an asphalt cement berm. The berms keep rainwater out of the wells. All measurements are from the top of cover (TOC) of the wells.

Injection Well 1 (W-1)

The access to the cellar is 19" x 19" covered by sheet metal and cellar is a standard storm drain manhole extending to 6' below TOC. The well has a 4" diameter stickup from the bottom of the well cellar. The stick up is 4.75' below TOC. The influent pipe of W-1 has a float valve that shuts off the influent when it rises to about 3 feet above the well cellar. When we arrived, the effluent was at the level of the stick-up and there was no flow. We could not see the bottom of the well cellar. The total depth of W-1 was measured at 51.50 feet. No sludge was detected. The depth to water was measured at 7.80 feet. Photographs of the wells are presented in the Attachments.

Injection Well 2 (W-2)

The well access/cellar is 3' by 1.5' by 7.6' deep made of concrete and bricks. It is covered with a sheet metal plate. A 4" well stickup pipe extends up from the bottom a few inches. An overflow pipe connects this well cellar to the well cellar of W-3. We suspect that this overflow pipe is 6". The well stick up was below the fluid level upon our arrival. The overflow pipe to Well 3 was below the fluid level. The depth of W-2 was not measured because the flow running past the stickup would wash the weighted tape away and we could not insert it into the stick up (we could not see the stick up but knew where it should be from the old photographs. The depth to water was measured at 1.90 feet.


Injection Well 3 (W-3)

The well access/cellar is 3' by 1.5' by 4.6' deep. The well cellar receives influent from the discharge pump. The delivery piping from the plant is 2½". Effluent gravity flows into the well (open to atmosphere). A pipe extension is loosely attached to the well stick up. This extension comes within 26" of the cover preventing W-3 from accepting most of the wastewater effluent. Some effluent apparently enters the well through the loose fit of the pipe extension. This well cellar is connected to the well cellar of W-2 by the 6" overflow pipe. As with W-2, the fluid level was above the

WELL LOCATION MAP

NORTH

Page 5

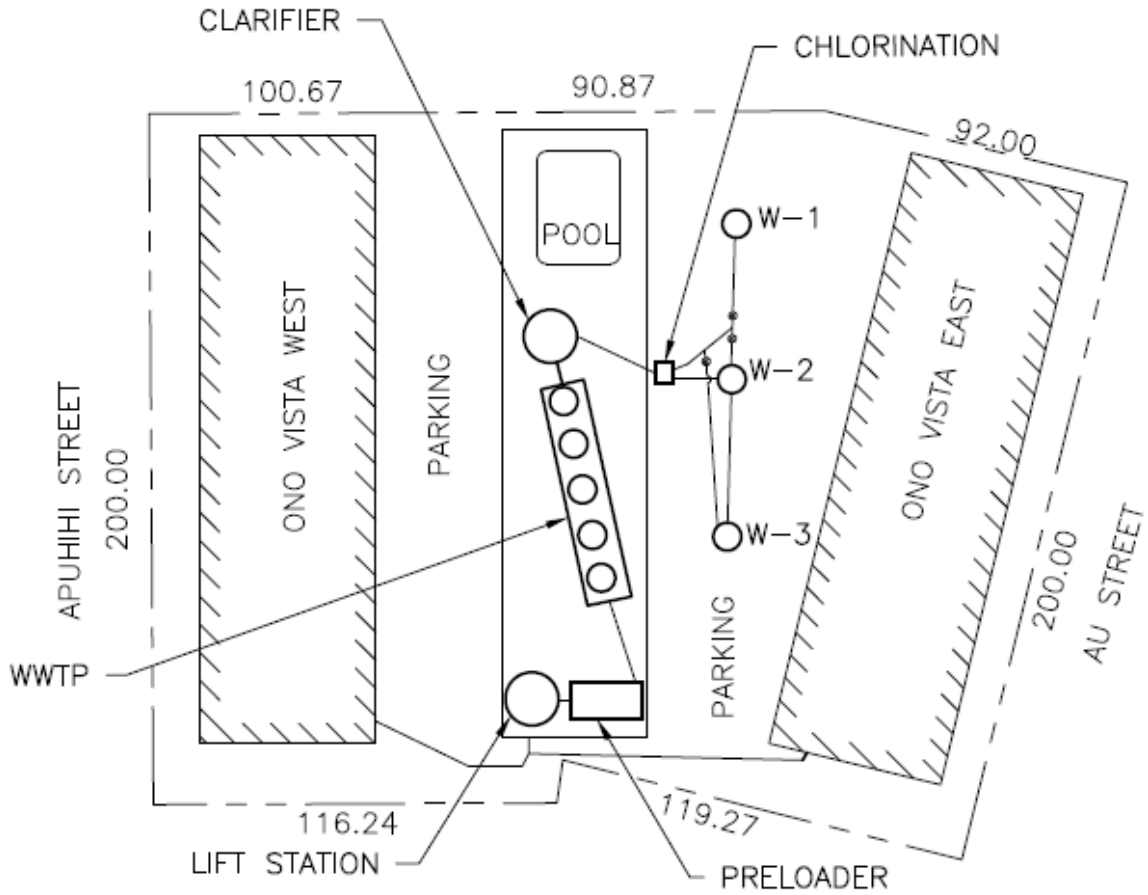

INJECTION WELL SITE PLAN

NOT TO SCALE

PROJECT: ONO VISTA CONDOMINIUMS
UIC PERMIT NO.: UO-1305
TMK: (1) 6-8-011: 058

MCNULTY CIVIL ENGINEERING
67-335 KAIEA PLACE
WAIALUA, HI 96791

overflow pipe. The depth to bottom of the well measured 44.00 feet. The depth to water was measured at 1.65 feet.

Effluent Water Quality

On August 24, 2022, the effluent had no odor, however the effluent was murky, full of suspended solids and we could not see the stick up or bottom of any of the well cellars.

Cleaning Events

This past year the wells were cleaned every two weeks. The cleaning consists of blowing the wells with compressed air (agitating the walls) while removing the agitated material with a vacuum truck.

Flow Evaluation

Utilizing a garden hose, a steady flow rate of 7.5 gallons per minute (gpm) was set to test the well capacities. Battery operated water level meters were used to record water levels. At 0930 we began testing W-1, we removed the testing water at 0950 and measured the well rebound for another 15 minutes

Next, we tested the W-2 with the 7.5 gpm flow while it was receiving flow from the plant. At 1035 we began testing W-3; we removed the testing water at 1100. There was a slight measurable difference in the level of the effluent during the time when we were adding the 7.5 gpm and the time when we were not adding the flow.

4.0 FINDINGS

The treatment plant, injection wells, wellheads, and related piping are in working order. There are no signs of leaks, corrosion, or mechanical malfunctions. Fine solids are overflowing into the wells.

W-1: The measured depth to the bottom of the well has regained its normal 51' depth. We measured a head build-up of 3.90 feet. There was a slight re-bound.

The water level in Wells 2 and 3 was less than 2' from grade. This is the highest measurement on record. During testing there was a slight rise in the liquid level of both wells and no rebound. Well 2 was receiving a less than 50 gpm flow from the plant. The depths of this well could not be measured. Well 3 measured 44.00' deep from grade. There was no obstruction in the well this year.

5.0 CONCLUSIONS

The wastewater treatment plant is receiving a high flow volume, possibly causing the overflow of some solids.

Well 1 has regained its normal 50' depth.

The bank of wells is accepting the daily flow from the plant. Effluent flowing into the well cellars is being adequately absorbed. The effluent is not overflowing and there are no signs of leaks in the parking lot.

6.0 RECOMMENDATIONS

- Continue the cleaning of the wells on a bi-weekly schedule; and
- If it has not already been done, install "low flow" fixtures in the units. This would include faucets, showers, and toilets.
- We understand that a new treatment plant and effluent disposal plans are being developed.

Please call me directly at 637-2460 if you have any questions or comments.

Sincerely,



Michael McNulty, P.E.



Attachments: Historical Head Build Up Graph
 Figures
 Tables
 Site Photographs

Historical Head Build Up
Ono Vista Condominiums



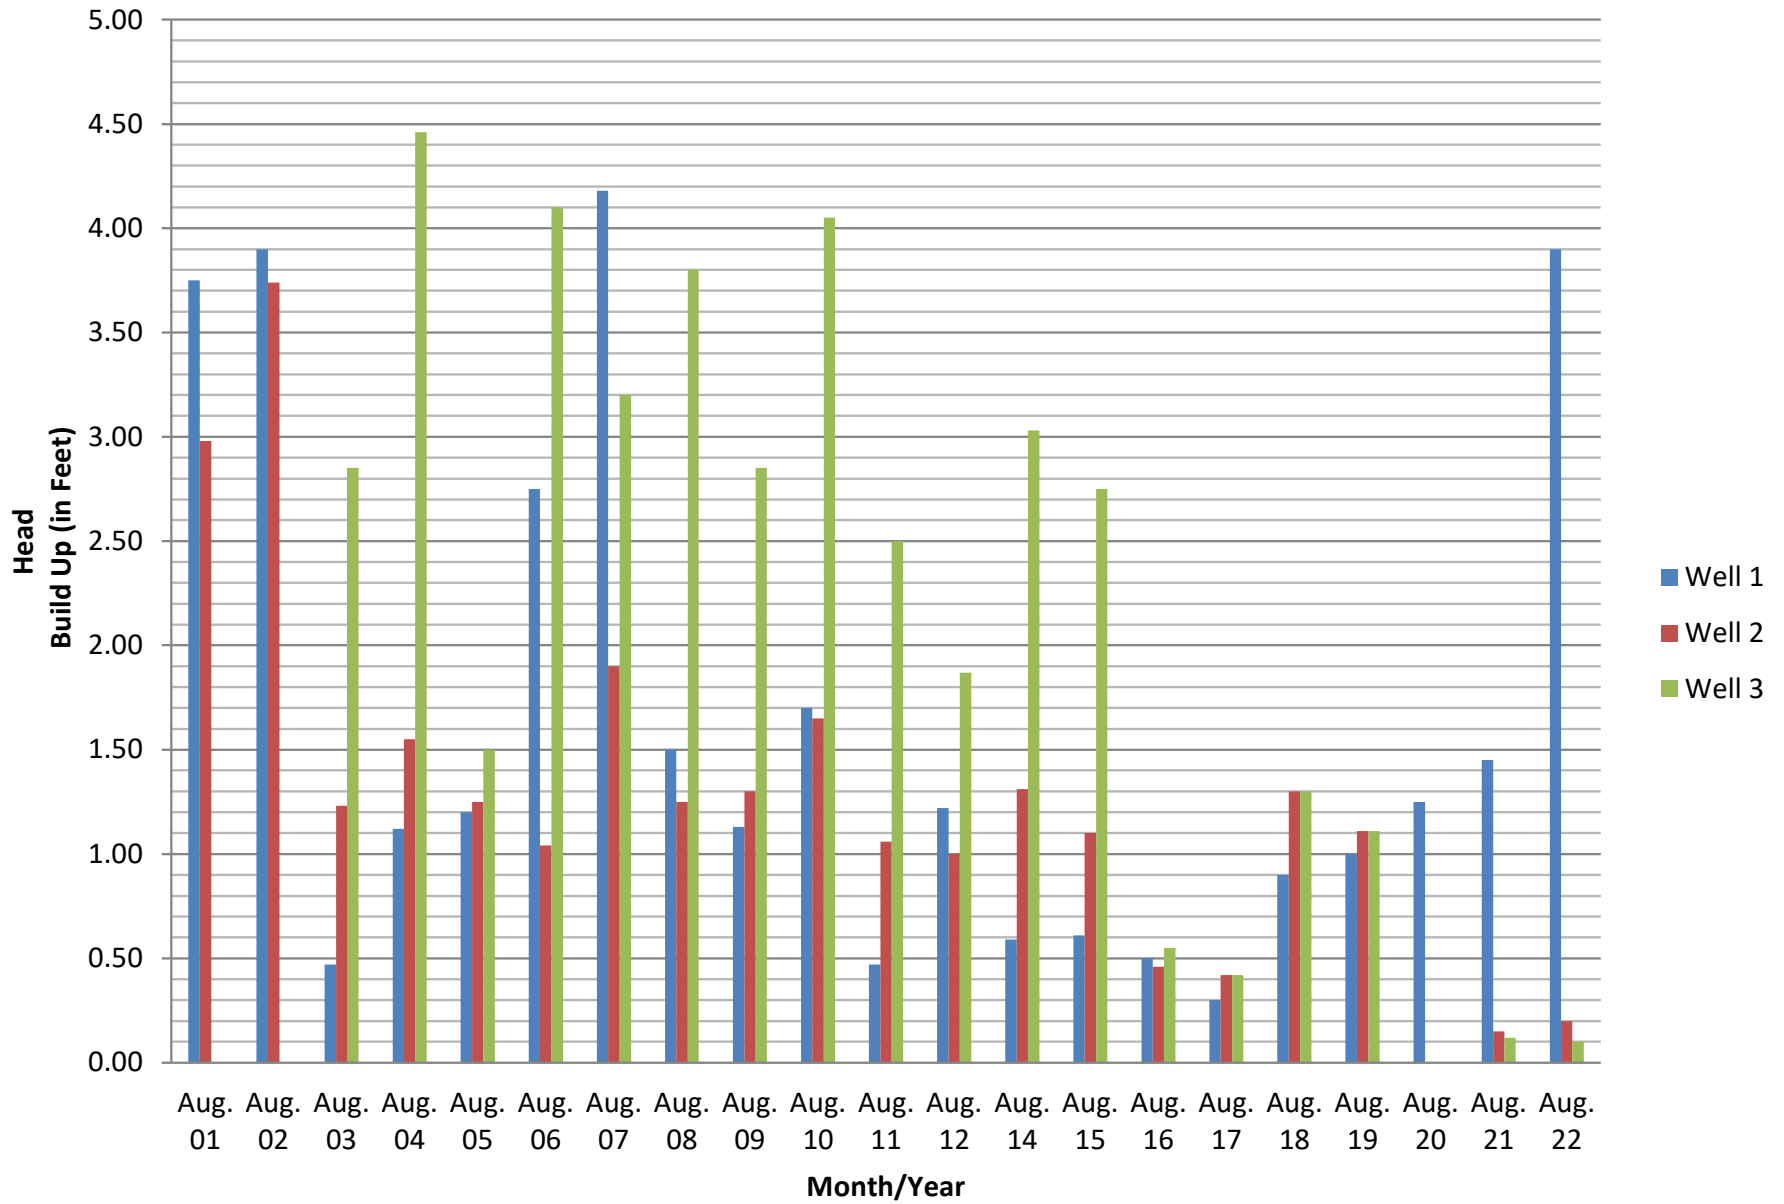


Figure1-Injection Curve for Well 1
Ono Vista Condominium
August 24, 2022

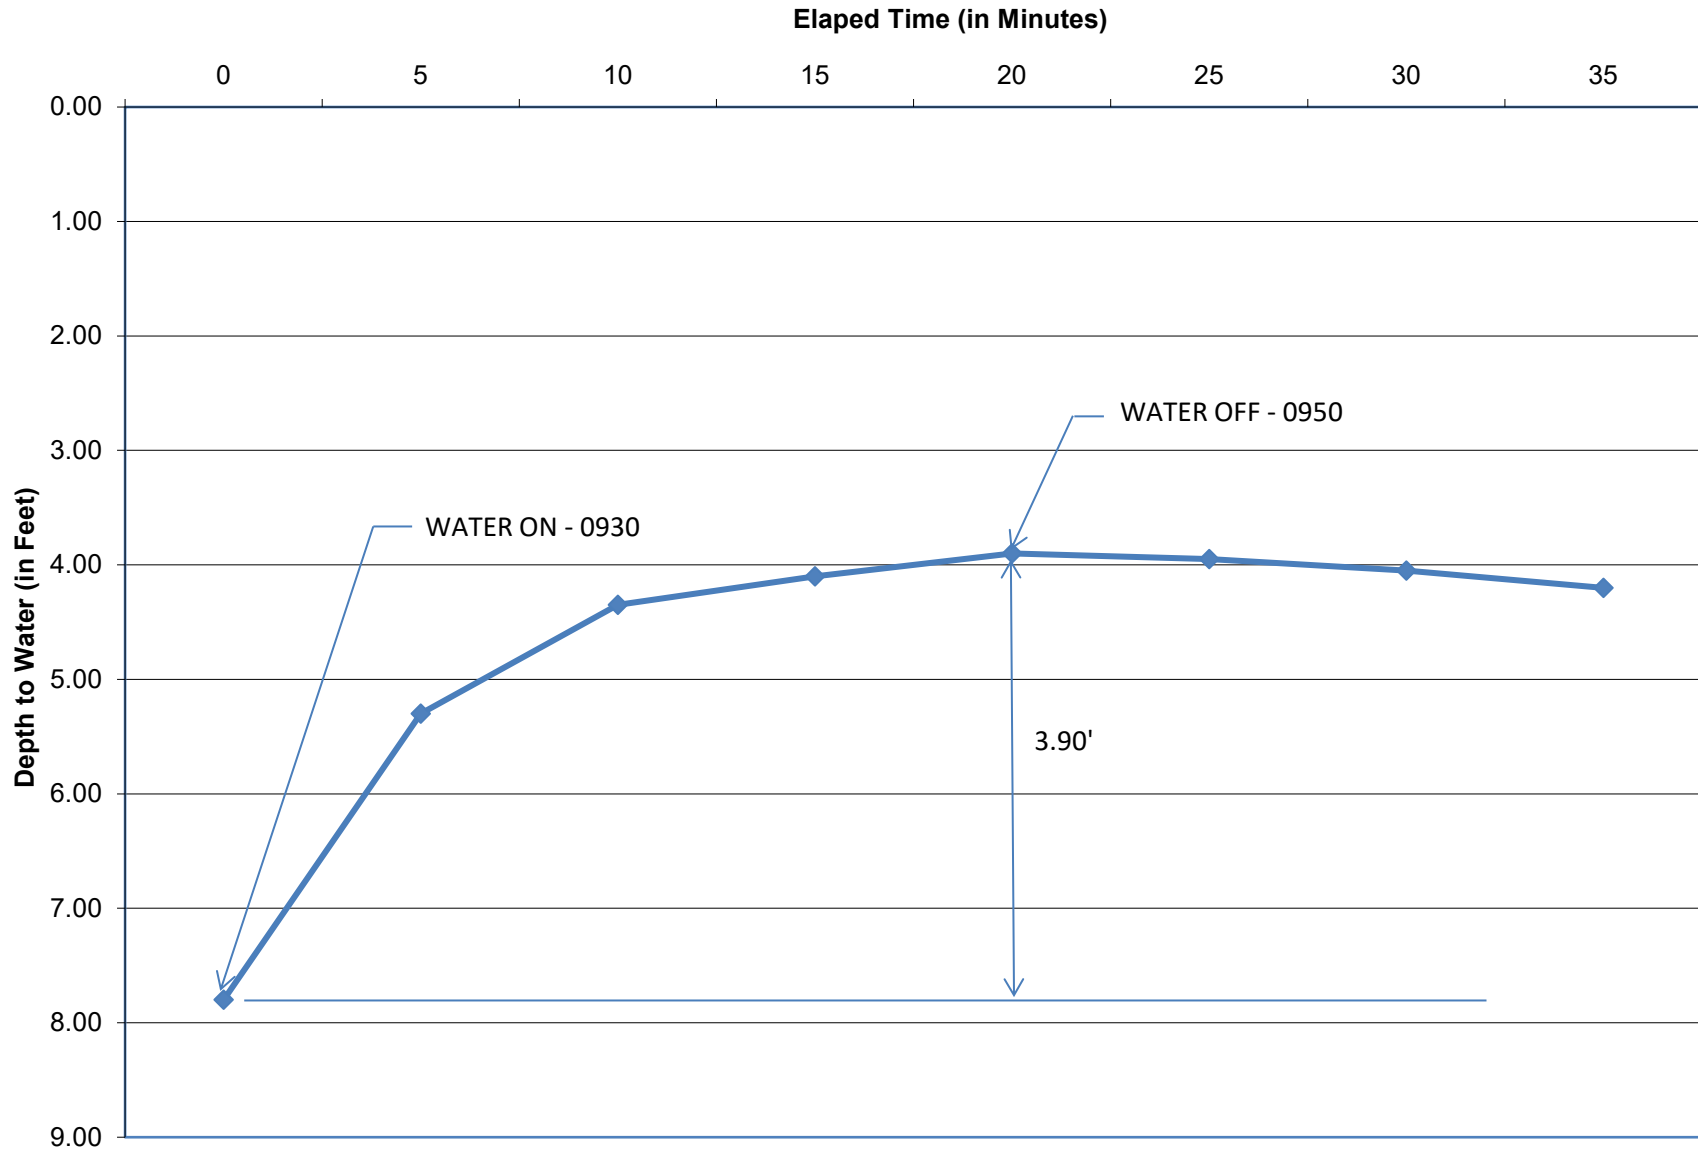


Note: 7.5 gpm injection rate.

Figure 2-Injection Curve for Well 2
Ono Vista Condominium
August 24, 2022

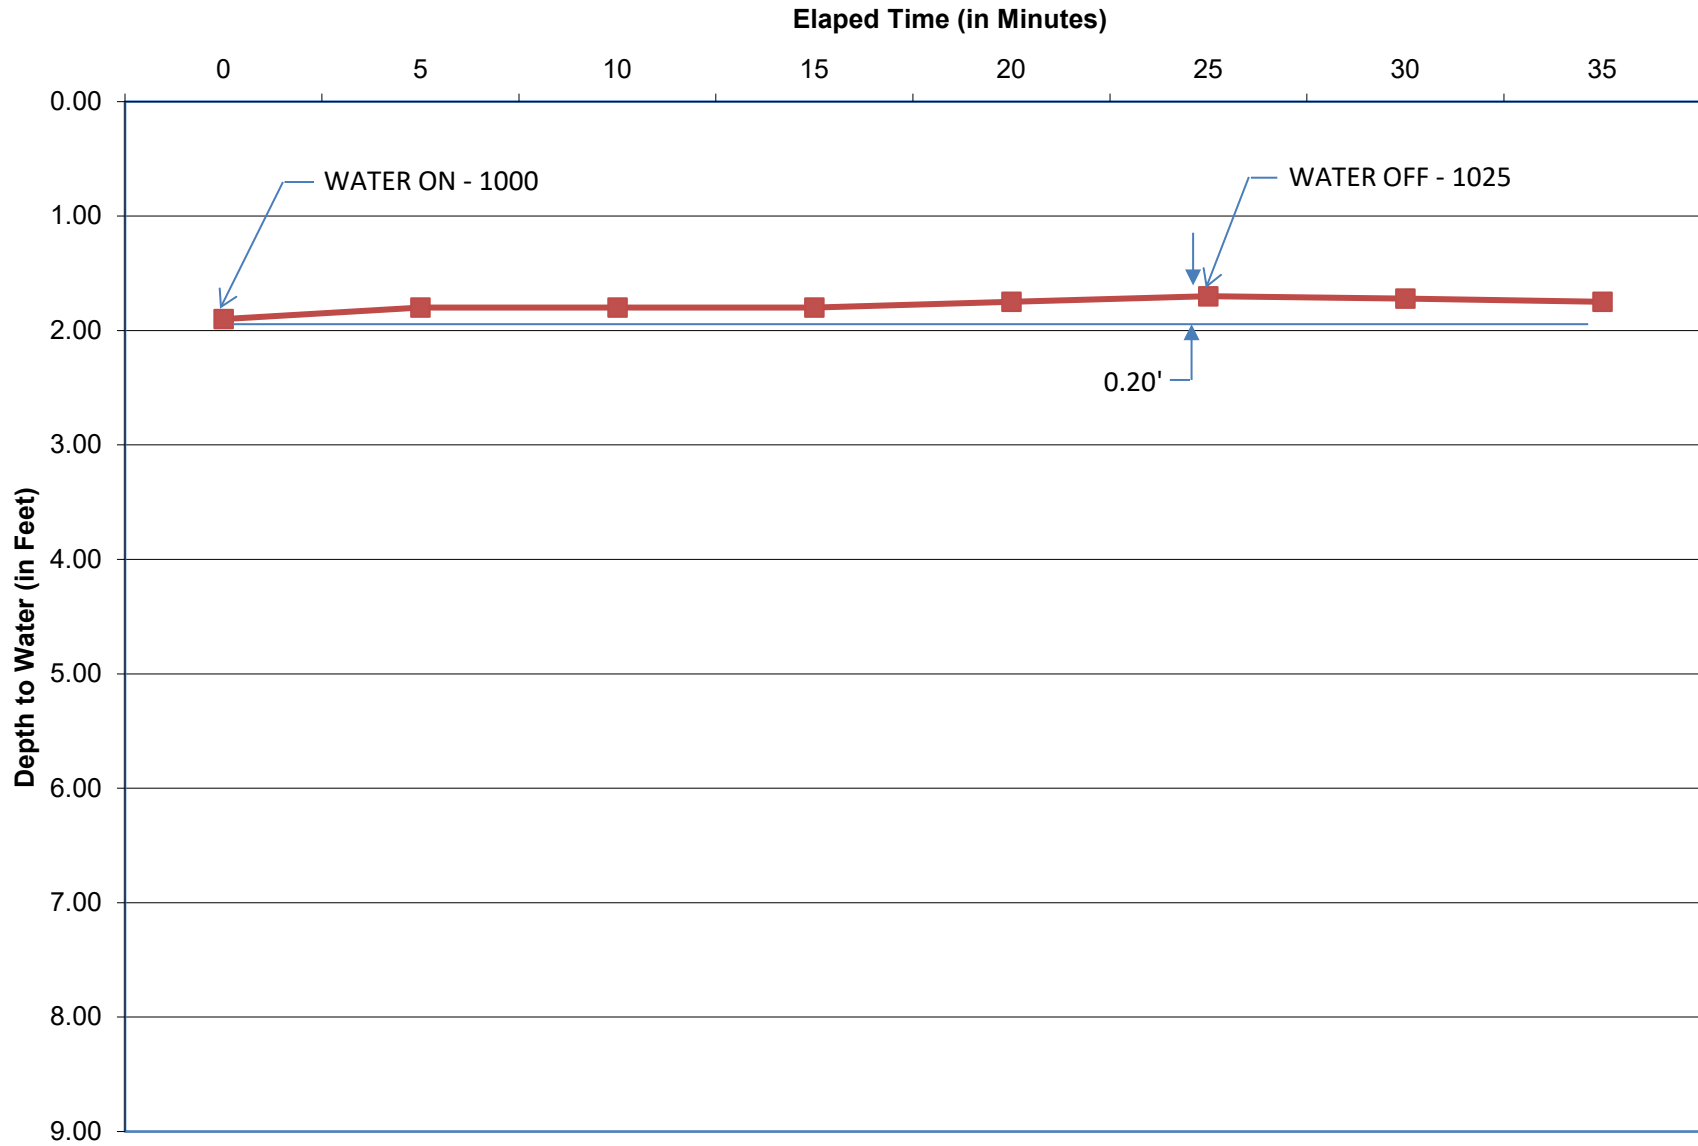

Note: W-2 tested w/ 50 gpm flow from plant into W-2

Figure 3-Injection Curve for Well 3
Ono Vista Condominium
August 24, 2022

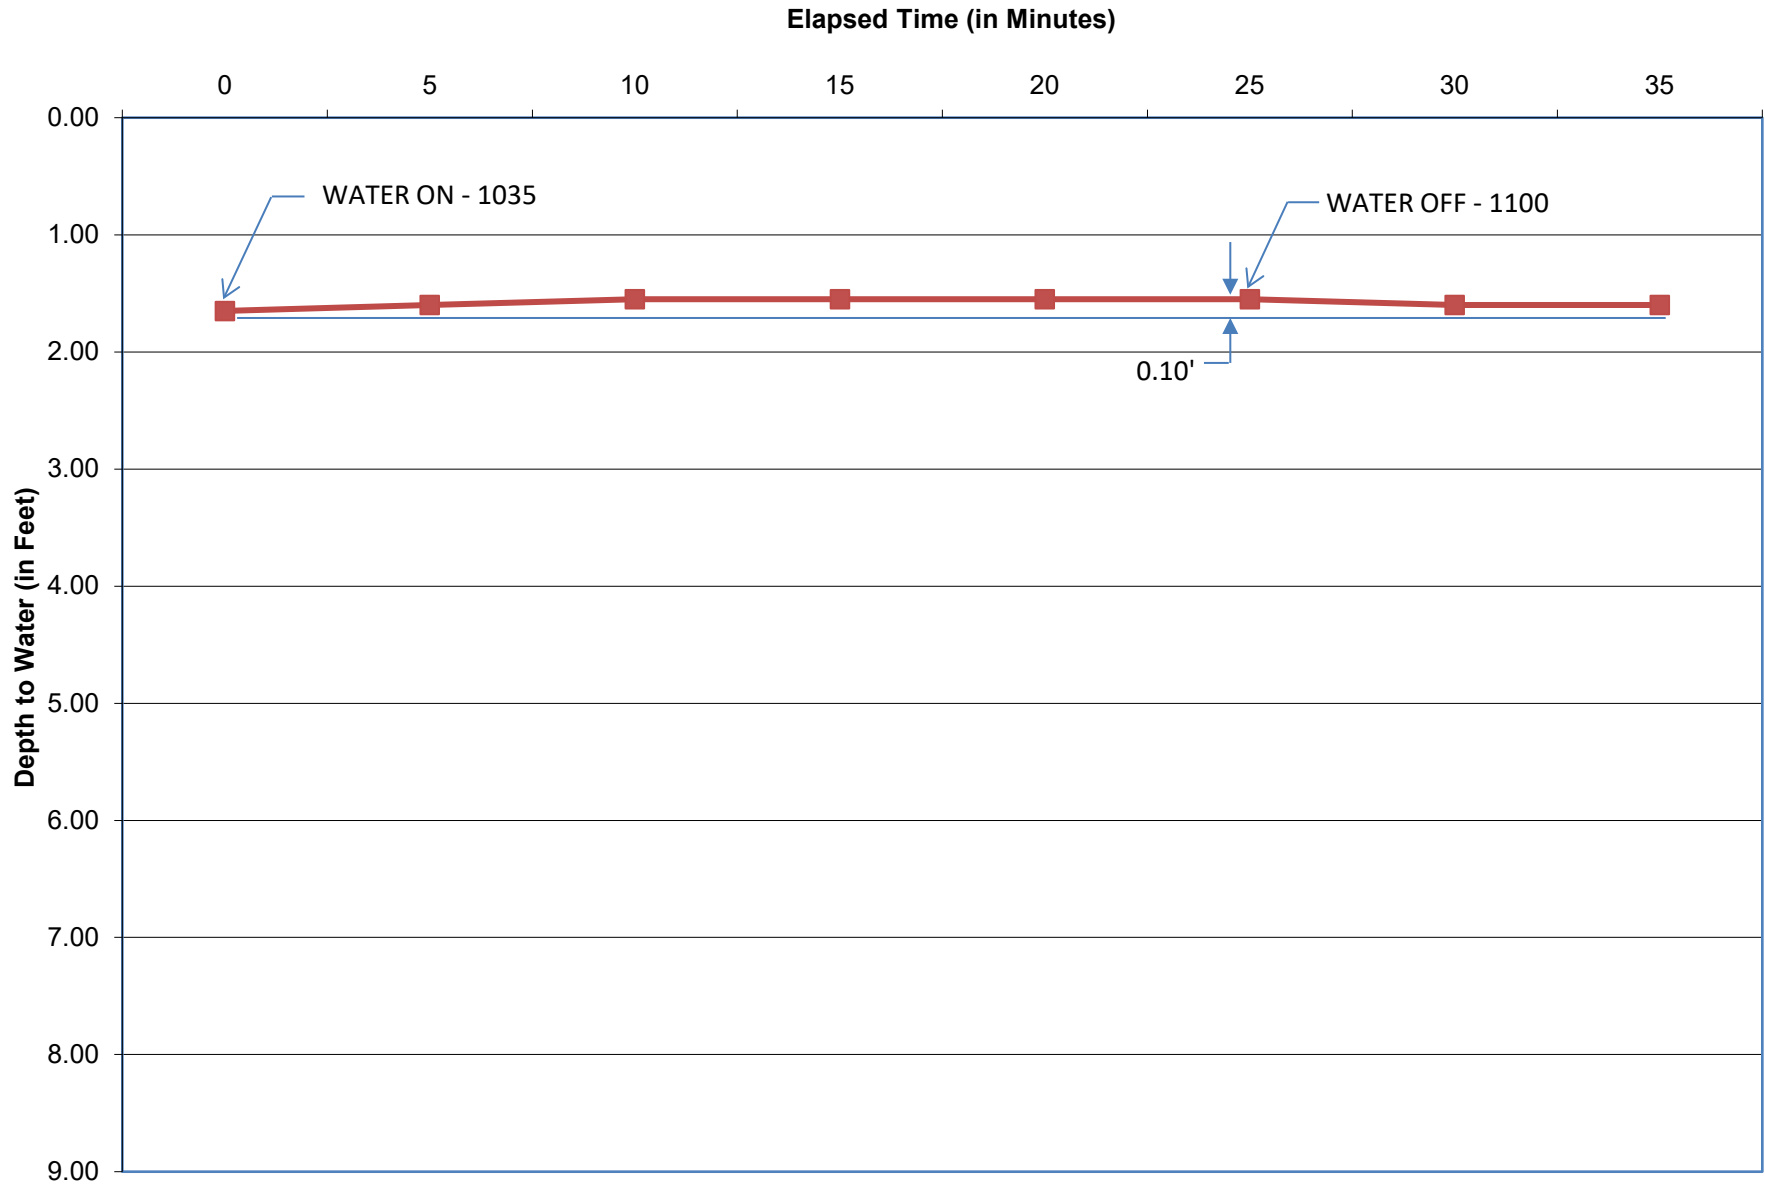

Note: Injection rate 7.5 gpm

TABLE 1
Underground Injection Control Wells
Ono Vista, UIC Permit No. UO-1305
August 24, 2022

Elapsed Time (minutes)	Well No.1		Well No.2*		Well No. 3	
	Depth to Water	Comments	Depth to Water	Comments	Depth to Water	Comments
	(feet)	(feet)	(feet)	(feet)	(feet)	(feet)
0	7.80	WATER ON-0930	1.90	WATER ON-1000	1.65	WATER ON-1035
5	5.30		1.80		1.60	
10	4.35		1.80		1.55	
15	4.10		1.80		1.55	
20	3.90	WATER OFF-0950	1.75		1.55	
25	3.95		1.70	WATER OFF1025	1.55	WATER OFF-1100
30	4.05		1.72		1.60	
35	4.20	END TEST	1.75	END TEST	1.60	END TEST
40						
45						
50						
55						
60						
65						
70						
75						
80						
85						
90						
95						
100						
105						
110						
115						
120						
125						
130						
135						
140						
145						
150						

Notes:

1. All depth measurements made from the top of casings
 2. Injection rate 7.5 gpm.
- * Water entering well from plant @ less than 50 gpm.

TABLE 2
Historical Depth Measurements of UIC Wells
Ono Vista, UIC Permit No. UO-1305
August 24, 2022

Date (Month - Year)	Well No. W-1			Well No. W-2			Well No. W-3*		
	Depth to Water	Depth to Sediment	Depth to Bottom	Depth to Water	Depth to Sediment	Depth to Bottom	Depth to Water	Depth to Sediment	Depth to Bottom
	(feet)	(feet)	(feet)	(feet)	(feet)	(feet)	(feet)	(feet)	(feet)
Aug. 01	4.75	47.58	48.50	6.90	47.00	47.60	0.00	34.50	34.60
Aug. 02	7.80	50.35	50.70	7.70	51.43	51.90	0.00	26.35	27.10
Aug. 03	7.75	None	51.15	7.62	None	52.00	6.15	None	35.20
Aug. 04	8.04	None	51.15	8.00	None	52.85	8.06	36.60	36.70
Aug. 05	7.95	None	51.18	7.70	None	53.00	7.90	Negligible	36.70
Aug. 06	7.70	None	51.15	7.55	None	55.50	7.80	None	37.05
Aug. 07	7.80	None	51.10	7.90	None	53.30	7.80	None	36.95
Aug. 08	7.40	None	51.12	7.50	51.00	51.10	6.50	35.60	35.80
Aug. 09	7.70	None	51.19	7.65	48.00	48.50	4.00	35.70	35.80
Aug. 10	7.60	None	51.20	7.65	45.80	46.80	7.30	None	39.09
Aug. 11	7.72	None	51.20	4.95	None	52.80	5.60	None	42.90
Aug. 12	8.47	None	51.20	7.45	45.20	45.50	8.17	None	42.95
Aug. 13	7.00	None	51.10	4.95	—	—	6.55	42.80	42.85
Aug. 14	7.91	None	51.00	7.90	29.30	30.45	7.54	None	42.90
Aug. 15	7.81	None	50.85	7.60	28.20	28.90	7.60	None	40.70
Aug. 16	7.50	None	51.00	5.46	16.40	17.20	5.40	None	42.86
Aug. 17	7.20	None	51.05	5.65	17.53	17.56	5.65	None	41.90
Aug. 18	7.95	None	51.20	5.80	13.78	17.69	5.80	None	42.28
Aug. 19	7.80	None	51.10	6.35	None	43.20	6.35	None	43.10
Aug. 20	4.40	None	51.35	6.30	**	**	6.30	**	**
Aug. 21	4.20	None	21.10	2.20	**	**	2.17	**	**
Aug. 22	7.80	None	51.50	1.90	**	**	1.65	None	44.00

Notes:

1. Depth measurements made from the top of the west side of the concrete vaults.

* Depth measurements made from the top of the extension pipe.

** Unable to Measure.

TABLE 3
Historical Head Build Up Measurements of the UIC Wells
Ono Vista, UIC Permit No. UO-1305
August 24, 2022

	Well No.1		Well No.2		Well No. 3	
Date	Head Build Up	Comments	Head Build Up	Comments	Head Build Up	Comments
month/year	(feet)		(feet)		(feet)	
Aug. 01	3.75	#1	2.98	#1	N/A	
Aug. 02	3.90	#1	3.74	#1	N/A	
Aug. 03	0.47	#2	1.23	#2	2.85	#2
Aug. 04	1.12	#2	1.55	#2	4.46	#2
Aug. 05	1.20	#2	1.25	#2 & #4	1.50	#2 & #4
Aug. 06	2.75	#2	1.04	#2	4.10	#2
Aug. 07	4.18	#2	1.90	#2	3.20	#2
Aug. 08	1.50	#2	1.25	#2	3.80	#3
Aug. 09	1.13	#2	1.30	#2 & #4	2.85	#2 & #4
Aug. 10	1.70	#2	1.65	#2 & #4	4.05	#2 & #4
Aug. 11	0.47	#2	1.06	#2 & #4	2.50	#2 & #4
Aug. 12	1.22	#2	1.00	#2 & #4	1.87	#2 & #4
Aug. 14	0.59	#2	1.31	#2 & #4	3.03	#2 & #4
Aug. 15	0.61	#2	1.10	#2 & #4	2.75	#2 & #4
Aug. 16	0.50	#2	0.46	#6	0.55	#6
Aug. 17	0.30	#2	0.42	#6	0.42	#6
Aug. 18	0.90	#2	1.30	#2, #6	1.30	#2, #6
Aug. 19	1.00	#2	1.11	#2, #6	1.11	#2, #6
Aug. 20	1.25	#2	0.00	#2, #6, #7	0.00	#2, #6, #7
Aug. 21	1.45	#2	0.15	#2, #6, #7	0.12	#2, #6, #7
Aug. 22	3.90	#2	0.20	#2, #8	0.10	#2

- Notes:
1. Water supply flow rate set at 10 gpm
 2. Water supply flow rate set at 7.5 gpm
 3. Water supply flow rate set at 1 gpm
 4. Water overflowed into adjoining well
 5. N/A -Not Available
 6. W-2 & W-3 tested together w/7.5 gpm flowing into W-2
 7. W-2 & W-3 tested together w/50 gpm in W-2 & 25 gpm in W-3.
 8. Additional flow from plant at less than 50 gpm



Photo 1: Overhead view of Well 1
All photos taken on August 24, 2022



Photo 2: View facing south of W-1 @ 10'



Photo 3: Overhead view of Well 2



Photo 4: View facing south of W-2 @ 10'



Photo 5: Overhead view of Well 3



Photo 6: View facing south of W-3 @ 10'

APPENDIX E

Comments and Responses

Pre-Assessment Consultation Comments and Responses

Ono Vista Condominiums Wastewater Treatment System Replacement

Pre-Assessment Consultation

During preparation of the Draft Environmental Assessment, the following parties provided initial comments on the proposed project.

CITY AND COUNTY OF HONOLULU	
	Department of Planning and Permitting
	Board of Water Supply
	Honolulu Fire Department
	Department of Design and Construction
STATE OF HAWAII	
	Department of Land and Natural Resources
	Division of Aquatic Resources
	Engineering Division
	Division of Forestry and Wildlife
	Department of Health
	Clean Water Branch
	Office of Planning and Sustainable Development
FEDERAL AGENCY	
	U.S. Fish and Wildlife Service
COMMUNITY ORGANIZATION	
	North Shore Neighborhood Board No. 27

BOARD OF WATER SUPPLY

CITY AND COUNTY OF HONOLULU
630 SOUTH BERETANIA STREET
HONOLULU, HI 96843
www.boardofwatersupply.com



November 2, 2022

RICK BLANGIARDI, MAYOR

BRYAN P. ANDAYA, Chair
KAPUA SPROAT, Vice Chair
MAX J. SWORD
NA'ALEHU ANTHONY
JONATHAN KANESHIRO

JADE T. BUTAY, Ex-Officio
DAWN B. SZEWCZYK, P.E., Ex-Officio

ERNEST Y. W. LAU, P.E.
Manager and Chief Engineer

ERWIN M. KAWATA
Deputy Manager

Ms. Stephanie Davis
Environmental Science International
354 Uluniu Street, Suite 304
Kailua, Hawaii 96734

Dear Ms. Davis:

Subject: Your Letter Requesting Comments on the Availability of Water for the Proposed Ono Vista Condominiums Wastewater Treatment System Replacement Project at 68-024 Apuhihi Street – Tax Map Key: 6-8-011: 058

Thank you for your letter regarding the proposed wastewater treatment system replacement project.

The existing water system is adequate to accommodate the proposed development. However, please be advised that this information is based upon current data, and therefore, the Board of Water Supply (BWS) reserves the right to change any position or information stated herein up until the final approval of the building permit application. The final decision on the availability of water will be confirmed when the building permit application is submitted for approval.

When water is made available, the applicant will be required to pay our Water System Facilities Charges for resource development, transmission and daily storage.

Water conservation measures are required for all proposed developments. These measures include low flow plumbing fixtures, utilization of nonpotable water for irrigation using rain catchment and chiller/air handler condensate, cooling tower conductivity meters and water softening recycling systems, drought tolerant plants, xeriscape landscaping, efficient irrigation systems and the use of Water Sense labeled ultra-low-flow water fixtures and toilets.

The proposed project is subject to BWS Cross-Connection Control and Backflow Prevention requirements prior to the issuance of the Building Permit Applications.

The on-site fire protection requirements should be coordinated with the Fire Prevention Bureau of the Honolulu Fire Department.

If you have any questions, please contact Robert Chun, Project Review Branch of our Water Resources Division at (808) 748-5443.

Very truly yours,

ERNEST Y. W. LAU, P.E.
Manager and Chief Engineer



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 25, 2022

ESI Project No. 122067

Robert Chun
Project Review Branch
Board of Water Supply
City and County of Honolulu
630 South Beretania Street
Honolulu, Hawaii 96843

Subject: Response to comments on the preparation of an Environmental Assessment for the Ono Vista Condominiums Wastewater Treatment System Replacement 68-024 Apuhihi Street, Waialua, Hawaii, 96791, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Mr. Robert Chun,

Thank you for commenting on the proposed Ono Vista Condominiums Wastewater Treatment System Replacement. We acknowledge that the applicant will be required to pay your Water System Facilities Charges when water is made available. We understand that water conservation measures are required for all proposed developments and that the project will be subject to BWS Cross-Connection Control and Backflow Prevention requirements prior to the issuance of the Building Permit Applications. We acknowledge that on-site fire protection requirements should be coordinated with the Fire Prevention Bureau of the Honolulu Fire Department.

Your comments will be addressed in the Draft Environmental Assessment or during the design and permitting phases of the project.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letter head address, or via e-mail at sdavis@esciencei.com.

Sincerely,


A handwritten signature in black ink, appearing to read 'Step Davis', written in a cursive style.

Stephanie Davis
Project Manager

DEPARTMENT OF DESIGN AND CONSTRUCTION
CITY AND COUNTY OF HONOLULU

650 SOUTH KING STREET, 11TH FLOOR
HONOLULU, HAWAII 96813
Phone: (808) 768-8480 • Fax: (808) 768-4567
Web site: www.honolulu.gov

RICK BLANGIARDI
MAYOR



HAKU MILLES, P.E.
ACTING DIRECTOR

BRYAN GALLAGHER, P.E.
ACTING DEPUTY DIRECTOR

October 31, 2022

SENT VIA EMAIL

Stephanie Davis
sdavis@esciencei.com

Dear Ms. Davis:

Subject: Ono Vista Condominiums Wastewater
Treatment System Replacement
68-024 Apuhihi Street, Waialua, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Thank you for the opportunity to review and comment. The Department of Design and Construction has no comments to offer at this time.

Should you have any questions, please contact me at (808) 768-8481.

Sincerely,


for Haku Milles, P.E.
Acting Director

HM:krm (890042)

Stephanie Davis

From: Maruoka, Colin <Colin.Maruoka@doh.hawaii.gov>
Sent: Wednesday, October 12, 2022 3:00 PM
To: Stephanie Davis
Cc: CleanWaterBranch
Subject: 2022A429 Ono Vista Condominium WWTS Replacement TMK No. (1) 6-8-011:058

Follow Up Flag: Follow up
Flag Status: Flagged

Dear Ms. Davis,

The Department of Health (DOH), Clean Water Branch (CWB) has received the pre-consultation letter, dated October 3, 2022, requesting comments for Ono Vista Condominiums Wastewater Treatment System Replacement. The DOH-CWB no longer provides comments for pre-consultation on EA/EIS documents. For agencies and projects owners requiring DOH-CWB comments, please utilize the DOH-CWB standard comments accessible on our website or the following link:

<https://health.hawaii.gov/cwb/files/2018/05/Memo-CWB-Standard-Comments.pdf>.

If you have any questions, please email cleanwaterbranch@doh.hawaii.gov.

Sincerely,

Colin T. Maruoka

Clean Water Branch
State of Hawaii Department of Health
2827 Waimano Home Road, #225
Pearl City, Hawaii 96782
Phone: (808) 586-4309

Notice: This information and attachments are intended only for the use of the individual(s) or entity to which it is addressed, and may contain information that is privileged and/or confidential. If the reader of this message is not the intended recipient, any dissemination, distribution, or copying of this communication is strictly prohibited and may be punishable under state and federal law. If you have received this communication and/or attachments in error, please notify the sender via e-mail immediately and destroy all electronic and paper copies.

DAVID Y. IGE
GOVERNOR OF
HAWAII



SUZANNE D. CASE
CHAIRPERSON
BOARD OF LAND AND NATURAL RESOURCES
COMMISSION ON WATER RESOURCE MANAGEMENT

ROBERT K. MASUDA
FIRST DEPUTY

M. KALEO MANUEL
DEPUTY DIRECTOR - WATER

AQUATIC RESOURCES
BOATING AND OCEAN RECREATION
BUREAU OF CONVEYANCES
COMMISSION ON WATER RESOURCE MANAGEMENT
CONSERVATION AND COASTAL LANDS
CONSERVATION AND RESOURCES ENFORCEMENT
ENGINEERING
FORESTRY AND WILDLIFE
HISTORIC PRESERVATION
KAHOOLAWE ISLAND RESERVE COMMISSION
LAND
STATE PARKS



STATE OF HAWAII
DEPARTMENT OF LAND AND NATURAL RESOURCES
DIVISION OF AQUATIC RESOURCES
1151 PUNCHBOWL STREET, ROOM 330
HONOLULU, HAWAII 96813

Date: 10/25/2022

DAR # 6307

MEMORANDUM

TO: Brian J. Neilson
DAR Administrator

FROM: Paul Murakawa, Aquatic Biologist *Paul J. Murakawa*

SUBJECT: Ono Vista Condominiums Wastewater Treatment System Replacement

Request Submitted by: Stephanie Davis, Project Manager, Environmental Science Internat
68-024 Apuhihi Street, Waialua, Oahu, Hawaii TMK No. (1) 6-8-011 :058

Location of Project: _____

Brief Description of Project:

The proposed project involves replacing the existing wastewater treatment system with a new wastewater treatment plant [WWTP] that will be connected to the existing permitted injection well disposal system. For wastewater treatment, Ono Vista Condominiums currently utilizes a system consisting of a wet well, pre-loader for preliminary treatment, an aerobic treatment unit, clarifier, and chlorine contact tank. Treated effluent is then discharged by gravity into three (3) active injection wells. The existing wastewater treatment system was installed in the 1970s and requires replacement due to deterioration. The proposed WWTP system components will all be constructed in the existing footprint and a portion of the east parking lot area.

Comments:

No Comments Comments Attached

Thank you for providing DAR the opportunity to review and comment on the proposed project. Should there be any changes to the project plan, DAR requests the opportunity to review and comment on those changes.

Comments Approved: *Brian J. Neilson* Date: Oct 25, 2022

Brian J. Neilson
DAR Administrator

DAR# 6307

Comments

The Division of Aquatic Resources would like to request that Best Management Practices (BMPs) be included in the Draft Environmental Assessment. This is to ensure that the contractor(s) implement the BMPs to minimize runoff/sedimentation and land-based sources of pollution (LBSP) at the project area where there is the opportunity (e.g. any site where there will be excavation, grading, or sediment/pollutant producing activities) for discharge into nearby waters. These BMPs may include (but not limited to) any type of barrier (e.g. sediment fences, silt screens/curtains, bags, environmental socks, petroleum absorption materials) that limits the amount of runoff, sediment, or LBSP (e.g. petroleum products, chemicals, debris, etc.) to the maximum extent possible. This is important given the proximity of the project to nearby waters. Periods of heavy rains increases runoff and there is a higher risk of sediment or LBSP ending up in nearby waters.



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740 phone

November 29, 2022

ESI Project No. 122067

Paul Murakawa, Aquatic Biologist
Division of Aquatic Resources
State of Hawaii Department of Land and Natural Resources
1151 Punchbowl Street #330
Honolulu, HI 96813

Subject: Response to comments on the preparation of an Environmental Assessment for the Proposed Ono Vista Condominium Wastewater Treatment System Replacement (DAR #6307)
64-024 Apuhihi Street, Waialua, Oahu, Hawaii TMK No. (1) 6-8-011:058

Dear Mr. Paul Murakawa,

Thank you for commenting on the proposed Ono Vista Condominium Wastewater Treatment System Replacement. We have reviewed the comments regarding the BMPs during construction. The BMPs will be implemented during construction and included in the Environmental Assessment.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letter head address, or via e-mail at sdavis@esciencei.com.


Sincerely,

A handwritten signature in black ink, appearing to read 'Step Davis', with a stylized flourish at the end.

Stephanie Davis
Project Manager



DAVID Y. IGE
GOVERNOR OF HAWAII



SUZANNE D. CASE
CHAIRPERSON
BOARD OF LAND AND NATURAL RESOURCES
COMMISSION ON WATER RESOURCE MANAGEMENT

ROBERT K. MASUDA
FIRST DEPUTY

M. KALEO MANUEL
DEPUTY DIRECTOR - WATER

AQUATIC RESOURCES
BOATING AND OCEAN RECREATION
BUREAU OF CONVEYANCES
COMMISSION ON WATER RESOURCE MANAGEMENT
CONSERVATION AND COASTAL LANDS
CONSERVATION AND RESOURCES ENFORCEMENT
ENGINEERING
FORESTRY AND WILDLIFE
HISTORIC PRESERVATION
KAHOOLAWE ISLAND RESERVE COMMISSION
LAND
STATE PARKS

STATE OF HAWAII
DEPARTMENT OF LAND AND NATURAL RESOURCES
DIVISION OF FORESTRY AND WILDLIFE
1151 PUNCHBOWL STREET, ROOM 325
HONOLULU, HAWAII 96813

November 2, 2022

Stephanie Davis
Project Manager
Environmental Science International (ESI)
354 Uluniu Street Suite 304
Kailua, Hawai'i 96734
Attn: sdavis@esciencei.com

Log no. 3846
ESI Project no. 122067

Dear Ms. Stephanie Davis,

The Department of Land and Natural Resources, Division of Forestry and Wildlife (DOFAW) has received your request for comments for the replacement of an existing wastewater treatment system (ESI Project No. 122067) at the Ono Vista Condominiums located at 68-024 Apuhihi Street, Waialua, on the island of O'ahu; TMK: (1) 6-8-011:058. The proposed project consists of replacing the existing wastewater treatment system with a new wastewater treatment plant that will be connected to the existing permitted injection well disposal system, and all components will be constructed in the existing footprint and a portion of the east parking lot.

The State listed Hawaiian Hoary Bat or 'Ōpe'ape'a (*Lasiurus cinereus semotus*) could potentially occur at or in the vicinity of the project and may roost in nearby trees. Any required site clearing should be timed to avoid disturbance to bats during their birthing and pup rearing season (June 1 through September 15). During this period woody plants greater than 15 feet (4.6 meters) tall should not be disturbed, removed, or trimmed. Barbed wire should also be avoided for any construction because bats can become ensnared and killed by such fencing material during flight.

Artificial lighting can adversely impact seabirds that may pass through the area at night by causing them to become disoriented. This disorientation can result in their collision with manmade structures or the grounding of birds. For nighttime work that might be required, DOFAW recommends that all lights used to be fully shielded to minimize the attraction of seabirds. Nighttime work that requires outdoor lighting should be avoided during the seabird fledging season, from September 15 through December 15. This is the period when young seabirds take their maiden voyage to the open sea. Permanent lighting also poses a risk of seabird attraction, and as such should be minimized or eliminated to protect seabird flyways and preserve the night sky. For illustrations and guidance related to seabird-friendly light styles that also protect seabirds and the dark starry skies of Hawai'i, please visit <https://dlnr.hawaii.gov/wildlife/files/2016/03/DOC439.pdf>.

State-listed waterbirds such as the Hawaiian stilt (*Himantopus mexicanus knudseni*), Hawaiian coot (*Fulica alai*), Hawaiian gallinule (*Gallinula chloropus sandvicensis*), and Hawaiian Duck (*Anas wyvilliana*) could potentially occur at or in the vicinity of the proposed project site. It is against State law to harm or harass these species. If any of these species are present during construction, then all activities within 100 feet (30 meters) should cease, and the bird or birds should not be approached. Work may continue after the bird or birds leave the area of their own accord. If a nest is discovered at any point, please contact the O‘ahu Branch DOFAW Office at (808) 973-9778.

DOFAW is concerned about the wastewater treatment facility attracting vulnerable birds to areas that may host nonnative predators such as cats, rodents, and mongooses. We recommend taking action to minimize predator presence; remove cats, place bait stations for rodents and mongoose, and provide covered trash receptacles. Also, you should consider implementing additional mitigation measures to avoid avian mortality during project design and during operation for the long term.

The State endangered Hawaiian Short-eared owl or pueo (*Asio flammeus sandwichensis*) could potentially occur in the project vicinity. Pueo are most active during dawn and dusk twilights. Before clearing any vegetation, DOFAW recommends twilight pre-construction surveys by a qualified biologist. If pueo nests are present, DOFAW staff should be notified and a buffer zone should be established in which no clearing occurs until nesting is completed.

DOFAW recommends minimizing the movement of plant or soil material between worksites. Soil and plant material may contain pathogens, pests such as Little Fire ants and/or Coconut Rhinoceros beetles, or invasive plant parts that could harm our native species and ecosystems. We recommend consulting the O‘ahu Invasive Species Committee (OISC) at (808) 266-7994 to help plan, design, and construct the project, learn of any high-risk invasive species in the area, and ways to mitigate their spread. All equipment, materials, and personnel should be cleaned of excess soil and debris to minimize the risk of spreading invasive species.

We appreciate your efforts to work with our office for the conservation of our native species. These comments are general guidelines and should not be considered comprehensive for this site or project. It is the responsibility of the applicant to do their own due diligence to avoid any negative environmental impacts. Should the scope of the project change significantly, or should it become apparent that threatened or endangered species may be impacted, please contact our staff as soon as possible. If you have any questions, please contact Paul Radley, Protected Species Habitat Conservation Planning Coordinator at (808) 295-1123 or paul.m.radley@hawaii.gov.

Sincerely,

Lainie Berry

LAINIE BERRY
Wildlife Program Manager



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 25, 2022

ESI Project No. 122067

Paul Radley, Protected Species Habitat Conservation Planning Coordinator
Department of Land and Natural Resources
Division of Forestry and Wildlife
1151 Punchbowl Street, Room 325
Honolulu, Hawaii 96813

Subject: Response to comments on the preparation of an Environmental Assessment for the Proposed Ono Vista Condominiums Wastewater Treatment System Replacement. 68-024 Apuhihi Street, Wailalua, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Mr. Paul Radley,


Thank you for commenting on the proposed Ono Vista Condominiums Wastewater Treatment System Replacement. We acknowledge your concerns and recommendations regarding the Hawaiian Hoary Bat, artificial lighting, state-listed waterbirds, Pueo, rodent and nonnative predator management, and plant/soil contamination. The recommendations will be addressed in the Draft Environmental Assessment.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letter head address, or via e-mail at sdavis@esciencei.com.


Sincerely,

A handwritten signature in black ink, appearing to read 'Step Davis', written in a cursive style.

Stephanie Davis
Project Manager



DAVID Y. IGE
GOVERNOR OF HAWAII



SUZANNE D. CASE
CHAIRPERSON
BOARD OF LAND AND NATURAL RESOURCES
COMMISSION ON WATER RESOURCE
MANAGEMENT

**STATE OF HAWAII
DEPARTMENT OF LAND AND NATURAL RESOURCES
LAND DIVISION**

POST OFFICE BOX 621
HONOLULU, HAWAII 96809

November 22, 2022

LD 0360

Stephanie Davis, Project Manager
Environmental Science International
354 Uluniu Street, Suite 304
Kailua, HI96734

Via email: sdavis@esciencei.com

To Whom It May Concern:

SUBJECT: Pre-Assessment Consultation for Draft Environmental Assessment
Ono Vista Condominiums Wastewater Treatment System Replacement
68-24 Apuhihi Street, Waialua, Island of Oahu, Hawaii
TMK: (1) 6-8-011:058

Thank you for the opportunity to review and comment on the subject project. The Land Division of the Department of Land and Natural Resources (DLNR) distributed copies of your request to DLNR's various divisions for their review and comment.

Enclosed are comments received from our Engineering Division. Should you have any questions, please feel free to contact Barbara Lee via email at barbara.j.lee@hawaii.gov. Thank you.

Sincerely,

Russell Tsuji

Russell Y. Tsuji
Land Administrator

Attachments

cc: Central Files



STATE OF HAWAII
DEPARTMENT OF LAND AND NATURAL RESOURCES
LAND DIVISION

POST OFFICE BOX 621
HONOLULU, HAWAII 96809

October 21, 2022

LD 0360

MEMORANDUM

FROM: ~~TO:~~

DLNR Agencies:

Div. of Aquatic Resources

Div. of Boating & Ocean Recreation

Engineering Division (via email: DLNR.engr@hawaii.gov)

Div. of Forestry & Wildlife (via email: rubyrosa.t.terrago@hawaii.gov)

Div. of State Parks

Commission on Water Resource Management (via email: DLNR.CWRM@hawaii.gov)

Office of Conservation & Coastal Lands

Land Division – Oahu District (via email: barry.w.cheung@hawaii.gov)

Russell Tsuji

TO: ~~FROM:~~

Russell Y. Tsuji, Land Administrator

SUBJECT:

Pre-Assessment Consultation for Draft Environmental Assessment

Ono Vista Condominiums Wastewater Treatment System Replacement

LOCATION:

68-24 Apuhihi Street, Waiialua, Island of Oahu, Hawaii

TMK: (1) 6-8-011:058

APPLICANT:

Environmental Science International, in cooperation with Laulea Engineering, LLC

Transmitted for your review and comment is information on the above-referenced project. Please review the attached information and submit any comments by the internal deadline of **November 18, 2022**, to barbara.j.lee@hawaii.gov at the Land Division.

If no response is received by the above due date, we will assume your agency has no comments at this time. Should you have any questions about this request, please contact Barbara Lee at the above email address. Thank you.

BRIEF COMMENTS:

- We have no objections.
- We have no comments.
- We have no additional comments.
- Comments are included/attached.

Signed:

Print Name:

Carty S. Chang, Chief Engineer

Division:

Engineering Division

Date:

Nov 10, 2022

Attachments

Cc: Central Files

**DEPARTMENT OF LAND AND NATURAL RESOURCES
ENGINEERING DIVISION**

LD/Russell Y. Tsuji

**Ref: Pre-Assessment Consultation for Draft Environmental Assessment
Ono Vista Condominiums Wastewater Treatment System Replacement
Location: 68-24 Apuhihi Street, Waialua, Island of Oahu, Hawaii
TMK(s): (1) 6-8-011:058
Applicant: Environmental Science International, in cooperation with Laulea
Engineering, LLC**

COMMENTS

The rules and regulations of the National Flood Insurance Program (NFIP), Title 44 of the Code of Federal Regulations (44CFR), are in effect when development falls within a Special Flood Hazard Area (high-risk areas). Be advised that 44CFR, Chapter 1, Subchapter B, Part 60 reflects the minimum standards as set forth by the NFIP. Local community flood ordinances may stipulate higher standards that can be more restrictive and would take precedence over the minimum NFIP standards.

The owner of the project property and/or their representative is responsible to research the Flood Hazard Zone designation for the project. Flood zones subject to NFIP requirements are identified on FEMA's Flood Insurance Rate Maps (FIRM). The official FIRMs can be accessed through FEMA's Map Service Center (msc.fema.gov). Our Flood Hazard Assessment Tool (FHAT) (<http://gis.hawaiiinfip.org/FHAT>) could also be used to research flood hazard information.

If there are questions regarding the local flood ordinances, please contact the applicable County NFIP coordinating agency below:

- Oahu: City and County of Honolulu, Department of Planning and Permitting (808) 768-8098.
- Hawaii Island: County of Hawaii, Department of Public Works (808) 961-8327.
- Maui/Molokai/Lanai County of Maui, Department of Planning (808) 270-7139.
- Kauai: County of Kauai, Department of Public Works (808) 241-4849.

Signed: 
CARTY S. CHANG, CHIEF ENGINEER

Date: Nov 10, 2022



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 29, 2022

ESI Project No. 122067

Carty S. Chang, Chief Engineer
Engineering Division
Department of Land and Natural Resources
Kalanimoku Building
1151 Punchbowl Street, Room 221
Honolulu, Hawaii 96813

Subject: Response to comments on the preparation of an Environmental Assessment for the Ono Vista Condominiums Wastewater Treatment System Replacement 68-024 Apuhihi Street, Waialua, Hawaii, 96791, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Chief Engineer Chang,

Thank you for commenting on the proposed Ono Vista Condominiums Wastewater Treatment System Replacement. We acknowledge your concerns and recommendations regarding the rules and regulations of the National Flood Insurance Program [NFIP], Title 44 of the CFR, when development falls within a Special Flood Hazard Area. Flood hazard information will be included in the Draft Environmental Assessment.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letterhead address, or via e-mail at sdavis@esciencei.com.

Sincerely,


A handwritten signature in black ink, appearing to read 'Stephanie Davis', written in a cursive style.

Stephanie Davis
Project Manager

DEPARTMENT OF PLANNING AND PERMITTING
CITY AND COUNTY OF HONOLULU

650 SOUTH KING STREET, 7TH FLOOR • HONOLULU, HAWAII 96813
PHONE: (808) 768-8000 • FAX: (808) 768-6041
DEPT. WEB SITE: www.honoluluodpp.org • CITY WEB SITE: www.honolulu.gov

RICK BLANGIARDI
MAYOR



DAWN TAKEUCHI APUNA
ACTING DIRECTOR

October 4, 2022

2022/ELOG-1837(ZS)

SEND VIA EMAIL

Ms. Stephanie Davis
SDavis@esciencei.com

Dear Ms. Davis:

SUBJECT: Pre-Environmental Assessment (EA) Consultation
Replacement Wastewater Treatment System
Ono Vista Condominium
68-090 Au Street - Waialua
Tax Map Key 6-8-011: 058

This is in response to your letter, received September 1, 2022, initiating consultation for the preparation of a draft EA for the subject Project. The subject Property is 51,656 square feet in area and is within the A-2 Medium Density Apartment District and the Special Management Area. The property fronts Apuhihi Street to the west and Au Street to the east. There are two apartment buildings, one along each street frontage, with parking in-between. You state that the existing wastewater system was installed in the 1970s and is deteriorating. A new wastewater system will be constructed within the existing footprint and a portion of the east parking lot area. Our comments are as follows; the EA should include:

- A description of the structural differences between the existing and proposed wastewater systems, and include drawings illustrating existing and proposed layouts and elevations. Drawings should demonstrate compliance with the A-2 Medium Density Apartment District standards established in the zoning code, including required yards.
- An explanation of whether the approved parking spaces will be affected, and an assessment of compliance with current parking regulations.

Ms. Stephanie Davis
October 4, 2022
Page 2

- A comparison of the environmental impacts of the existing and proposed wastewater systems, and explain whether a National Pollutant Discharge Elimination System permit is required.
- An evaluation of the proposed wastewater system with respect to coastal hazards, including flooding and sea level rise.
- Indication as to whether the EA is required pursuant to Hawaii Revised Statutes (HRS) Section 343-5(9)(A) (propose any wastewater treatment unit serving at least 50 single-family dwellings or the equivalent). If so, the document should be submitted for publication as an HRS Chapter 343 and ROH Chapter 25 document. Based on certificates of occupancy on file, it appears there are a total of 64 dwelling units.

We look forward to reviewing the draft EA. Should you have any questions, please contact Zack Stoddard, of our staff, at (808) 768-8019 or via email at zachary.stoddard@honolulu.gov.

Very truly yours,


for Dawn Takeuchi Apuna
Acting Director



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 25, 2022

ESI Project No. 122067

Zack Stoddard
Department of Planning and Permitting
City and County of Honolulu
650 South King Street, 7th floor
Honolulu, Hawaii 96813

Subject: Response to comments on the preparation of an Environmental Assessment for the Ono Vista Condominiums Wastewater Treatment System Replacement 68-024 Apuhihi Street, Waiialua, Hawaii, 96791, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Mr. Zack Stoddard,

Thank you for commenting on the proposed Ono Vista Condominiums Wastewater Treatment System Replacement. Your comments will be addressed in the Draft Environmental Assessment, to include:

- A description of the structural differences between the existing and proposed wastewater systems, and drawings illustrating existing and proposed layouts and elevations and compliance with the zoning code.
- Compliance with the current parking regulations.
- A comparison of the environmental impacts of the existing and proposed wastewater systems, and whether a National Pollutant Discharge Elimination System permit is required.
- An evaluation of the proposed wastewater system with respect to costal hazards, including flooding and sea level rise.
- A description of why the Environmental Assessment is required.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letter head address, or via e-mail at sdavis@esciencei.com.

Sincerely,


A handwritten signature in black ink, appearing to read "Step Davis", with a stylized flourish at the end.

Stephanie Davis
Project Manager

HONOLULU FIRE DEPARTMENT
CITY AND COUNTY OF HONOLULU

636 South Street
Honolulu, Hawaii 96813-5007
Phone: 808-723-7139 Fax: 808-723-7111 Internet: www.honolulu.gov/hfd

RICK BLANGIARDI
MAYOR



OCT 26 2022

SHELDON K. HAO
FIRE CHIEF

JASON SAMALA
DEPUTY FIRE CHIEF

October 20, 2022

Ms. Stephanie Davis
Project Manager
Environmental Science International
354 Uluniu Street, Suite 304
Kailua, Hawaii 96734

Dear Ms. Davis:

Subject: Wastewater Treatment System Replacement
Ono Vista Condominiums
68-024 Apuhihi Street
Waialua, Hawaii 96791
Tax Map Key: 6-8-011: 058

In response to your letter received on October 11, 2022, regarding the abovementioned subject, the Honolulu Fire Department (HFD) reviewed the submitted information and requires that the following be complied with:

1. Fire department access roads shall be provided such that any portion of the facility or any portion of an exterior wall of the first story of the building is located not more than 150 feet (46 meters) from fire department access roads as measured by an approved route around the exterior of the building or facility. (National Fire Protection Association [NFPA] 1; 2018 Edition, Sections 18.2.3.2.2 and 18.2.3.2.2.1, as amended.)

A fire department access road shall extend to within 50 feet (15 meters) of at least one exterior door that can be opened from the outside and that provides access to the interior of the building. (NFPA 1; 2018 Edition, Section 18.2.3.2.1.)

2. An approved water supply capable of supplying the required fire flow for fire protection shall be provided to all premises upon which facilities, buildings, or portions of buildings are hereafter constructed or


Ms. Stephanie Davis
Page 2
October 20, 2022

moved into the jurisdiction. The approved water supply shall be in accordance with NFPA 1; 2018 Edition, Sections 18.3 and 18.4.

3. The fire department access roads shall be in accordance with NFPA 1; 2018 Edition, Section 18.2.3.
4. Submit civil drawings to the City and County of Honolulu's Department of Planning and Permitting and route them to the HFD for review and approval.
5. The abovementioned provisions are required by the HFD. This project may necessitate that additional conditions be met as determined by other agencies.

Should you have questions, please contact Acting Battalion Chief Kendall Ching of our Fire Prevention Bureau at 808-723-7154 or kching3@honolulu.gov.

Sincerely,



CRAIG UCHIMURA
Acting Assistant Chief

CU/MD:bh



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 25, 2022

ESI Project No. 122067

Kendall Ching, Acting Battalion Chief
Fire Prevention Bureau
Honolulu Fire Department
City and County of Honolulu
636 South Street
Honolulu, Hawaii 96813

Subject: Response to comments on the preparation of an Environmental Assessment for the Ono Vista Condominiums Wastewater Treatment System Replacement
68-024 Apuhihi Street, Waialua, Hawaii, 96791, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Acting Battalion Chief Kendall Ching,


Thank you for commenting on the proposed Ono Vista Condominiums Wastewater Treatment System Replacement. We acknowledge your comments regarding the access roads, an approved water supply capable of supplying the required fire flow for fire protection, and the submittal of civil drawings to the City and County of Honolulu's Department of Planning and Permitting. The comments will be addressed in the design and permitting phases of the project.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letter head address, or via e-mail at sdavis@esciencei.com.

Sincerely,

A handwritten signature in black ink, appearing to read 'Stephanie Davis', written in a cursive style.

Stephanie Davis
Project Manager



STATE OF HAWAII OFFICE OF PLANNING & SUSTAINABLE DEVELOPMENT

DAVID Y. IGE
GOVERNOR

MARY ALICE EVANS
DIRECTOR

235 South Beretania Street, 6th Floor, Honolulu, Hawaii'i 96813
Mailing Address: P.O. Box 2359, Honolulu, Hawaii'i 96804

Telephone: (808) 587-2846
Fax: (808) 587-2824
Web: <https://planning.hawaii.gov/>

DTS 202210110828NA

Coastal Zone
Management
Program

October 21, 2022

Environmental
Review Program

Land Use
Commission

Land Use Division

Special Plans
Branch

State Transit-
Oriented
Development

Statewide
Geographic
Information System

Statewide
Sustainability Branch

Ms. Stephanie Davis
Environmental Science International
354 Uluniu Street, Suite 304
Kailua, HI 96734

Dear Ms. Davis:

Subject: Pre-consultation for an Environmental Assessment on Ono Vista
Condominium Wastewater Treatment System Replacement, 68-024
Apuhihi Street, Waialua, Oahu; Tax Map Key: (1) 6-8-011: 058

The Office of Planning and Sustainable Development (OPSD) is in receipt of your Environmental Assessment (EA) pre-consultation request, received October 11, 2022, for Ono Vista Condominium Wastewater Treatment System Replacement, 68-024 Apuhihi Street, Waialua, Oahu.

According to the EA pre-consultation request, the proposed project, which is located within the county designated Special Management Area (SMA), will replace the existing wastewater treatment system with a new Wastewater Treatment Plant (WWTP). The new WWTP system will be constructed in the existing footprint and a portion of the east parking lot area, and connected to the existing permitted injection well disposal system. The proposed WWTP system will consist of the following components:

- Existing wet well/lift station/trash tank
- New secondary treatment tank system
- Existing multiple injection well disposal system, including one primary deep injection well, and two backup deep injection wells

The OPSD has reviewed the subject pre-consultation request and has the following comments to offer:

1. The EA should discuss the triggers for the requirement of an EA for the proposed WWTP system pursuant to Hawaii Revised Statutes (HRS) Chapter 343, and county SMA Ordinance.
2. Hawaii Coastal Zone Management (CZM) Law, HRS Chapter 205A, requires all state and county agencies to enforce the CZM objectives and

- policies. The subject EA should include an assessment with mitigation measures, if needed, as to how the proposed residential development conforms to each of the CZM objectives and supporting policies set forth in HRS § 205A-2, as amended.
3. If the subject EA will serve as a supporting document for a SMA Use Permit application, the OPSD recommends that the EA specifically discuss the compliance with the requirements of SMA use under Revised Ordinances of Honolulu (ROH) Chapter 25 for the proposed WWTP system by consulting with the Department of Planning and Permitting, City and County of Honolulu.
 4. To assess potential impacts of sea level rise on the proposed development, the OPSD suggests the EA refer to the findings of the Hawaii Sea Level Rise Vulnerability and Adaptation Report 2017, accepted by the Hawaii Climate Change Mitigation and Adaptation Commission. The Report, and Hawaii Sea Level Rise Viewer at <https://www.pacioos.hawaii.edu/shoreline/slr-hawaii/> particularly identifies a 3.2-foot sea level rise exposure area across the main Hawaiian Islands which may occur in the mid to latter half of the 21st century. The EA should provide a map of the 3.2-foot sea level rise exposure area in relation to the property area, and consider whether site-specific mitigation measures are necessary to respond to the potential impacts of 3.2-foot sea level rise on the proposed development.
 5. The OPSD has developed guidance documents on stormwater runoff strategies, which offer techniques to prevent land-based pollutants and sediment from potentially affecting water resources. The OPSD recommends that the subject EA consider the following stormwater assessment guidance to mitigate stormwater runoff impacts:

Stormwater Impact Assessments can be used to identify and analyze information on hydrology, sensitivity of coastal and riparian resources, and management measures to control runoff, as well as consider secondary and cumulative impacts to the area.

https://files.hawaii.gov/dbedt/op/czm/initiative/stomwater_imapct/final_stormwater_impact_assessments_guidance.pdf

If you have any questions regarding this comment letter, please contact Shichao Li of our office at (808) 587-2841, or by email at shichao.li@hawaii.gov.

Sincerely,



Mary Alice Evans
Director



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 29, 2022

ESI Project No. 122067

Shichao Li
State of Hawaii
Office of Planning & Sustainable Development
P.O. Box 2359
Honolulu, Hawaii 96804

Subject: Response to comments on the preparation of an Environmental Assessment for the Proposed Ono Vista Condominium Wastewater Treatment System Replacement
64-024 Apuhihi Street, Waialua, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Mr. Shichao Li,

Thank you for commenting on the proposed Ono Vista Condominium Wastewater Treatment System Replacement. We acknowledge your comments and recommendations regarding the following: 1) discussion of triggers for the requirement of the Environmental Assessment, 2) Coastal Zone Management objectives and policies, 3) compliance with the requirements of Special Management Area use, 4) assessing potential impacts of sea level rise, and 5) mitigation of stormwater runoff impacts. The recommendations will be addressed in the Draft Environmental Assessment.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letterhead address, or via e-mail at sdavis@esciencei.com.

Sincerely,

A handwritten signature in black ink, appearing to read 'Step Davis', written in a cursive style.

Stephanie Davis
Project Manager



United States Department of the Interior



FISH AND WILDLIFE SERVICE
Pacific Islands Fish and Wildlife Office
300 Ala Moana Boulevard, Room 3-122
Honolulu, Hawai'i 96850

In Reply Refer To:
2023-0007035-S7-001

November 8, 2022

Ms. Stephanie Davis
Environmental Science International
354 Uluniu Street, Suite 304
Kailua, Hawai'i 96734

Subject: Species List for the Ono Vista Condominiums Wastewater Treatment Replacement System, O'ahu

Dear Ms. Davis:

Thank you for your letter of October 11, 2022, requesting our comments for the Ono Vista Condominiums wastewater treatment system replacement at 68-024 Apuhihi Street, Waialua, O'ahu, TMK (1) 6-8-011:058. The proposed project involves replacing the existing wastewater treatment system with a new wastewater treatment plant (WWTP) that will be connected to the existing permitted injection well disposal system. The proposed WWTP will consist of an existing wet well/lift station/trash tank, a new secondary treatment tank/system, and an existing multiple injection well disposal system.

This letter has been prepared under the authority of and in accordance with provisions of the Endangered Species Act of 1973 (16 U.S.C. 1531 *et seq.*), as amended (ESA). We have reviewed the information you provided and pertinent information in our files, as it pertains to federally listed species in accordance with section 7 of the ESA. Our data indicate the following federally listed species may occur or transit through the vicinity of the proposed project area: the endangered Hawaiian hoary bat (*Lasiurus cinereus semotus*); endangered Hawaiian petrel (*Pterodroma sandwichensis*), threatened Newell's shearwater (*Puffinus auricularis newelli*), and endangered Hawaii DPS band-rumped storm-petrel (*Oceanodroma castro*) (hereafter collectively referred to as Hawaiian seabirds).

Hawaiian hoary bat

The Hawaiian hoary bat roosts in both exotic and native woody vegetation across all islands and will leave young unattended in trees and shrubs when they forage. If trees or shrubs 15 feet or taller are cleared during the pupping season, there is a risk that young bats could inadvertently be harmed or killed since they are too young to fly or may not move away.

PACIFIC REGION 1

IDAHO, OREGON*, WASHINGTON,
AMERICAN SAMOA, GUAM, HAWAI'I, NORTHERN MARIANA ISLANDS

*PARTIAL

To avoid and minimize impacts to the endangered Hawaiian hoary bat we recommend you consider incorporating the following applicable measure into your project description:

- Do not disturb, remove, or trim woody plants greater than 15 feet tall during the bat birthing and pup rearing season (June 1 through September 15).
- Do not use barbed wire for fencing.

Hawaiian seabirds

Hawaiian seabirds may traverse the project area at night during the breeding, nesting, and fledging seasons (March 1 to December 15). Outdoor lighting could result in seabird disorientation, fallout, and injury or mortality. Seabirds are attracted to lights and after circling the lights they may become exhausted and collide with nearby wires, buildings, or other structures or they may land on the ground. Downed seabirds are subject to increased mortality due to collision with automobiles, starvation, and predation by dogs, cats, and other predators. Young birds (fledglings) traversing the project area between September 15 and December 15, in their first flights from their mountain nests to the sea, are particularly vulnerable.

To avoid and minimize potential project impacts to seabirds we recommend you incorporate the following applicable measures into your project description:

- Fully shield all outdoor lights so the bulb can only be seen from below bulb height and only use when necessary.
- Install automatic motion sensor switches and controls on all outdoor lights or turn off lights when human activity is not occurring in the lighted area.
- Avoid nighttime construction during the seabird fledging period, September 15 through December 15.

We appreciate your efforts to conserve protected species. If you have questions regarding this response, please contact Elyse Sachs, Fish and Wildlife Biologist (phone: 808-792-9400, email: Elyse_Sachs@fws.gov). When referring to this project, please include this reference number: 2023-0007035-S7-001.

Sincerely,

Island Team Manager
O‘ahu, Kaua‘i, Northwestern Hawaiian
Islands, and American Samoa



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 29, 2022

ESI Project No. 122067

Elyse Sachs, Fish and Wildlife Biologist
United States Department of the Interior
Fish and Wildlife Service
Pacific Island Fish and Wildlife Office
300 Ala Moana Boulevard, Room 3-122
Honolulu, Hawaii 96850

Subject: Response to comments on the preparation of an Environmental Assessment for the Ono Vista Condominiums Wastewater Treatment System Replacement 68-024 Apuhihi Street, Waialua, Hawaii, 96791, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Ms. Elyse Sachs,

Thank you for commenting on the proposed Ono Vista Condominiums Wastewater Treatment System Replacement (Reference Number: 2023-0007035-S7-001). We acknowledge your concerns about the Hawaiian hoary bat and Hawaiian seabirds, and your recommendations will be implemented during construction and included in the Environmental Assessment.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letter head address, or via e-mail at sdavis@esciencei.com.

Sincerely,

A handwritten signature in black ink, appearing to read 'Step Davis', written in a cursive style.

Stephanie Davis
Project Manager

Stephanie Davis

From: Kathleen Pahinui <pahinuik001@hawaii.rr.com>
Sent: Friday, October 28, 2022 12:52 PM
To: Stephanie Davis
Subject: FW: Pre-Consultation for Draft Environmental Assessment for WWTS at Ono Vista Condominium

Follow Up Flag: Follow up
Flag Status: Flagged

Aloha –

Here is a question from one of our board members.

Mahalo!

Kathleen

From: Bob Leinau <leinaur001@hawaii.rr.com>
Date: Thursday, October 20, 2022 at 6:11 PM
To: 'Kathleen Pahinui' <pahinuik001@hawaii.rr.com>
Subject: RE: Pre-Consultation for Draft Environmental Assessment for WWTS at Ono Vista Condominium

It would be good to know the design capacity and how assurance can be instituted that there is sufficient detention time. Also in a high density area there should be some enforceable policies and procedures that reduce the amount of waste stream/ pressure on the system.

Mahalo, Bob

From: Kathleen Pahinui <pahinuik001@hawaii.rr.com>
Sent: Thursday, October 20, 2022 3:33 PM
To: NSNB <pahinuik001@hawaii.rr.com>
Cc: Ishitani, Casey J <casey.ishitani@honolulu.gov>
Subject: FW: Pre-Consultation for Draft Environmental Assessment for WWTS at Ono Vista Condominium

Aloha Board Members –

If you have any questions or comments, send my way and I will forward to Stephanie.

Mahalo!

Kathleen



Environmental Science International
354 Uluniu Street Suite 304, Kailua, Hawaii 96734
(808) 261-0740

November 25, 2022

ESI Project No. 122067

Bob Leinau
C/O Kathleen Pahinui
North Shore Neighborhood Board
925 Dillingham Blvd Suite 160
Honolulu, Hawaii 96817

Subject: Response to comments on the preparation of an Environmental Assessment for the Ono Vista Condominiums Wastewater Treatment System Replacement 68-024 Apuhihi Street, Waiialua, Hawaii, 96791, Oahu, Hawaii
TMK No. (1) 6-8-011:058

Dear Mr. Bob Leinau,

Thank you for commenting on the proposed Ono Vista Condominiums Wastewater Treatment System Replacement. Your comments will be addressed in the Draft Environmental Assessment, to include:

- In regard to your questions on the design capacity and about sufficient detention time –
There are 112-bedroom units * 200 gallons per day (gdp) per bedroom unit = 22,400 gdp. The design flow of 22,400 gdp was calculated based on the “Hawaii Administrative Rules”, Department of Health [DOH], Chapter 62 Title 11, Wastewater Systems, State of Hawaii, dated March 21, 2016.
- Regarding enforceable policies and procedures in high density areas that reduce the amount of waste stream/pressure on the system –
The effluent leaving the wastewater treatment plant will be disposed of in accordance with the DOH Wastewater Branch Standards. The wastewater will not enter an additional system, but will be disposed of on-site.

Should you have any questions in the future, please contact the undersigned at (808) 261-0740, at the letter head address, or via e-mail at sdavis@esciencei.com.

Sincerely,

A handwritten signature in black ink, appearing to read "Step Davis", with a stylized flourish at the end.

Stephanie Davis
Project Manager

Draft EA Comments and Responses

Ono Vista Condominiums Wastewater Treatment System Replacement

Draft Environmental Assessment

The following parties provided comments on the Draft Environmental Assessment.

CITY AND COUNTY OF HONOLULU

Department of Planning and Permitting

INDIVIDUALS

Mr. Steve Holmes, Former Honolulu City Councilmember



Environmental Science International
354 Uluniu Street, Suite 304, Kailua, Hawaii 96734
(808) 261-0740

ESI Project No. 122067

May 8, 2023

Department of Planning and Permitting
City and County of Honolulu
650 South King Street, 7th Floor
Honolulu, Hawaii 96813

Attention: Zack Stoddard

Subject: Response to Comments on Draft Environmental Assessment, Replacement Wastewater Treatment System, Ono Vista Condominium, 68-090 Au Street – Waialua, Tax Map Key 6-8-011:058.

Reference: Comment Letter from the City and County of Honolulu, Department of Planning and Permitting, to Environmental Science International, February 28, 2023 [2022/ED-29(ZS)].

Dear Mr. Stoddard,

On behalf of Ono Vista Condominiums, we thank you for your prompt and thoughtful response to our submittal of the Draft Environmental Assessment [DEA] report for the proposed Ono Vista Condominiums Wastewater Treatment System Replacement Project (the “Project”) located at 68-090 Au Street in Waialua, Hawaii. We appreciate your Department taking the time to review the report.

The comments that the Department of Planning and Permitting have made are listed below in bold italics and our responses follow.

1. The final EA should include “WWTW” in the list of acronyms and abbreviations.

Added WWTW as requested.

2. Pages iii and 1-1 state that the EA is necessary because the Project is within the Special Management Area (SMA) and requires an SMA Use Permit. Please add that the EA is also required pursuant to Hawaii Revised Statutes Section 343-5(9)(A) (propose any wastewater treatment unit serving at least 50 single-family dwellings or the equivalent).

Updated pages iii and 1-1 to include “the EA is also required pursuant to Hawaii Revised Statutes Section 343-5(9)(A) (propose any wastewater treatment unit serving at least 50 single-family dwellings or the equivalent)”.

3. During pre-EA consultation, we requested a description of the structural differences between the existing and proposed wastewater systems, including drawings showing existing and proposed layouts and elevations. These descriptions and drawings must be updated in the final EA as follows:

- a. Section 1.6 should indicate which components of the existing facility are aboveground, and provide the dimensions of those features. All structures 30 inches or higher must be located outside the 10-foot required yards.**

As-built drawings for the original wastewater treatment system have been added to the EA as Appendix B (subsequent appendices were renumbered). Although the drawings are not of optimal quality, they show the general plans and layout of the existing system components.

The following paragraph has been added to Section 1.6:

“Aboveground components of the existing facility include the generator inside the machine room adjacent to the Pool House, and the system control panel and aeration blowers, which are located inside the Pool House (see Appendix A: Photographs 6, 13, and 14; and preliminary design plans included in Appendix C).”

- b. Page 2-2 states that the proposed system will include a new utility enclosure, but does not explain whether there are other proposed aboveground structures. Section 2 should describe all proposed aboveground structures and provide their dimensions, and provide the depths of the three proposed injection wells.**

Section 2 has been updated to describe all proposed aboveground structures, with their dimensions provided. Other revisions were made to Section 2 for clarity.

The second paragraph of Section 2.2 has been revised as follows:

“After passing through the UV disinfection system, treated effluent will be disposed in the existing injection wells. There will be one (1) primary injection well (IW1), one (1) 100% backup well (IW2), and one (1) redundancy well (IW3), each with a maximum depth of 100 feet.”

- c. Section 5.4.2 explains that the proposed wastewater treatment structure is 11 feet high, 14 feet wide, and 30 feet long, but does not explain how many of these structures are proposed, describe other proposed aboveground structures, or compare existing and proposed structures. Complete and accurate descriptions and comparisons should be included in this section of the final EA.**

Section 5.4.2 has been revised to provide more detail for the existing and proposed aboveground structures. The following paragraph was added.

“Most of the components of the existing wastewater treatment system are belowground, except for the emergency generator inside the machine room adjacent to the Pool House, and the system control panel and aeration blowers, which are located inside the Pool

House. The existing underground treatment tank is 60 feet long by 8 feet in diameter. The underground tank will be removed and replaced by four aboveground treatment tanks, which will be installed on four individual concrete pads. Other aboveground components of the new WWTW include the generator, blowers, and control panels, which will be contained in the back room of the existing Pool House. The dimensions of the treatment tanks are provided in Section 2. The machine room adjacent to the Pool House is planned to be demolished.”

- d. The final EA must include updated drawings to ensure an accurate accounting of the proposed Project. Figures 5a and 5b must include numbers on their graphic scales. Elevation drawings should be included as figures. These figures and all written descriptions must be consistent with the drawings in Appendix B. Sheet C-001 shows four new tanks, each approximately 13 feet long by four feet wide; Sheet C-002 shows tanks that are approximately 25 feet long by eight feet wide; and Sheets C-003 and C-006 show tanks that are approximately 50 feet long, 18 feet wide, and over 20 feet in height. Figures 5a and 5b, as well as Sheet C-001, show the proposed generator adjacent to the new utility enclosure, but Sheets C-002, C-003, and C-005 indicate that the new generator will be located along the south property line. These discrepancies must be addressed in the final EA.***

Basis of Design and Engineering Report (now in Appendix C of the EA), including the preliminary design plans, have been updated. Figures 5a and 5b have been updated with graphic scales and to match the most current preliminary design plans. Elevation drawing has been added as Figure 5c (also shown in drawing C-411 of preliminary design plans). Figures 5a and 5b, drawings in Appendix C, and written descriptions have been reviewed for consistency.

- 4. Section 5.4.1 states that there are existing trees and landscaping in the area where the existing wastewater treatment system is located in the parking lot. In the final EA, please describe or show these features on drawings, and explain whether they will be modified or enhanced.***

Section 5.4.1 has been updated with a more detailed description of the existing trees and landscaping in the area where the existing wastewater treatment system is located.

Because the new treatment tanks will be aboveground, there is no available room for existing trees to remain. The limited available landscaping areas will be grass or gravel. Gravel provides a low maintenance option. This information has been added to Section 5.4.2.

- 5. During pre-EA consultation, we also requested a comparison of the environmental impacts of the existing and proposed wastewater systems, and asked whether a National Pollutant Discharge Elimination System (NPDES) permit is required. Section 4.2.2 states that, based on communication with the State Department of Health, Clean Water Branch, an NPDES permit is not required for the wastewater system. The final EA should explain this determination and should include the documentation from the Clean Water Branch confirming the determination.***

Section 4.2.2, 2nd paragraph, has been revised as follows.

“The proposed WWTW is anticipated to have no adverse impacts on coastal waters. The proposed project will not cause an increase in runoff quantities, nor increase the volume of treated wastewater effluent. Construction and operation of the WWTW will be conducted in accordance with the State’s water quality standards (HAR Chapter 11-54). During construction, barriers (e.g., sediment fences, silt screens, bags, or environmental filter socks) will be used as needed to limit sediment and land-based sources of pollution from discharging into the coastal waters. Operation of the proposed WWTW will mitigate future potential spills of wastewater that could possibly reach the nearby coastal waters. Based on communication with the DOH Clean Water Branch, a NPDES permit is not currently required for the disposal of treated wastewater via the injection wells. However, the Clean Water Branch indicated they are currently working on regulations for subsurface discharges into State waters in light of the Supreme Court decision regarding Lahaina Wastewater Treatment Plant. When DOH Clean Water Branch determines the designating factors for a functional equivalent of a direct discharge, affected facilities will be notified that NPDES permit coverage is required. A copy of the correspondence with the DOH Clean Water Branch is included in Appendix E. Additionally, due to the oxygen supplied for the biological process within the treatment system, complete nitrification is anticipated based on the system design. The long-term impacts of the proposed project will be beneficial to near shore water quality and marine habitat.”

Documentation from the Clean Water Branch confirming the determination that an NPDES permit is not currently required is also attached.

6. ***The final EA should enumerate the specific objectives and policies that the proposed action supports and is compliant with in the Oahu General Plan relating to utilities, energy, and resiliency, for example, similar to the specific descriptions for conformance the applicant provided for the Hawaii State Plan and the North Shore Sustainable Communities Plan.***

Section 3.2.3 has been updated as follows.

The Oahu General Plan (City and County of Honolulu, 2021b) is a comprehensive statement of objectives and policies that sets forth the long-range aspirations of Oahu’s residents and the strategies to achieve them. It is the first tier of and lays the foundation for a comprehensive planning process that addresses physical, social, cultural, economic, and environmental concerns affecting the City and County of Honolulu. The most recent version of the plan was adopted by the City Council on December 1, 2021, as Resolution 21-023, CD1, and signed by the Mayor on January 14, 2022.

The Oahu General Plan seeks to protect and enhance Oahu’s natural beauty and environmental attributes by mitigating against the degradation of these assets. The proposed project directly supports multiple objectives and policies listed in the General Plan. The key areas that will be addressed by the proposed project are *Housing and Communities* as well as *Transportation and Utilities*.

Under the *Housing and Communities* key area, Objective A, Policies 3 and Policy 4 are relevant to the proposed project. The project will encourage more efficient use of

land and infrastructure as well as support and encourage programs to maintain and improve conditions of existing housing.

Under the *Transportation and Utilities* key area, Objective B, Policies 3 and 6, and Objective C, Policies 1, 2, and 3 are relevant to the proposed project. The project supports Objective B, Policies 3 and 6 by utilizing a technology that provides waste disposal services at a reasonable cost and in a manner that addresses environmental and community impacts, and by providing safe, reliable, efficient, and environmentally sound waste disposal services that consider the near- and long-term impacts of climate change during the siting and construction. The project supports Objective C, Policies 1, 2, and 3 by upgrading a utility system to avoid major breakdowns and service interruptions, providing improvements to utilities in existing neighborhoods to reduce substandard conditions and increase resilience to use fluctuations, natural hazards, extreme weather, and other climate impacts, and facilitating timely and orderly upgrades and expansions of a utility system.

- 7. While the Project is in conformance with the North Shore Sustainable Communities Plan, it should be noted that the North Shore Regional Wastewater Alternatives Plan (2012) calls out opportunities for the Project to reuse treated effluent for subsurface drip irrigation due to project's proximity to agricultural lots and Puuiki Park. The final EA should discuss the North Shore Regional Wastewater Alternatives Plan and explore a reuse alternative.**

A new section, Section 3.4, was added to discuss the North Shore Regional Wastewater Alternatives Plan and potential reuse options. The Ono Vista AOA is exploring opportunities to reuse the treated effluent for subsurface drip irrigation, either onsite or at the nearby Dole Private Beach Park.

The Final EA has been revised to address the issues raised by your comments. If you have questions or require additional information, please contact me at 808-261-0740 (office) or 808-542-4939 (cellular), or by email at sdavis@esciencei.com.

Sincerely,



Stephanie Davis
Project Manager
Environmental Science International, Inc.

Attachment: Email correspondence from DOH Clean Water Branch

Stephanie Davis

From: Lum, Darryl C <darryl.lum@doh.hawaii.gov>
Sent: Thursday, December 15, 2022 6:36 AM
To: Stephanie Davis
Subject: RE: Question regarding individual NPDES permit requirement

Hi Stephanie,

Because the wastewater goes into an injection well and does not directly enter the Pacific Ocean, a National Pollutant Discharge Elimination System (NPDES) permit is not required at this time. However, the DOH Clean Water Branch is currently working on regulations for subsurface discharges into State waters in light of the Supreme Court decision regarding Lahaina Wastewater Treatment Plant. When DOH determines the designating factors for a functional equivalent of a direct discharge, affected facilities will be notified that NPDES permit coverage is required.

Thanks,
Darryl

Darryl Lum
Clean Water Branch
State of Hawaii Department of Health
Phone: (808) 586-4309

Notice: This information and attachments are intended only for the use of the individual(s) or entity to which it is addressed, and may contain information that is privileged and/or confidential. If the reader of this message is not the intended recipient, any dissemination, distribution, or copying of this communication is strictly prohibited and may be punishable under state and federal law. If you have received this communication and/or attachments in error, please notify the sender via e-mail immediately and destroy all electronic and paper copies.

From: Stephanie Davis <SDavis@esciencei.com>
Sent: Wednesday, December 14, 2022 3:37 PM
To: Lum, Darryl C <darryl.lum@doh.hawaii.gov>
Subject: [EXTERNAL] RE: Question regarding individual NPDES permit requirement

Hi Darryl,

I'm preparing another EA for a SMA Permit Application for a proposed wastewater treatment system replacement at the Ono Vista Condominiums, which is located at 68-024 Apuhihi Street in Waialua, Hawaii. The Property is identified by the City & County of Honolulu as TMK No. (1) 6-8-011:058. See attached figures. During pre-consultation, DPP requested an explanation as to whether a NPDES permit is required since the treated effluent from the wastewater treatment system will be disposed in an existing injection well system. The property is located approximately 300 feet from the ocean. I would like to get confirmation whether an individual NPDES permit is required or not.

Thanks,

Stephanie Davis
Operations Manager



ENVIRONMENTAL SCIENCE INTERNATIONAL
NHOC - DOT UDBE - SDB



Environmental Science International
354 Uluniu Street, Suite 304, Kailua, Hawaii 96734
(808) 261-0740

ESI Project No. 122067

April 11, 2023

Steve Holmes
75-5865 Walua Road, E634
Kailua-Kona, HI 96740

Via email: councilmemberholmes@icloud.com

To: Steve Holmes, Former Honolulu City Councilmember

Subject: Response to Comments on Draft Environmental Assessment, Replacement Wastewater Treatment System, Ono Vista Condominium, 68-090 Au Street – Waialua, Tax Map Key 6-8-011:058.

Reference: Comment received via email, February 8, 2023.

Dear Mr. Holmes,

On behalf of Ono Vista Condominiums, we thank you for your prompt and thoughtful response to our submittal of the Draft Environmental Assessment [EA] report for the proposed Ono Vista Condominiums Wastewater Treatment System Replacement Project (the “Project”) located at 68-090 Au Street in Waialua, Hawaii. We appreciate you taking the time to review the report.

Your comment is listed below in bold italics and our response follows.

The U. S. Supreme Court in Maui County v. Hawai’i Wildlife Fund rule that wastewater discharges to groundwater that can convey to regulated coastal waters require a Clean Water Act permit. This decision has wide ranging impacts in Hawaii as there are hundreds of injection wells statewide that HDOH has only reviewed under the Safe Drinking Water Act while excluding Clean Water Act impacts. Failure to address this in the Draft EA for this package plant upgrade violates HEPA.

Last year on Maui, a group of Maalaea homeowners associations realized the legal import of the Supreme Court decision and petitioned the Maui Council for a solution.

Currently, HDOH has failed to respond to the high court ruling and left private and public wastewater plants with legal and regulatory exposure. Ono Vista is in the same situation. You really can’t just upgrade the aged package plant without considering the impacts and permitting that protect coastal water quality. Every day is an ongoing violation and subject to penalties.

Every environmental planner needs to be aware of this situation as they go into environmental review. Last year, for example, Sierra Club working with Earthjustice

attorneys responded to a Draft EA for the North Kona Pump Station on the Big Island. This would have facilitated greatly increased flows to the County Kealahou Treatment Plant nearby which also illegally discharges. Again, Earthjustice pointed out the HEPA violations in not considering coastal water impacts.

Earthjustice lead the legal fight to the U.S. Supreme Court and will want to grow their victory. Regardless, your AOA needs to be advised of the situation. The Draft EA is deficient and violates HEPA, but more importantly they have an ongoing violation of federal law. HDOH has left everyone vulnerable by not taking action.

Water recycling is an option as no federal permit is required. Maui chose this option for the Lahaina treatment plant. But, you can't recycle some and inject the rest. It really is an all or nothing situation.

Your concern is noted. Section 3.1.4 of the Draft EA discusses DOH Clean Water Branch requirements and regulations for water pollution control and, as stated in the last paragraph of Section 4.2.1, "The coastal waters adjacent to the Property are classified as Class A, which precludes any discharge which has not received the best degree of treatment or control compatible with the criteria established for this class. The specific criteria applicable to marine waters are included in HAR Chapter 11-54 (DOH, 2014b)."

Section 4.2.2 discusses the potential impacts of the proposed project on coastal waters. As noted in the Draft EA, the DOH Clean Water Branch was consulted regarding the requirement for a NPDES permit and they confirmed that a NPDES permit is not required for the disposal of treated wastewater via the injection wells (at this time). They added the following notice: "However, the DOH Clean Water Branch is currently working on regulations for subsurface discharges into State waters in light of the Supreme Court decision regarding Lahaina Wastewater Treatment Plant. When DOH determines the designating factors for a functional equivalent of a direct discharge, affected facilities will be notified that NPDES permit coverage is required." A copy of the correspondence with the DOH Clean Water Branch is attached for your reference, and will be included as an appendix in the Final EA.

According to the EPA website, "EPA's Pacific Southwest (Region 9) issues all NPDES permits for any discharges into federal ocean waters in Hawaii. All other NPDES permits are issued by the Hawaii Department of Health. Currently, there are no EPA-issued permits for any discharges in Hawaii."

The Ono Vista AOA is considering reuse alternatives for the treated effluent.

The Final EA has been revised to address the issues raised by your comments. If you have questions or require additional information, please contact me at 808-261-0740 (office) or 808-542-4939 (cellular), or by email at sdavis@esciencei.com.

Mr. Steve Holmes
April 11, 2023
Page 3

Sincerely,

A handwritten signature in black ink, appearing to read "Step Davis", written in a cursive style.

Stephanie Davis
Project Manager
Environmental Science International, Inc.

Attachment: Correspondence with the DOH Clean Water Branch

Stephanie Davis

From: Lum, Darryl C <darryl.lum@doh.hawaii.gov>
Sent: Thursday, December 15, 2022 6:36 AM
To: Stephanie Davis
Subject: RE: Question regarding individual NPDES permit requirement

Hi Stephanie,

Because the wastewater goes into an injection well and does not directly enter the Pacific Ocean, a National Pollutant Discharge Elimination System (NPDES) permit is not required at this time. However, the DOH Clean Water Branch is currently working on regulations for subsurface discharges into State waters in light of the Supreme Court decision regarding Lahaina Wastewater Treatment Plant. When DOH determines the designating factors for a functional equivalent of a direct discharge, affected facilities will be notified that NPDES permit coverage is required.

Thanks,
Darryl

Darryl Lum
Clean Water Branch
State of Hawaii Department of Health
Phone: (808) 586-4309

Notice: This information and attachments are intended only for the use of the individual(s) or entity to which it is addressed, and may contain information that is privileged and/or confidential. If the reader of this message is not the intended recipient, any dissemination, distribution, or copying of this communication is strictly prohibited and may be punishable under state and federal law. If you have received this communication and/or attachments in error, please notify the sender via e-mail immediately and destroy all electronic and paper copies.

From: Stephanie Davis <SDavis@esciencei.com>
Sent: Wednesday, December 14, 2022 3:37 PM
To: Lum, Darryl C <darryl.lum@doh.hawaii.gov>
Subject: [EXTERNAL] RE: Question regarding individual NPDES permit requirement

Hi Darryl,

I'm preparing another EA for a SMA Permit Application for a proposed wastewater treatment system replacement at the Ono Vista Condominiums, which is located at 68-024 Apuhihi Street in Waialua, Hawaii. The Property is identified by the City & County of Honolulu as TMK No. (1) 6-8-011:058. See attached figures. During pre-consultation, DPP requested an explanation as to whether a NPDES permit is required since the treated effluent from the wastewater treatment system will be disposed in an existing injection well system. The property is located approximately 300 feet from the ocean. I would like to get confirmation whether an individual NPDES permit is required or not.

Thanks,


Stephanie Davis
Operations Manager



ENVIRONMENTAL SCIENCE INTERNATIONAL
NHOC - DOT UDBE - SDB

APPENDIX F

DOH Safe Drinking Water Branch Approval to Construct, Three Injection Wells



STATE OF HAWAII
DEPARTMENT OF HEALTH
P. O. BOX 3378
HONOLULU, HI 96801-3378

In reply, please refer to:
File: SDWB

1305Nov01ATC.docx

November 9, 2022

Ms. Sarada Wright
President
Association of Apartment Owners of Ono Vista
68-090 Au Street
Waialua Hawaii 96791

Dear Ms. Wright:

SUBJECT: ONO VISTA CONDOMINIUM
UNDERGROUND INJECTION CONTROL (UIC)
UIC PERMIT NO. UO-1305
GRANTED APPROVAL-TO-CONSTRUCT (ATC)
THREE (3) INJECTION WELLS

The Safe Drinking Water Branch (SDWB) UIC Program has reviewed your application for a UIC permit. Your application has been assigned the number listed above. Please list this number in all future correspondence.

This ATC is hereby granted to you, the applicant, strictly based on the following 20 conditions. These conditions, unless identified as a recommendation, are enforceable under Hawaii Administrative Rules (HAR), Sections 11-23-07(c) and (d). Enforcement may include, and not be limited to, monetary penalties and corrective action paid by the applicant.

1. Only applicable are the information, specifications, and plans that were provided in the revised UIC application received on August 12, 2022. All other types or forms of information/materials are not applicable unless acknowledged and approved by this ATC;
2. The injection well amount per the application is three (3).

The approximate diameter and depth below ground surface of the injection wells are:

Well No.	Diameter (inches)	Depth (feet)
1	8	100
2	8	100
3	8	100

The proposed injectant is generally categorized as treated sewage wastewater;

3. Any modification or revision to the injection wells' particulars, including the facility and application, shall not occur unless such proposals are first submitted to the UIC program for review, concurrence, and written approval under this ATC. Any modification, revision, or construction involving the injection wells done without written authorization will constitute a violation of HAR, Chapter 11-23;
4. A geologist shall be involved from the start of injection well construction to monitor the drilling on a daily basis, either directly or by detailed field reporting to the geologist;
5. Weekly reports, on a day basis, shall be made to the UIC program throughout the duration of active injection well drilling. The reports shall include, but not be limited to, current well diameter and depth, major or significant geologic or hydrogeologic conditions encountered by the drilling, and preliminary injection test findings. Reports shall be concise, professionally prepared or reviewed, organized consistently, and purposeful. Reports shall be transmitted via email to sdwb@doh.hawaii.gov on Mondays following every work week. Enclosed is a suggested weekly reporting format;
6. We recommend that the entire well bore length be properly cased, i.e., no open hole, in order to eliminate sidewall collapse which may not be recoverable without redrilling;
7. The applicant is responsible to identify all drinking water sources around the injection wells in order to prevent injection well siting within one-quarter mile of any existing drinking water source. Identifying water sources may require field activities as well as records research. Noncompliance with this requirement may result in improper injection well siting needing corrective action by the applicant which includes proper backfilling and abandonment of the injection well;
8. Comply with applicable conditions stipulated in HAR, Section 11-23-10, such as the requirement of at least a fifty-foot buffer zone between the bottom of the injection well and the top of the volcanic aquifer when establishing an injection well in the caprock formation;
9. Regarding deep injection, injection into a basalt formation shall not be into or adversely affecting an artesian aquifer;
10. If an artesian groundwater condition is encountered during the injection well drilling/construction, drilling shall immediately stop and not proceed until the artesian condition is assessed by the Department of Health (DOH). The applicant is required to promptly notify the DOH for an assessment. An artesian groundwater condition may warrant a redesign of the injection well in order to protect the artesian aquifer as an underground source of drinking water. For reference, artesian aquifer requirements and restrictions are described under HAR, Section 11-23-10;
11. If a void, such as a lava tube or solution cavity, 3 feet or more in diameter or vertical measurement is encountered during injection well drilling/construction, drilling shall immediately stop and not proceed until the void is assessed by the DOH. The applicant is required to promptly notify the DOH for an assessment. A void may


warrant a redesign of the injection well in order to prevent unacceptable migration of the injectant or to prevent direct injection into the void. For reference, voids are described under HAR, Section 11-23-09 (f);

12. Once the injection depth, for a shallow or deep injection well, is established and injection well construction is completed, a minimum 12-hour continuous injection test at design rates shall be conducted for the injection well. During injection well construction, preliminary injection testing over extended durations before the injection well is fully built is recommended, if practicable. Preliminary injection test results may provide a progressive estimate of injection capacities which tend to diminish with the installation of the well casing and the annular backfill;
13. If groundwater within the influence of the injection well is used for injection testing, the effects of groundwater withdrawal on the injection well's capacity should be addressed in the injection test results. The injection well's capacity should not include influences due to groundwater withdrawal for injection testing;
14. Operation of the injection well is not automatically authorized by this ATC. Furthermore, construction and testing of the injection well does not guarantee that the injection well will be authorized for operation under a UIC permit. Depending on the information obtained during and from construction and testing, a UIC permit may or may not be issued;
15. The fully constructed injection well must demonstrate satisfactory performance. An UIC permit may not be issued for an injection well that cannot successfully support the proposed discharge quantity;
16. The injection well shall be constructed to allow for the following continuous or periodic, permit-required activities related to operating and maintaining an injection well: injection well access, injection well depth and diameter measurement, injectant flow measurement (quantity) metering, injectant pressure measurement when applicable (metering), and injection performance testing;
17. Pursuant to HAR, Section 11-23-13, submit the final report for the enclosed outline: "Final Report Format For New or Modified Injection Well." This report shall be made and signed by a geologist and a professional engineer, including the P.E. stamp. The engineer and geologist shall be responsible for monitoring the proper construction of the injection wells and for obtaining the information needed to complete the final report;
18. The final report is due by November 9, 2024. The final report shall be fully complete and satisfactory. Unless the final report is submitted by the due-date, this ATC automatically expires and is void. A late final report may subject the applicant to an enforcement action/penalty or corrective measures, including a permit reapplication. If more time beyond the due-date is needed to complete the final report, a written request with reasons for a time extension must be submitted at least 60 days before the due-date. Time extensions are not guaranteed, and if granted, may contain restrictive conditions;

19. Backfilling and abandonment of an injection well, should such an activity become necessary, whether during construction or after full well completion, may only occur under the instructions from the DOH. An abandonment application must first be submitted, and specific abandonment instructions will be issued by the DOH. Drilling contractors under their own discretion should not backfill and abandon an injection well; and
20. You are required to notify Mr. Mark Frazier by email at sdwb@doh.hawaii.gov one week prior to the injection well testing. You will be informed if DOH personnel will be present to witness the injection well testing. If you conduct the injection well test without notifying the DOH, you will be required to redo the injection well test under proper witnessing. Injection well testing for the purpose of the final report shall be valid only when such testing is performed on the fully completed injection well.

If you have any questions about the final report, or the processing of your application, please contact Mr. Mark Frazier of the SDWB UIC Program at (808) 586-4258 or by email at sdwb@doh.hawaii.gov.

Sincerely,



JOANNA L. SETO, P.E., CHIEF
Environmental Management Division

MF:mb

Enclosures: Final Report Format For New or Modified Injection Well
Weekly Report Format
Signatory and Certification Statement

c: Mr. Kevin Gooding, INTERA, Inc. (w/encls.)
[via kgooding@intera.com only]

**FINAL REPORT FORMAT FOR
NEW OR MODIFIED INJECTION WELL
UNDERGROUND INJECTION CONTROL (UIC)
UIC APPLICATION NO. UO-1305A**

For Office Use

1. General Information:
 - a. Facility Name:
 - b. Address:
 - c. Applicant (Permittee):
2. Physical Characteristics of the Area:
 - a. Location and accessibility:
 - b. Climate:
 - c. Topography:
 - d. Geologic and foundation conditions:
 - e. Earthquake considerations:
 - f. Flood potential including tsunami inundation zones:
 - g. Conformance with local land-use planning and zoning regulations:
 - h. Sensitive environments: natural or community-related:
3. Injection Well System:
 - a. Actual number of injection wells constructed or modified:
 - b. Date of construction or modification:
 - c. Security from unauthorized access (As-built drawing of the modified injection well):
 - d. Site plan (drawn to scale) showing location of constructed or modified injection wells:
 - e. Description of any changes from the permit application:
4. Hydrogeologic Characteristics:
 - a. Well log (geologic profile) by geologist for each injection well drilled:
 - i. General formations: e.g., organic, fill, soil, saprolite, decomposed rock, sedimentary, lagoonal, marine, alluvial, coral, dune, beach, pyroclastic, ash, pahoehoe, `a`a, ponded lava, tuff, etc.
 - ii. Physical and structural characteristics of the formations encountered. The following characteristics shall be used in the descriptions: color, hardness (competency), degree of weathering, qualitative degree of fracturing or consolidation, qualitative degree of vesiculation or porosity, unified soil classification for soils, volcanic series or lithologic formation for rock, petrologic terminologies for rock and cinder, lava type, and the differentiation between soil and rock units;
 - b. Injection testing:
 - i. Minimum 12 hours of continuous injection testing for wells No. 1 and 3:
 - ii. Complete results of injection testing including maximum injection capacity of each well and hydraulic conductivity of the injection formation. Injection test results shall be shown graphically with the related data.

c. Groundwater characteristics: (if encountered)

- i. Initial water level, and subsequent water level as fluctuations occur (below ground surface and corresponding elevation per msl):
- ii. Tidal fluctuations and tidal efficiency:
- iii. Continuous profile of total dissolved solids and salinity (maximum 5-foot sample intervals if done with discrete sampler) for all wells obtained before the introduction of any foreign fluids. The profiling shall represent stabilized conditions without influence or restriction from any well casing and shall extend to the bottom of the boring. Profiling within solid casing strings are typically not acceptable;
- iv. Water samples collected from each distinct zone of significantly different total dissolved solids or salinity concentration levels.

Water samples shall be analyzed using EPA or EPA equivalent standards and methods for the following parameters:

<u>Parameter</u>	<u>EPA Method</u>
chlorides	325
conductivity (specific conductance)	120
dissolved oxygen	360
Fecal Coliform	MF or MPN
field pH	150
field temperature	170
nitrate+nitrite as (N)	353
Total Dissolved Solids	160

5. Special considerations to be addressed by this report: (None)
6. Attach an original Signatory and Certification Statement sheet signed and dated by the permittee or legal representative.
7. Preparers' signature: The final report shall be signed by the geologist and licensed engineer and shall bear the engineer's stamp.
8. Submit the final report by mail to Uluakupu Building 4, 2385 Waimano Home Road, Suite 110, Pearl City, Hawaii 96782-1400 and email at sdwb@doh.hawaii.gov.

INJECTION WELL CONSTRUCTION WEEKLY REPORT FORM

(Send to: Safe Drinking Water Branch email: sdwb@doh.hawaii.gov)

Report Date: _____

Project Name: _____

Reported By: _____

UIC No.: _____

Driller: _____

Injection Well No.: _____

Date	Depths Drilled (feet bgs)	Diameter (inches)	Casing Depth (feet)	Remarks*
	from: to:			
	from: to:			
	from: to:			
	from: to:			
	from: to:			
	from: to:			

* Remarks should include formation & materials encountered, anomalies, injection considerations and indications

**SIGNATORY AND CERTIFICATION STATEMENT
FOR UNDERGROUND INJECTION CONTROL (UIC) SUBMITTALS**
*Submitted Statement shall bear an original signature and date.
Photocopy signatures are unsatisfactory.*

Facility Name: _____

e-Permitting Submission No. (if applicable) _____

UIC No. (if assigned): _____

Please check one:

- I certify that for a municipality, I am a principal executive officer or ranking elected official.
- I certify that for a state, non-federal or other public agency, I am a principal executive officer or ranking elected official.
- I certify that for a federal agency, I am the chief executive officer of the agency, or I am the senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency.
- I certify that I am a general partner for a partnership.
- I certify that I am the proprietor for a sole proprietorship.
- I certify that I am a trustee for a trust.
- I certify that for a corporation/association of apartment owners/home owners association, I am the President, Vice President, Secretary or Treasurer of the corporation/association of apartment owners/home owners association and in charge of a principal business function, or I perform similar policy or decision making functions for the corporation/association of apartment owners/home owners association.
- I certify that for a corporation, I am the manager of one or more manufacturing, production or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), and authority to sign documents has been assigned or delegated to me in accordance with corporate procedures.
- I certify that for a limited liability company (LLC), I am the Manager or a Member authorized to make management decisions for the LLC and am in charge of a principal business function, or I perform similar policy or decision making functions for the LLC.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signature: _____ Date: _____

Name (Print): _____ Title: _____

Company Name: _____

Address: _____

Phone Number: _____ Fax Number: _____

Email: _____